

Instructions for use Construction Specification 1—Clearing

1. Applicability

Construction Specification 1 is applicable to the clearing of vegetation at construction sites where grubbing is not required.

2. Material specifications

No material specifications complement Construction Specification 1.

3. Included items

Items to be included in contract specifications and drawings follow:

- a. When the area(s) to be cleared is definable on the project layout map or other construction plan view drawing, the limits of each class (A, B, or C as defined in Section 2 Classification) of clearing must be shown and clearly defined.
- b. When the area(s) to be cleared is not definable on the drawings (which may occur for many channel improvement projects), the extent of each class of clearing required must be described by notes and by designation of right-of-way boundaries and station limits. The full extent of work to be performed must be clearly defined.
- c. When replacement plants are required because of damage caused by the contractor, the specific size, number, and species needs to be specified in section 8. Example: "Any tree removed that was designated to remain or is irreparably damaged shall be replaced with two 15-gallon valley oak (*Quercus lobata*) as directed by the contracting officer."
- d. When measurement and payment are identified to be in accordance with method 2, section 7, the survey line(s) along which the length of cleared area(s) is to be measured must be designated. The lateral extent and station reaches of the area(s) to be cleared must be clearly defined.
- e. Areas in which disposal of refuse/waste material is not allowed or areas where disposal is restricted or limited must be clearly defined or shown on the drawings.
- f. Required minimum depth of earth cover over buried materials, if applicable.
- g. Required surface grading over buried materials, if applicable. Existing natural flow patterns onto or from the construction site onto other properties must be a consideration in the final grading.
- h. Restrictions on the use of explosives, if any.
- i. Restrictions on the burning of combustible materials as a disposal procedure, if any.
- j. Special requirements to control erosion, water pollution, and air pollution, if applicable. Requirements of this specification must be compatible with any and all requirements outlined in Construction Specification 5, Pollution Control, when included as part of the contract.
- k. Method(s) of measurement and payment if the standard specification includes more than one method.

4. Methods

Section 7, Measurement and payment

Methods 1 and 3—Intended for use when the area(s) to be cleared is extensive and can be defined in area units on the ground and clearly shown on the drawing(s). Section 8 should specify horizontal or surface measurements to be used to determine area cleared. A reservoir project is a good example of this type of site.

Method 2—Intended for use when the area(s) to be cleared is long and narrow, and cannot be clearly defined on the drawings. Section 8 should specify horizontal or surface measurements to be

used to determine area cleared. A channel right-of-way is a typical example of this type of site.

Method 4—Intended for use when the area(s) to be cleared cannot be measured practically and when it is reasonable to expect that variations in the quantity of clearing to be performed will be minor. For method 4, the procedures that will be used to determine the amount of work satisfactorily completed for progress payment need to be identified in section 8. Options may include:

- An onsite agreed-to estimate of the percent of work satisfactorily completed at time of progress payment cutoff.
- Require the contractor to provide measurements of all areas and those that have been satisfactorily cleared, and use a percentage of the total item.
- Other suitable and fair methods, one of which could be related to the construction schedule.

When all but one method is deleted for use in a contract specification, delete from the last paragraph ***All Methods The following provisions apply to all methods of measurement and payment.*** Left justify the remaining text.

5. Items of work and construction details

Starting at the top of page 1–3, prepare and outline job specific "Items of Work and Construction Details" (IWCD) in accordance with these instructions. For ease of utilization, the use of recyclable color paper for the IWCD should be considered.

Construction Specification 1—Clearing

1. Scope

The work shall consist of the clearing and disposal of trees, snags, logs, brush, shrubs, stumps, and rubbish from the designated areas.

2. Classification

Unless otherwise specified in section 8, clearing will be classified according to the following definitions:

Class A—Requires that trees and other woody vegetation be removed so that the remaining stumps extend no higher than 4 inches above the ground surface.

Class B—Requires that trees and other woody vegetation be removed so that the remaining stumps extend no higher than 12 inches above the ground surface.

Class C—Requires that trees and other woody vegetation be removed as near the ground surface as conventional tools or field conditions will permit or as specified in section 8.

3. Protection of existing vegetation

Trees and other woody vegetation designated to remain undisturbed shall be protected from damage throughout the entire construction period. Any damage resulting from the contractor's operations or neglect shall be repaired by the contractor.

Earthfill, stockpiling of materials, vehicular parking, and excessive foot or vehicular traffic shall not be allowed within the dripline of vegetation designated to remain in place. Vegetation damaged by any of these or similar actions shall be replaced with viable vegetation of the same species or as specified in section 8 and approved by the contracting officer.

Any cuts, skins, scrapes, or bruises to the bark of the vegetation shall be carefully trimmed and local nursery accepted procedures used to seal damaged bark.

Any limbs or branches 0.5-inch or larger in diameter that are broken, severed, or otherwise seriously damaged during construction shall be cut off at the base of the damaged limb or branch flush with the adjacent limb or tree trunk.

All roots 1 inch or larger in diameter that are cut, broken, or otherwise severed during construction operations shall have the end smoothly cut perpendicular to the root. Roots exposed during excavation or other operations shall be covered with moist earth and/or backfilled as soon as possible to prevent them from drying.

4. Marking

The limits of the areas to be cleared will be marked by stakes, flags, tree markings, or other suitable methods. Trees to be left standing and uninjured will be designated by special markings placed on the trunks at a height of about 6 feet above the ground surface.

5. Clearing

All trees not marked for preservation and all snags, logs, brush, shrubs, stumps, rubbish, and similar materials shall be cleared from within the limits of the marked areas.

6. Disposal

All materials cleared from the designated areas shall be disposed of at locations shown on the drawings or in a manner specified in section 8. The contractor is responsible for complying with all local rules and regulations and the payment of any and all fees that may result from the disposal at locations away from the construction location.

7. Measurement and payment

Method 1—For items of work for which specific unit prices are established in the contract, the cleared area is measured to the nearest 0.1 acre. Payment for clearing is made for the total area within the designated limits at the contract unit price for the specified class of clearing. Such payment will constitute full compensation for all labor, equipment, tools, and all other items necessary and incidental to the completion of the work.

Method 2—For items of work for which specific unit prices are established in the contract, the length of the cleared area is measured to the nearest full station (100 feet) along the line designated on the drawings or in the specifications. Payment for clearing is made for the total length within the designated limits at the contract unit price for the specified class of clearing. Such payment will constitute full compensation for all labor, equipment, tools, and all other items necessary and incidental to the completion of the work.

Method 3—For items of work for which specific unit prices are established in the contract, the cleared areas is measured within the specified limits to the nearest 0.1 acre. The cleared areas are determined by measuring the width cleared, within the specified limits, at representative sections and multiplying the average width between sections by the linear distance between sections. Payment for clearing is made at the contract unit price for the item and shall constitute full compensation for all labor, equipment, tools, and all other items necessary and incidental to the completion of the work.

Method 4—For items of work for which specific lump sum prices are established in the contract, payment for clearing is made at the contract lump sum prices. Such payment shall constitute full compensation for all labor, equipment, tools, and all other items necessary and incidental to the completion of the work.

All Methods—These provisions apply to all methods of measurement and payment. Compensation for any item of work described in the contract, but not listed in the bid schedule is included in the payment for the item of work to which it is made subsidiary. Such items and the items to which they are made subsidiary are identified in section 8.

8. Items of work and construction details

Instructions for use Construction Specification 2—Clearing and Grubbing

1. Applicability

Construction Specification 2 is applicable to the clearing and grubbing of woody vegetation and the removal of trash and rubbish at construction sites.

2. Material specifications

No material specifications complement Construction Specification 2.

3. Included items

Items to be included in contract specifications and drawings follow:

- a. When the area(s) to be cleared and grubbed, including area(s) of rubbish removal, is definable on the project layout map or other construction plan view, the limits must be shown and clearly defined.
- b. When the area(s) to be cleared and grubbed is not definable on the drawings (which may occur for many channel improvement projects), the extent of clearing and grubbing required must be described by notes and by designation of right-of-way boundaries and station limits.
- c. When replacement plants are required because of damage caused by the contractor, the specific size, number, and species needs to be specified in section 7. Example: "Any tree removed that was designated to remain or is irreparably damaged shall be replaced with two 15-gallon valley oak (*Quercus lobata*) as directed by the contracting officer."
- d. When measurement and payment are identified to be in accordance with method 2, section 6, the survey line(s) along which the cleared and grubbed area(s) length is to be measured must be designated. The lateral extent and station reaches of the area(s) to be cleared and grubbed must be clearly defined.
- e. Areas in which disposal of refuse/waste material is not allowed or areas where disposal is restricted must be clearly defined or shown on the drawings.
- f. Special requirements for grubbing depth, if required.
- g. Required depth of earth cover over buried materials, if applicable.
- h. Required surface grading over buried materials, if applicable. Existing natural flow patterns onto the construction site or from the site onto other properties must be a consideration in the final grading.
- i. Restrictions on the use of explosives, if any.
- j. Restrictions on the burning of combustible materials as a disposal procedure, if any.
- k. Special requirements for control of erosion, water pollution, and air pollution, if applicable. Requirements of this specification must be compatible with any and all requirements outlined in Construction Specification 5, Pollution Control, when included as part of the contract.
- l. Method(s) of measurement and payment if the standard specification includes more than one method.

4. Methods

Section 6, Measurement and payment

Method 1—Intended for use when the area(s) to be cleared and grubbed is extensive and can be defined in units of area on the ground and on the drawings. Section 6 should specify horizontal or surface measurements to be used to determine area cleared and grubbed. A reservoir area is a typical example of this type of site.

Method 2—Intended for use when the area(s) to be cleared and grubbed is long and narrow. Section 6 should specify horizontal or surface measurements to be used to determine length of clearing and grubbing. A channel right-of-way is a typical example of this type of site.

Method 3—Intended for use when the area(s) to be cleared and grubbed is extensive, but the vegetation consists mainly of scattered trees, stumps, or snags that can be measured individually.

Method 4—Intended for use when the area(s) to be cleared and grubbed cannot be measured practically and when it is reasonable to expect that variations in the estimated quantity of work to be performed will not occur after the contract is awarded. For method 4, the procedures that will be used to determine the amount of work satisfactorily completed for progress payment need to be identified in section 7. Options may include:

- An onsite agreed-to estimate of the percent of work satisfactorily completed at time of cutoff.
- Require the contractor to provide measurements of all areas and identify those that have been satisfactorily cleared and grubbed, and use a percentage of the total bid item.
- Other suitable and fair methods, one of which could be related to construction schedule.
- When all but one method is deleted for use in a contract specification, delete from the last paragraph **All Methods The following provisions apply to all methods of measurement and payment.** After deleting, left justify the remaining text.

5. Items of work and construction details

Starting at the top of page 2–3, prepare and outline job specific "Items of Work and Construction Details" (IWCD) in accordance with these instructions. For ease of utilization, the use of recyclable color paper for the IWCD should be considered.

Construction Specification 2—Clearing and Grubbing

1. Scope

The work consists of clearing and grubbing and disposal of trees, snags, logs, brush, stumps, shrubs, and rubbish from the designated areas.

2. Protection of existing vegetation

Trees and other vegetation designated to remain undisturbed shall be protected from damage throughout the duration of the construction period. Any damages resulting from the contractor's operations or neglect shall be repaired by the contractor.

Earthfill, stockpiling of materials, vehicular parking, and excessive foot or vehicular traffic shall not be allowed within the drip line of vegetation designated to remain in place. Vegetation damaged by any of these or similar actions shall be replaced with viable vegetation of the same species, similar condition, and like size unless otherwise approved by the contracting officer.

Any cuts, skins, scrapes, or bruises to the bark of the vegetation shall be carefully trimmed and local nursery accepted procedures used to seal damaged bark.

Any limbs or branches 0.5 inch or larger in diameter that are broken, severed, or otherwise seriously damaged during construction shall be cut off at the base of the damaged limb or branch flush with the adjacent limb or tree trunk. All roots 1-inch or larger in diameter that are cut, broken, or otherwise severed during construction operations shall have the end smoothly cut perpendicular to the root. Roots exposed during excavation or other operations shall be covered with moist earth or backfilled as soon as possible to prevent the roots from drying out.

3. Marking

The limits of the area(s) to be cleared and grubbed will be marked by stakes, flags, tree markings, or other suitable methods. Trees to be left standing and uninjured will be designated by special markings placed on the trunk about 6 feet above the ground surface.

4. Clearing and grubbing

All trees not marked for preservation and all snags, logs, brush, stumps, shrubs, rubbish, and similar materials shall be cleared from within the limits of the designated areas. Unless otherwise specified, all stumps, roots, and root clusters that have a diameter of 1 inch or larger shall be grubbed out to a depth of at least 2 feet below subgrade for concrete structures and 1 foot below the ground surface at embankment sites and other designated areas.

5. Disposal

All materials cleared and grubbed from the designated areas shall be disposed of at locations shown on the drawings or in a manner specified in section 7. The contractor is responsible for complying with all local rules and regulations and the payment of any and all fees that may result from disposal at locations away from the project site.

6. Measurement and payment

Method 1—For items of work for which specific units prices are established in the contract, the cleared and grubbed area is measured to the nearest 0.1 acre. Payment for clearing and grubbing is made for the total area within the designated limits at the contract unit price. Such payment will constitute full compensation for all labor, equipment, tools, and all other items necessary and incidental to the completion of the work.

Method 2—For items of work for which specific unit prices are established in the contract, the length of the cleared and grubbed area is measured to the nearest full station (100 feet) along the line designated on the drawing or identified in the specifications. Payment for clearing and grubbing is made for the total length within the designated limits at the contract unit price. Such payment will constitute full compensation for all labor, equipment, tools, and all other items necessary and incidental to the completion of the work.

Method 3—For items of work for which specific unit prices are established in the contract, each tree, stump, and snag having a diameter of 4 inches or larger and each log having a diameter of 4 inches or larger and a length of 10 feet are measured before removal. The size of each tree and snag is determined by measuring its trunk at breast height above the natural ground surface. The size of each log is determined by measuring the butt and by measuring its length from butt to tip. The size of each stump is measured at the top. Diameter is determined by dividing the measured circumference by 3.14.

Payment for clearing and grubbing of each tree, stump, and snag having a diameter of 4 inches or larger and each log having a diameter of 4 inches or larger and a length of 10 feet or larger is made at the contract unit price for its size designation as determined by the following schedule:

Measured diameter (in)	Size designation (in)
4 to 8	6
8 to 12	10
12 to 24	18
24 to 36	30
36 to 60	48
Over 60	60

The sum of such payments shall constitute full compensation for clearing and grubbing (including the clearing and grubbing of smaller trees, stumps, snags, logs, brush, shrubs, and roots), applicable permits and associated fees, and rubbish removal. Such payment shall constitute full compensation for all labor, equipment, tools, and all other items necessary and incidental to the completion of the work.

Method 4—For items of work for which specific lump sum prices are established in the contract, payment for clearing and grubbing is made at the contract lump sum price. Such payment shall constitute full compensation for all labor, equipment, tools, and all other items necessary and incidental to the completion of the work.

All Methods—The following provisions apply to all methods of measurement and payment. Compensation for any item of work described in the contract, but not listed in the bid schedule will be included in the payment for the item of work to which it is made subsidiary. Such items and the items to which they are made subsidiary are identified in section 7.

7. Items of work and construction details

Instructions for use Construction Specification 3—Structure Removal

1. Applicability

Construction Specification 3 is applicable to the removal of all types of structures (including fences) from construction sites.

2. Material specifications

No material specifications complement Construction Specification 3.

3. Included items

Items to be included in contract specifications and drawings follow:

- a. The location and description of each structure or fence to be removed or the area from which structures are to be removed must be shown on the drawings. If structure removal is designated by area limits, the location and description of all buried structures to be removed must be shown together with area boundaries. All known information regarding the structure must be shown.
- b. The location and types of structures or fences to be preserved in place or to be salvaged must be shown on the drawings.
- c. The required extent and depth of removal.
- d. The locations of storage areas for salvaged structural materials must be shown on the drawings or indicated by appropriate notations. **Note:** A separate bid item may be required as a result of cost sharing arrangements when structure salvage is included in the contract.
- e. Areas where disposal of refuse material is not permitted or areas where disposal is limited, if known. If refuse materials must be disposed of outside the right-of-way or work limits, make appropriate notation.
- f. Structures, including fences, to be removed by others.
- g. Required minimum depth of earth cover, soil density requirements, and surface grading over buried materials, if applicable.
- h. Restrictions on the use of explosives, if any.
- i. Special requirements for control of erosion, water pollution, and air pollution, if applicable. Requirements of this specification must be compatible with any and all requirements outlined in Construction Specification 5, Pollution Control, when included as part of the contract.
- j. Method(s) of measurement and payment, if the standard specification includes more than one method.

4. Methods

Section 2, Marking

Method 1—Intended for use when the structures to be removed are of significant size or when structures at several easy to identify locations must be removed. Whenever possible, this method is preferred over method 2.

Method 2—Used when several small structures located within the work limits are to be removed.

Section 3, Removal

Method 1—Compatible with Method 1, Marking, and must be used accordingly.

Method 2—Compatible with Method 2, Marking, and must be used accordingly.

Section 6, Measurement and payment

Method 1—For measurement and payment on a unit basis.

Method 2—For payment on a lump sum basis. For this method, section 7 should include the procedures that will be used to determine extent of satisfactory completed work for progress payment purposes.

When using only one of the methods in the contract, delete **All Methods** *The following provisions apply to all methods of measurement and payment.* Left justify the remaining text.

5. Items of work and construction details

Starting at the top of page 3-3, prepare and outline job specific "Items of Work and Construction Details" (IWCD) in accordance with these instructions. For ease of utilization, the use of recyclable color paper for the IWCD should be considered.

Construction Specification 3—Structure Removal

1. Scope

The work shall consist of the removal, salvage, and disposal of structures (including fences) from the designated areas.

2. Marking

Method 1—Each structure or structure part to be removed will be marked with stakes, flags, paint, or other suitable method.

Method 2—The area boundaries from which structures must be removed will be marked using stakes, flags, paint, or other suitable method. Structures to remain undisturbed or to be salvaged will be designated by special markings.

3. Removal

Method 1—All structures designated for removal in the contract shall be removed to the specified extent and depth.

Method 2—Within the areas so marked, all visible and buried structures identified shall be removed to the specified extent and depth.

4. Salvage

Structures or structure parts that are designated to be salvaged shall be carefully removed and neatly placed in the specified or approved storage location. Salvaged structures that are capable of being disassembled shall be dismantled into individual members or sections. Such structures shall be neatly and systematically match marked with paint before disassembly. All connectors and other parts shall be marked to indicate their proper location within the structure and shall be fastened to the appropriate structural member or packed in suitable containers.

Material from fences designated to be salvaged shall be placed outside the work area on the property on which the fence was originally located. Fence wire shall be rolled into uniform rolls of suitable size and neatly piled with other salvaged materials. Posts and rails shall be neatly stacked.

5. Disposal of refuse materials

Refuse materials resulting from structure removal shall be disposed of in a manner and at locations specified in section 7 of this specification or in an acceptable manner and at locations approved by the contracting officer. Disposal by burning shall be in accordance with local rules and regulations.

6. Measurement and payment

Method 1—For items of work for which specific unit prices are established by the contract, payment for the removal of each structure unit, except fences, is made at the contract unit price. Fences removed or removed and salvaged are measured to the nearest linear foot. Payment for fence removal or removal and salvage is made at the contract unit prices for each type and size of fence.

Such payment will constitute full compensation for all labor, equipment, tools, applicable permits and associated fees for burning and disposal of refuse, and all other items necessary and incidental to the completion of the work.

Method 2—For items of work for which specific lump sum prices are established by the contract, payment for structure removal is made at the contract lump sum price.

Such payment will constitute full compensation for all labor, equipment, tools, applicable permits and associated fees for burning and disposal of refuse, and all other items necessary and incidental to the completion of the work.

All Methods—The following provisions apply to all methods of measurement and payment. Compensation for any item of work described in the contract, but not listed as a contract line item number in the bid schedule, is included in the payment for the item of work to which it is made subsidiary. Such items and items to which they are made subsidiary are identified in section 7 of this specification.

7. Items of work and construction details

Instructions for use Construction Specification 4—Channel Clearing and Shaping

1. Applicability

Construction Specification 4 is applicable to the clearing, removal, and disposal of woody and other vegetation; removal and disposal of trash and rubbish; and the earth shaping of the bottom and sides of the channel. This specification is applicable for natural floodways, constructed channels, and other drainage systems.

2. Material specifications

No material specifications complement Construction Specification 4.

3. Included items

Items to be included in contract specifications and drawings

- a. The special markings indicating trees to be left standing, undisturbed, and uninjured must be described.
- b. For Section 2, Protection of Existing Vegetation, when the specific size of replacement plant is known or is desired, specify the number, size, and species of the replacement in section 8. Example: "Any tree designated to remain or is irreparably damaged shall be replaced with two 15-gallon valley oak (*Quercus lobata*) as directed by the contracting officer."
- c. Areas in which disposal of refuse material or other waste materials resulting from channel clearing and shaping activities is not allowed or areas where disposal is limited or restricted, if known.
- d. Restrictions on the burning of combustible materials as a disposal procedure, if any.
- e. The reaches of the stream or channel where shaping is to be performed.
- f. An illustration or description that provides the shaping requirements.

- g. Method(s) of measurement and payment if the standard specification includes more than one method.

4. Methods

Section 7, Measurement and Payment

Method 1—Intended for irregularly shaped reaches that need to be physically measured in the field. Section 8 should specify horizontal or surface measurements to be used to determine area cleared and shaped.

Methods 2 and 3—Intended for long channel reaches that have a uniform width and minor variations in width, respectively. Section 8 should specify horizontal or surface measurements to be used to determine area cleared and shaped.

Method 4—Intended for use where the amount of work required is relatively consistent throughout the described work area. For this method, procedures that will be used to determine the amount of work satisfactorily completed for progress payment need to be identified in section 8. Options may include:

- An onsite agreed-to estimate of the percent of work satisfactorily completed at time of cutoff.
- Require the contractor to provide supporting calculations to determine extent of work satisfactorily completed.
- Other suitable and fair methods, one of which could be related to the construction schedule.

Method of measurement and payment

When all but one method are deleted for use in a contract specification, delete from the last paragraph *All Methods* *The following provisions apply to all methods of measurement and payment*. Left justify the remaining text.

5. Items of work and construction details

Starting at the top of page 4-3, prepare and outline job specific "Items of Work and Construction Details" (IWCD) in accordance with these instructions. For ease of utilization, the use of recyclable color paper for the IWCD should be considered.

Construction Specification 4—Channel Clearing and Shaping

1. Scope

The work consists of clearing designated areas by the removal and disposal of trees, logs, stumps, shrubs, brush, and rubbish, and the shaping of the channel.

2. Protection of existing vegetation

Trees and other vegetation designated to remain undisturbed shall be protected from damage throughout the duration of the construction period. Any damages resulting from the contractor's operations or neglect shall be repaired by the contractor.

Earthfill, stockpiling of materials, vehicle or equipment parking, and excessive foot or vehicle traffic shall not be allowed within the drip line of vegetation designated to remain in place. Vegetation damaged by any of these or similar actions shall be replaced with viable vegetation of the same species, similar condition, and like size unless otherwise approved by the contracting officer.

Any cuts, skins, scrapes, or bruises to the bark of the vegetation shall be carefully trimmed and local nursery accepted procedures used to seal damaged bark.

Any limbs or branches 0.5 inch or larger in diameter that are broken, severed, or otherwise seriously damaged during construction shall be cut off at the base of the damaged limb or branch flush with the adjacent limb or tree trunk.

All roots 1 inch or larger in diameter that are cut, broken, or otherwise severed during channel shaping shall have the end smoothly cut perpendicular to the root. Roots exposed during channel shaping operations shall be covered with moist soil as soon as possible to prevent roots from drying out.

3. Marking

The limits of the area(s) to be cleared and shaped are marked by stakes, flags, paint, tree markings, or other suitable methods or as specified in section 8 of this specification, or they will be shown on the drawings. Trees to remain standing, undisturbed, and uninjured are designated by special markings.

4. Clearing

Trees and other vegetation marked for clearing shall be cut off as near the ground surface as conventional tools and equipment normally permit. All trees not marked for preservation and all snags, logs, brush, shrubs, stumps, and rubbish shall be cleared from within the area limits identified.

5. Disposal

All woody material, vegetation, and rubbish resulting from clearing from designated areas shall be disposed of at the locations and in a manner shown on the drawings, or as specified in section 8 of this specification.

6. Shaping

The channel bottom and side slopes shall be shaped as shown on the drawings. The resulting shaped channel surface shall be reasonably smooth. Material excavated during the channel shaping operation shall be removed from the channel and disposed of as specified in section 8 of this specification.

7. Measurement and payment

Method 1—For items of work for which specific unit prices are established by the contract, the designated cleared and shaped area is measured and the area determined to the nearest 0.1 acre. Payment for clearing and shaping is made at the contract unit price for the item and shall constitute full compensation for all labor, equipment, tools, applicable permits and associated fees for burning and disposal of refuse, and all other items necessary and incidental to the satisfactory completion of the work.

Method 2—For items of work for which specific unit prices are established by the contract, the length of the cleared and shaped channel designated is measured to the nearest 100 feet. Payment for clearing and shaping is made at the contract unit price for the item and shall constitute full compensation for all labor, equipment, tools, applicable permits and associated fees for burning and disposal of refuse, and all other items necessary and incidental to the satisfactory performance of the work.

Method 3—For items of work for which specific unit prices are established by the contract, the cleared and shaped area(s) is measured and the area determined to the nearest 0.1 acre. The designated cleared and shaped area(s) is determined from the measured width at representative sections and the distance between the sections. Payment for clearing and shaping is made at the contract unit price for the item and shall constitute full compensation for all labor, equipment, tools, applicable permits and associated fees for burning and disposal of refuse, and all other items necessary and incidental to the satisfactory completion of the work.

Method 4—For items of work for which specific lump sum prices are established by the contract, the extent of clearing and shaping is not measured or determined for payment. Payment for clearing and shaping is made at the contract lump sum price for the item and shall constitute full compensation for all labor, equipment, tools, applicable permits and associated fees for burning and disposal of refuse, and all other items necessary and incidental to the satisfactory completion of the work.

All Methods—The following provisions apply to all methods of measurement and payment. Compensation for any item of work described in the contract, but not listed in the bid schedule is included in the payment for the item of work to which it is made subsidiary. Such items and items to which they have been made subsidiary are identified in section 8 of this specification.

8. Items of work and construction details

Instructions for use

Construction Specification 5—Pollution Control

1. Applicability

This specification is applicable to the control or reduction of pollution from all construction activities.

2. Material specifications

No material specifications complement this specification. Any material specifications required shall be specified in section 8 of this specification.

3. Included items

Items to be included in contract specifications and drawings follow:

- a. The area to be controlled should be defined, and the limits to be treated shall be shown on the drawings or described in the construction specifications, or both.
- b. If areas to be treated are not easily definable on the site map, such as some channel projects, the extent of treatment shall be fully described by notes or designated by stations or right-of-way limits.
- c. Restrictions or special requirements limiting the selection of best management practices for control or treatment should be specified.
- d. Special requirements designating the sequence of construction operations are included. These requirements might require temporary or prolonged shutdown of some or all construction operations.
- e. Alternate methods of control, if applicable.
- f. Any restrictions on amount of area disturbed before treatment is started.
- g. Any restriction on timing of installation, operation, or removal of any of the controls or treatments. Stabilization and structural practices, such as diversions, stream crossings, sediment basins, sediment filters, and waterways, are typically specified as temporary and to be removed. If any of these practices are to remain in place, specify in

section 8, along with any maintenance or changes required before final acceptance.

- h. Special pollution control requirements, such as sectional excavation or placement of materials, burying operations, waste area reclamation, blasting, clearing, dredging, or other unique construction procedure or operation.
- i. Water and chemicals for dust control is covered in section 5. Payment for water for dust control may be included as an item of work under this specification or Construction Specification 10, Water for Construction. The intent is to be covered in section 8 of this specification.
- j. Any other special requirements pertaining to this specification, including reference to applicable state and local laws and regulations.
- k. Storm Water Pollution Prevention Plan (SWPPP) requirements. Environmental Protection Agency or State requirements shall be followed as applicable.
- l. Method of measurement and payment.

4. Construction methods to be applied in contracts to control pollution

The following list does not include all possible erosion and pollution control methods. All personnel concerned with planning, design, and construction should study the site carefully and specify needed practices required to control erosion, sediment, and air pollution. Pollution control specifications are to be coordinated with the SWPPP requirements developed to meet the National Pollution Discharge Elimination System (NPDES) program.

Structures

1. Limit clearing and grubbing before actual need. Protect vegetation where possible.

2. Install terraces, diversions, or level spreaders, including stable outlets:
 - (a) Above and below borrow areas
 - (b) Above earth emergency spillways
 - (c) Above storage areas
3. Control access and haul roads:
 - (a) Contour roads and grade surfaces away from slopes and toward controlled outlets.
 - (b) Dust control with water and/or chemicals.
 - (c) Erosion control by installing turnouts and culverts and by stabilizing road ditches.
 - (d) Vegetate disturbed areas.
 - (e) Surface roughening or pitting.
4. Shape and control borrow areas. Reduce area and duration of exposed areas.
5. Install debris basins, brush dams, straw bale barriers, and geotextile fences.
6. Locate, shape, size, and protect by-pass channel:
 - Use coffer dams.
 - Pump extra water across construction area.
7. Sectional construction.
8. Timely installation of all structural and stabilization practices.
9. Control work sequence.
10. Complete as you go.
11. Winter or seasonal shutdowns to minimize pollution control problems.
12. Good housekeeping practices, to prevent water or air pollution, in use at the work site at all times.
13. Seeding for temporary or permanent protection. Provide topsoil as appropriate.
14. Prevent wildfires. Burn only per regulations.
15. Prevent pollution by chemicals and lubricants.
16. Mulch unprotected areas.

Channels

1. Preserve natural vegetation where possible. Remove blocks if possible.
2. Leave old channel to function as long as possible. Perform new channel excavation as an initial construction activity.
3. Where possible, do not open new channel to flows until vegetation is established. Sequence work.
4. Seed or sod slopes immediately after construction. Provide topsoil as necessary.
5. Mulch or mat slopes immediately after disturbance.
6. Spray mulch, seed, fertilizer, and asphalt or polyvinyl resin.
7. Begin excavation downstream and work upstream.
8. Use temporary grade control structures.
9. Limit clearing, clearing and grubbing, and snagging.
10. Limit disturbance of channel banks to one side. Delay and complete other side after the initial side is vegetated.
11. Channel construction should be performed in segments, completing each segment before starting the next.
12. Control storm water inlets into channel.
13. Install pipe inlets, grade control structures, and other such structures at the time of construction.
14. Install sediment traps in channel and provide for their cleanout and maintenance.

5. Methods

Section 7, Measurement and payment

Method 1—Provides measurement and payment by the unit of work performed. The use of water and chemical suppressants inappropriately and in excessive to need may be clarified in section 8.

Method 2—Provides for payment on the lump sum basis with progress payments determined from invoices provided by the contractor.

Method 3—Provides for payment on the lump sum basis with measurement on a prorated and equal basis for each monthly payment.

When specifications are prepared using electronic procedures and all methods but one are deleted for use in the contract specification, delete from the last paragraph, ***All Methods The following provisions apply to all methods of measurement and payment.*** Left justify the remaining text.

6. Items of work and construction details

Starting at the top of page 5-4, prepare and outline job specific "Items of Work and Construction Details" (IWCD) in accordance with these instructions. For ease of utilization, the use of recyclable color paper for the IWCD should be considered.

Construction Specification 5—Pollution Control

1. Scope

The work consists of installing measures or performing work to control erosion and minimize the production of sediment and other pollutants to water and air from construction activities.

2. Material

All material furnished shall meet the requirements of the material specifications listed in section 8 of this specification.

3. Erosion and sediment control measures and works

The measures and works shall include, but are not limited to, the following:

Staging of earthwork activities—The excavation and moving of soil materials shall be scheduled to minimize the size of areas disturbed and unprotected from erosion for the shortest reasonable time.

Seeding—Seeding to protect disturbed areas shall occur as soon as reasonably possible following completion of that earthwork activity.

Mulching—Mulching to provide temporary protection of the soil surface from erosion.

Diversions—Diversions to divert water from work areas and to collect water from work areas for treatment and safe disposition. They are temporary and shall be removed and the area restored to its near original condition when the diversions are no longer required or when permanent measures are installed.

Stream crossings—Culverts or bridges where equipment must cross streams. They are temporary and shall be removed and the area restored to its near original condition when the crossings are no longer required or when permanent measures are installed.

Sediment basins—Sediment basins collect, settle, and eliminate sediment from eroding areas from impacting properties and streams below the construction site(s). These basins are temporary and shall be removed and the area restored to its original condition when they are no longer required or when permanent measures are installed.

Sediment filters—Straw bale filters or geotextile sediment fences trap sediment from areas of limited runoff. Sediment filters shall be properly anchored to prevent erosion under or around them. These filters are temporary and shall be removed and the area restored to its original condition when they are no longer required or when permanent measures are installed.

Waterways—Waterways for the safe disposal of runoff from fields, diversions, and other structures or measures. These works are temporary and shall be removed and the area restored to its original condition when they are no longer required or when permanent measures are installed.

Other—Additional protection measures as specified in section 8 of this specification or required by Federal, State, or local government.

4. Chemical pollution

The contractor shall provide watertight tanks or barrels or construct a sump sealed with plastic sheets to dispose of chemical pollutants, such as drained lubricating or transmission fluids, grease, soaps, concrete mixer washwater, or asphalt, produced as a by-product of the construction activities. At the completion of

the construction work, sumps shall be removed and the area restored to its original condition as specified in section 8 of this specification. Sump removal shall be conducted without causing pollution.

Sanitary facilities, such as chemical toilets, or septic tanks shall not be located next to live streams, wells, or springs. They shall be located at a distance sufficient to prevent contamination of any water source. At the completion of construction activities, facilities shall be disposed of without causing pollution as specified in section 8 of this specification.

5. Air pollution

The burning of brush or slash and the disposal of other materials shall adhere to state and local regulations.

Fire prevention measures shall be taken to prevent the start or spreading of wildfires that may result from project activities. Firebreaks or guards shall be constructed and maintained at locations shown on the drawings.

All public access or haul roads used by the contractor during construction of the project shall be sprinkled or otherwise treated to fully suppress dust. All dust control methods shall ensure safe construction operations at all times. If chemical dust suppressants are applied, the material shall be a commercially available product specifically designed for dust suppression and the application shall follow manufacturer's requirements and recommendations. A copy of the product data sheet and manufacturer's recommended application procedures shall be provided to the engineer 5 working days before the first application.

6. Maintenance, removal, and restoration

All pollution control measures and temporary works shall be adequately maintained in a functional condition for the duration of the construction period. All temporary measures shall be removed and the site restored to near original condition.

7. Measurement and payment

Method 1—For items of work for which specific unit prices are established in the contract, each item is measured to the nearest unit applicable. Payment for each item is made at the contract unit price for that item. For water or chemical suppressant items used for dust control for which items of work are established in section 8 of this specification, measurement for payment will not include water or chemical suppressants that are used inappropriately or excessive to need. Such payment will constitute full compensation for the completion of the work.

Method 2—For items of work for which lump sum prices are established in the contract, payment is made as the work proceeds and supported by invoices presented by the contractor that reflect actual costs. If the total of all progress payments is less than the lump sum contract price for this item, the balance remaining for this item will be included in the final contract payment. Payment of the lump sum contract price will constitute full compensation for completion of the work.

Method 3—For items of work for which lump sum prices are established in the contract, payment will be prorated and provided in equal amounts on each monthly progress payment estimate. The number of months used for prorating shall be the number estimated to complete the work as outlined in the contractor's approved construction schedule. The final month's prorate amount will be provided with the final contract payment. Payment as described will constitute full compensation for completion of the work.

All Methods—The following provisions apply to all methods of measurement and payment. Compensation for any item of work described in the contract, but not listed in the bid schedule is included in the payment for the item of work to which it is made subsidiary. Such items, and the items to which they are made subsidiary, are identified in section 8 of this specification.

8. Items of work and construction details

Instructions for use Construction Specification 6—Seeding, Sprigging, and Mulching

1. Applicability

Construction Specification 6 is applicable to vegetating or mulching all designated areas requiring protective cover following completion of construction operations.

2. Material specifications

Material requirements are included in this specification.

3. Included items

Items to be included in contract specifications and drawings:

- a. Complete plans of the designated areas to be treated, including locations of disposal sites for oversize rocks and other debris.
- b. Name of plant or mixture to include scientific name, common name, and acceptable cultivars.
- c. Purity, germination, hard seed, and weed seed requirements for seed or mixture. Certified (e.g., Blue Tag) seed may be specified.
- d. Fertilizer, lime, and other soil amendment requirements, if applicable.
- e. Inoculant requirements, if needed.
- f. Types of mulch, straw, hay, or native hay and mulching methods, when required.
- g. Dates for seeding, sprigging, fertilizing, and mulching operations.
- h. Rates for seeding, sprigging, fertilizing, and mulching operations, expressed in pounds pure live seed (PLS) per acre.
- i. Method of application of seed, sprigs, fertilizer, and mulch.
- j. Method of anchoring mesh or netting.
- k. Supplemental irrigation to support vegetation establishment; frequency, volume per application, and duration of irrigation.

Overirrigation and soil saturation must be avoided for some soils.

4. Methods

Section 6, Measurement and payment

Method 1—Measurements used to determine the size of the area treated should specify horizontal or surface measured values in section 7. Constructed fill or cut slopes steeper than 3 feet horizontal to 1 foot vertical should consider surface measurements to calculate areas for payment purposes.

Methods 2 and 3—The procedures that will be used to determine the amount of work satisfactorily completed for progress payment should be identified in section 7. Options may include:

- An onsite agreed-to estimate of the percent of work satisfactorily complete at time of progress payment preparation.
- Require the contractor to provide invoices (method 3) to support his incurred costs to satisfactorily complete work at time of progress payment.
- Other suitable and fair methods, one of which could be related to the construction schedule.

When all methods but one are deleted for use in a contract specification, delete from the last paragraph **All Methods The following provisions apply to all methods of measurement and payment.** Left justify the remaining text.

5. Items of work and construction details

Starting at the top of page 6–4, prepare and outline job specific "Items of Work and Construction Details" (IWCD) in accordance with these instructions. For ease of utilization, the use of recyclable color paper for the IWCD should be considered.

Construction Specification 6—Seeding, Sprigging, and Mulching

1. Scope

The work consists of preparing the area for treatment; furnishing and placing seed, sprigs, mulch, fertilizer, inoculant, lime, and other soil amendments; and anchoring mulch in designated areas as specified.

2. Material

Seed—All seed shall conform to the current rules and regulations of the state where it is being used and shall be from the latest crop available. It shall meet or exceed the standard for purity and germination listed in section 7.

Seed shall be labeled in accordance with the state laws and the U.S. Department of Agriculture rules and regulations under the Federal Seed Act in effect on the date of invitations for bids. Bag tag figures are evidence of purity and germination. No seed will be accepted with a test date of more than 9 months before the delivery date to the site.

Seed that has become wet, moldy, or otherwise damaged in transit or storage will not be accepted. The percent of noxious weed seed allowable shall be as defined in the current State laws relating to agricultural seeds. Each type of seed shall be delivered in separate sealed containers and fully tagged unless exception is granted in writing by the contracting officer.

Fertilizer—Unless otherwise specified, the fertilizer shall be a commercial grade fertilizer. It shall meet the standard for grade and quality specified by State law. Where fertilizer is furnished from bulk storage, the contractor shall furnish a supplier's certification of analysis and weight. When required by the contract, a representative sample of the fertilizer shall be furnished to the contracting officer for chemical analysis.

Inoculants—The inoculant for treating legume seeds shall be a pure culture of nitrogen-fixing bacteria prepared specifically for the species and shall not be used later than the date indicated on the container or as otherwise specified. A mixing medium, as recommended by the manufacturer, shall be used to bond the inoculant to the seed. Two times the amount of the inoculant recommended by the manufacturer shall be used except four times the amount shall be used when seed is applied using a hydraulic seeder. Seed shall be sown within 24 hours of treatment and shall not remain in the hydraulic seeder longer than 4 hours.

Lime and other soil amendments—Lime shall consist of standard ground agriculture limestone, or approved equivalent. Standard ground agriculture limestone is defined as ground limestone meeting current requirements of the State Department of Agriculture. Other soil amendments shall meet quality criteria and application requirements specified in section 7.

Mulch tackifiers—Asphalt emulsion tackifiers shall conform to the requirements of ASTM D 977, Specification for Emulsified Asphalt. The emulsified asphalt may be rapid setting, medium setting, or slow setting. Nonasphaltic tackifiers required because of environmental considerations shall be as specified in section 7.

Straw mulch material—Straw mulch shall consist of wheat, barley, oat or rye straw, hay, grass cut from native grasses, or other plants as specified in section 7. The mulch material shall be air-dry, reasonably light in color, and shall not be musty, moldy, caked, or otherwise of low quality. The use of mulch that contains noxious weeds is not permitted. The contractor shall provide a method satisfactory to the contracting officer for determining weight of mulch furnished.

Other mulch materials—Mulching materials, such as wood cellulose fiber mulch, mulch tackifiers, synthetic fiber mulch, netting, and mesh, are other mulching materials that may be required for specialized locations and conditions. These materials, when specified, must be accompanied by the manufacturer's recommendations for methods of application.

3. Seeding mixtures, sod, sprigs, and dates of planting

The application rate per acre for seed mixtures, sprigs, or sod and date of seeding or planting shall be as shown on the plans or as specified in section 7.

4. Seedbed preparation and treatment

Areas to be treated shall be dressed to a smooth, firm surface. On sites where equipment can operate on slopes safely, the seedbed shall be adequately loosened (4 to 6 inches deep) and smoothed. Depending on soil and moisture conditions, disking or cultipacking, or both, may be necessary to properly prepare a seedbed. Where equipment cannot operate safely, the seedbed shall be prepared by hand methods by scarifying to provide a roughened soil surface so that broadcast seed will remain in place.

If seeding is to be accomplished immediately following construction operations, seedbed preparation may not be required except on a compacted, polished, or freshly cut soil surface.

Rocks larger than 6 inches in diameter, trash, weeds, and other debris that will interfere with seeding or maintenance operations shall be removed or disposed of as specified in section 7.

Seedbed preparation shall be discontinued when soil moisture conditions are not suitable for the preparation of a satisfactory seedbed as determined by the contracting officer's technical representative (COTR).

5. Seeding, sprigging, fertilizing, mulching, and stabilizing

All seeding or sprigging operations shall be performed in such a manner that the seed or sprigs are applied in the specified quantities uniformly in the designated areas. The method and rate of seed application shall be as specified in section 7. Unless otherwise specified, seeding or sprigging shall be accomplished within 2 days after final grading is completed and approved.

Fertilizer, lime, and other soil amendments shall be applied as specified in section 7. When specified, the fertilizer and soil amendments shall be thoroughly incorporated into the soil immediately following surface application.

The rate, amount, and kind of mulching or mesh shall be as specified in section 7. Mulches shall be applied uniformly to the designated areas. They shall be applied to areas seeded not later than 2 working days after seeding has been performed. Straw mulch material shall be stabilized within 24 hours of application using a mulch crimper or equivalent anchoring tool or by a suitable tackifier. When the mulch crimper or equivalent anchoring tool is used, it shall have straight blades and be the type manufactured expressly for and capable of firmly punching the mulch into the soil. Where the equipment can be safely operated, it shall be operated on the contour. Hand methods shall be used where equipment cannot safely operate to perform the work required.

The tackifier shall be applied uniformly over the mulch material at the specified rate, or it shall be injected into the mulch material as it is being applied. Mesh or netting stabilizing materials shall be applied smoothly, but loosely on the designated areas. The edges of these materials shall be buried or securely anchored using spikes or staples as specified in section 7.

The contractor shall maintain the mesh or netting areas until all work under the contract has been completed and accepted. Maintenance shall consist of the repair of areas damaged by water erosion, wind, fire, or other causes. Such areas shall be repaired to reestablish the intended condition and to the design lines and grades required by the contract. The areas shall be refertilized, reseeded, and remulched before the new application of the mesh or netting.

6. Measurement and payment

Method 1—For items of work for which specific unit prices are established in the contract, each area treated is measured as specified in section 7 and the area calculated to the nearest 0.1 acre. Payment for treatment is made at the contract unit price for the designated treatment, which will constitute full compensation for completion of the work.

When specified as an item of work, mesh or netting is measured to the nearest square yard of surface area covered and accepted. Payment is made at the contract unit price and will constitute full compensation for completion of the work.

Method 2—For items of work for which specific lump sum prices are established in the contract, the quantity of work will not be measured for payment. Payment for this item is made at the contract lump sum price for the item and will constitute full compensation for the completion of the work.

Method 3—For items of work for which lump sum prices are established in the contract, payment is made as the work proceeds. Progress payments will be determined as specified in section 7. Payment of the lump sum contract price will constitute full compensation for completion of the work.

All Methods—The following provisions apply to all methods of measurement and payment. Compensation for any item of work described in the contract, but not listed in the bid schedule is included in the payment for the item of work to which it is made subsidiary. Such items and the item(s) to which they are made subsidiary are identified in section 7.

7. Items of work and construction details

Instructions for use

Construction Specification 7—Construction Surveys

1. Applicability

Construction Specification 7 is applicable to construction contracts containing clauses requiring the contractor to provide construction surveys, layout, and measurement from government established baselines and bench marks; to provide quantity surveys, measurements, and computations for progress payment estimates; and when method 3, section 5, is authorized, provide original and final surveys for final quantity determinations.

2. Material specifications

No material specifications complement this specification. Any material requirements are to be specified in section 9.

3. Included items

Items to be included in contract specifications and drawings follow:

- a. Baselines, bench marks, and all other basic survey control information to be provided by the government are to be indicated on the drawings.
- b. Number of copies, format and timing of the submittal of survey data, notes, computations, and other such information is provided to the engineer by the contractor.
- c. Special requirements for advance notification of surveys to be performed by the contractor.
- d. Quality of any material, as applicable. Example may be the providing of permanent reference stakes.
- e. Qualifications of construction survey personnel, such as qualified construction personnel, certified or licensed land surveyors, or registered engineers. Provide a list outlining the minimum requirements expected.

- f. Special requirements for staking, such as offset reference stakes and hubs for excavations and fills.
- g. Requirements other than the standards of the industry, such as being consistent with NRCS procedures or higher levels of accuracy than those specified. Precision and accuracy are described in Engineering Field Handbook (EFH) chapter 1.
- h. Any special surveys to be performed by either the contractor or the government that are not listed in section 5.

4. Methods

Section 5, Construction surveys

Method 1—Used where the government provides basic staking that includes alignment, grade, and slope stakes. Other staking shall be performed by the contractor and is considered quality control construction staking and surveys for the determination of work accomplished for progress payment purposes.

Method 2—Used where the contractor performs all surveys required for the layout and control of construction work and all surveys necessary for progress payment quantities. This does not include original (initial) and final surveys for determining final quantities for payment purposes.

Method 3—This method is the same as method 2 except the contractor is required to perform the original (initial) and final surveys for use in determining final payment quantities. Note: The use of method 3 requires approval to use FAR Clause 52.236-16, Quantity Surveys, Alternate I. NRCS policy for field surveys is in National Engineering Manual (NEM) Section 540.04, Contractor Surveys; Section 540.05, Checking; and, Section

540.06, Responsibility. The project's Quality Assurance Plan should outline the checking requirements. The state conservation engineer has the authority to approve construction documents (drawings and specifications) that outline the survey responsibilities. Administrative authority to use method 3 rests with the contract specialist on the Regional Office staff.

Section 8, Payment

Method 1—Used when a related construction survey activity is significant and not expected to be uniform throughout the contract.

Method 2—Used when the extent of required construction survey is minor and could be expected to be fairly uniform throughout the duration of the contract.

When specifications are prepared using electronic procedures and all methods but one are deleted for use in a contract specification, delete from the last paragraph **All Methods The following provisions apply to all methods of measurement and payment.** Left justify the remaining text.

Note: Implementation of methods within this construction specification needs to be compatible with the Quality Assurance Plan prepared and approved for the project.

5. Items of work and construction details

Starting at the top of page 7-4, prepare and outline job specific "Items of Work and Construction Details" (IWCD) in accordance with these instructions. For ease of utilization, the use of recyclable color paper for the IWCD should be considered.

Construction Specification 7—Construction Surveys

1. Scope

The work consists of performing all surveys, measurements, and computations required by this specification.

2. Equipment and material

Equipment for construction surveys shall be of a quality and condition to provide the required accuracy. The equipment shall be maintained in good working order and in proper adjustment at all times. Records of repairs, calibration tests, accuracy checks, and adjustments shall be maintained and be available for inspection by the engineer. Equipment shall be checked, tested, and adjusted as necessary in conformance with manufacturer's recommendations.

Material is field notebooks, stakes, templates, platforms, equipment, spikes, steel pins, tools, and all other items necessary to perform the work specified.

3. Quality of work

All work shall follow recognized professional practice and the standards of the industry unless otherwise specified in section 9 of this specification. The work shall be performed to the accuracy and detail appropriate for the type of job. Notes, sketches, and other data shall be complete, recorded neatly, legible, reproducible and organized to facilitate ease in review and allow reproduction of copies for job documentation. Survey equipment that requires little or no manual recording of field data shall have survey information documented as outlined in section 9 of this specification.

All computations shall be mathematically correct and shall include information to identify the bid item, date, and who performed, checked, and approved the computations. Computations shall be legible, complete, and clearly document the source of all information used including assumptions and measurements collected.

If a computer program is used to perform the computations, the contractor shall provide the engineer with the software identification, vendor's name, version number, and other pertinent data before beginning survey activities. Computer generated computations shall show all input data including values assigned and assumptions made.

The elevations of permanent and temporary bench marks shall be determined and recorded to the nearest 0.01 foot. Differential leveling and transit traverses shall be of such precision that the error of vertical closure in feet shall not exceed plus or minus 0.1 times the square root of the traverse distance in miles. Linear measurements shall be accurate to within 1 foot in 5,000 feet, unless otherwise specified in section 9 of this specification. The angular error of closure for transit traverses shall not exceed 1 minute times the square root of the number of angles turned.

The minimum requirements for placing slope stakes shall be at 100-foot stations for tangents, as little as 25 feet for sharp curves, breaks in the original ground surface and at any other intermediate stations necessary to ensure accurate location for construction layout and measurement. Slope stakes and cross sections shall be perpendicular to the centerline. Significant breaks in grade shall be determined for cross sections. Distances shall be measured horizontally and recorded to the nearest 0.1 foot. Side shots for interim construction stakes may be taken with a hand level.

Unless otherwise specified in section 9 of this specification, measurements for stationing and establishing the location of structures shall be made to the nearest 0.1 foot.

Elevations for concrete work, pipes, and mechanical equipment shall be determined and recorded to the nearest 0.01 foot. Elevations for earth work shall be determined and recorded to the nearest 0.1 foot.

4. Primary control

The baselines and bench marks for primary control, necessary to establish lines and grades needed for construction, are shown on the drawings and have been located on the job site.

These baselines and bench marks shall be used as the origin of all surveys, layouts, and measurements to establish construction lines and grades. The contractor shall take all necessary precautions to prevent the loss or damage of primary control points. Any stakes or control points lost or damaged by construction activity will be reestablished by the contractor or at contractor expense.

5. Construction surveys

Before work starts that requires contractor performed surveys, the contractor shall submit in writing for the engineer's review: the name, qualifications, and experience of the individuals to be assigned to the survey tasks.

Method 1—Contractor performed surveys shall include:

- checking and any supplemental or interim staking
- performing quantity surveys, measurements, and computations for progress payment
- other surveys as described in section 9 of this specification

Method 2—Contractor performed surveys shall consist of all work necessary for:

- establishing line and grade for all work
- setting slope stakes for all work
- checking and any supplemental or interim staking
- establishing final grade stakes
- performing quantity surveys, measurements, and computations for progress payment
- other surveys as described in section 9 of this specification

Method 3—Contractor performed surveys shall consist of all work necessary for:

- establishing line and grade for all work
- setting slope stakes for all work
- checking and any supplemental or interim staking
- establishing final grade stakes
- performing quantity surveys, measurements, and computations for progress payments
- performing original (initial) and final surveys for determinations of final quantities
- other surveys as described in section 9 of this specification.

6. Staking

The construction staking required for the item shall be completed before work on any item starts. Construction staking shall be completed as follows or as otherwise specified in section 9 of this specification:

Clearing and grubbing—The boundary of the area(s) to be cleared and grubbed shall be staked or flagged at a maximum interval of 200 feet, closer if needed, to clearly mark the limits of work. When contractor staking is the basis for determining the area for final payment, all boundary stakes will be reviewed by the engineer before start of this work item.

Excavation and fill—Slope stakes shall be placed at the intersection of the specified slopes and ground line. Slope stakes and the reference stakes for slopes shall be marked with the stationing, required cut or fill, slope ratio, and horizontal distance from the centerline or other control line. The minimum requirements for placing slope stakes is outlined in section 3, Quality of work.

Structures—Centerline and offset reference line stakes for location, alignment, and elevation shall be placed for all structures.

7. Records

All survey data shall be recorded in fully identified standard hard-bound engineering survey field notebooks with consecutively numbered pages. All field notes and printed data shall include the purpose or description of the work, the date the work was performed, weather data, sketches, and the personnel who performed and checked the work. Electronically generated survey data and computations shall be bound, page numbered, and cross referenced in a bound field notebook containing the index for all survey activities. All work shall follow recognized professional practice.

The construction survey records shall be available at all times during the progress of the work for examination and use by the engineer and when requested, copies shall be made available. The original field notebooks and other records shall be provided to and become the property of the owner before final payment and acceptance of all work.

Complete documentation of computations and supporting data for progress payments shall be submitted to the engineer with each invoice for payment as specified in section 9 of the specification. When the contractor is required to conduct initial and final surveys as outlined in section 5, Construction Surveys, notes shall be provided as soon as possible after completion to the engineer for the purpose of determining final payment quantities.

8. Payment

Method 1—For items of work for which lump sum prices are established in the contract, payment is made as the work proceeds, after presentation of correct and accurate invoices by the contractor showing related costs and evidence of the charges of suppliers, subcontractors, and others for supplies furnished and work performed. Invoices for the total amount of the contract price will not be accepted until all surveys are complete and required documentation has been determined complete. If the total of such payments is less than the lump sum contract price for this item, the unpaid balance will be included in the final contract payment. Payment of the lump sum contract price will constitute full compensation for completion of all work under the bid item.

Method 2—For items of work for which lump sum prices are established in the contract, payment is made as the work proceeds with progress payment amounts determined as a percentage of the total work planned as projected from the contractor's approved construction schedule. Payment of the lump sum contract price will constitute full compensation for completion of all work under this bid item.

Payment will not be provided under this item for the purchase price of materials or equipment having a residual value.

Compensation for any item of work described in the contract, but not listed in the bid schedule will be included in the payment for the item of work to which it is made subsidiary. Such items and the item to which they are made subsidiary are identified in section 9 of this specification.

9. Items of work and construction details

Instructions for use Construction Specification 8—Mobilization and Demobilization

1. Applicability

Construction Specification 8 is applicable to any construction contract that includes a bid item for general mobilization and demobilization of the contractor's personnel and equipment. It is not intended to cover mobilization and demobilization of special equipment for specific items of work, such as grouting equipment, pile driving equipment, or rock drilling equipment, for which payment for mobilization and demobilization is included and provided by specific bid items elsewhere in the contract.

2. Material specification

No material specifications complement Construction Specification 8.

3. Included items

Items to be included in contract specifications and drawings follow:

- a. Special requirements pertaining to mobilization and demobilization, if any.
- b. Any particular work for which payment will or will not be made under the mobilization and demobilization item if not adequately described by the specification.
- c. When more sites than one (work limits not continuous) are included in the contract, include in section 4 of this specification if mobilization of contractor's equipment and personnel between sites is included or not included in Section 3, Payment.

4. Items of work and construction details

Starting at the top of page 8-2, prepare and outline job specific "Items of Work and Construction Details" (IWCD) in accordance with these instructions. For ease of utilization, the use of recyclable color paper for the IWCD should be considered.

Construction Specification 8—Mobilization and Demobilization

1. Scope

The work consists of the mobilization and demobilization of the contractor's forces and equipment necessary for performing the work required under the contract. It does not include mobilization and demobilization for specific items of work for which payment is provided elsewhere in the contract. Mobilization will not be considered as work in fulfilling the contract requirements for commencement of work.

2. Equipment and material

Mobilization shall include all activities and associated costs for transportation of contractor's personnel, equipment, and operating supplies to the site; establishment of offices, buildings, and other necessary general facilities for the contractor's operations at the site; premiums paid for performance and payment bonds including coinsurance and reinsurance agreements as applicable; and other items specified in section 4 of this specification.

Demobilization shall include all activities and costs for transportation of personnel, equipment, and supplies not required or included in the contract from the site; including the disassembly, removal, and site cleanup of offices, buildings, and other facilities assembled on the site specifically for this contract.

This work includes mobilization and demobilization required by the contract at the time of award. If additional mobilization and demobilization activities and costs are required during the performance of the contract as a result of changed, deleted, or added items of work for which the contractor is entitled to an adjustment in contract price, compensation for such costs will be included in the price adjustment for the item or items of work changed or added.

3. Payment

Payment will be made as the work proceeds, after presentation of paid invoices or documentation of direct costs by the contractor showing specific mobilization and demobilization costs and supporting evidence of the charges of suppliers, subcontractors, and others. When the total of such payments is less than the lump sum contract price, the balance remaining will be included in the final contract payment. Payment of the lump sum contract price for mobilization and demobilization will constitute full compensation for completion of the work.

Payment will not be made under this item for the purchase costs of materials having a residual value, the purchase costs of materials to be incorporated in the project, or the purchase costs of operating supplies.

4. Items of work and construction details

Instructions for use Construction Specification 9—Traffic Control

1. Applicability

This specification is applicable to providing facilities for control of traffic and providing public safety during construction.

2. Material specifications

No material specifications complement Construction Specification 9.

3. Included items

Items to be included in contract specifications and drawings follow:

- a. Any local constraints in traffic control, utilities, and access of local residents to their homes shall be stated.
- b. Provide information on any required permits and/or approvals.
 - (1) List any traffic control permits required and the issuing agency.
 - (2) List any fees or inspection costs that may be required as a result of obtaining a permit.
- c. Any special local activities that would generate above average vehicle use by the public. Outline the dates that this activity could occur so construction schedules would consider this potential conflict. Examples: State and county fairs, rodeos, sporting events, special local holiday, or seasonal activities.
- d. Name(s) and contact information for local authorities responsible for traffic control, maintenance, and public safety in the project area.

- e. The appropriate state or other acceptable technical reference(s) shall be identified. Also, provide for issuing agency's name, contact person, address, telephone number, and ordering information, as appropriate.

Examples:

Manual of Traffic Controls for Construction and Maintenance of Work Zones
(Reference)

State of California: Business, Transportation and Housing Agency, Department of Transportation

(Issued by)

(Contact person's name and title)

(805) 792-4729

(Telephone no.)

CDOT-39-2870

(Order no.)

- f. For measurement and payment, outline the procedures that will be used to determine the percent of work completed for progress payments if it differs from that outlined in section 6.

4. Items of work and construction details

Starting at the top of page 9–3, prepare and outline job specific "Items of Work and Construction Details" (IWCD) in accordance with these instructions. For ease of utilization, the use of recyclable color paper for the IWCD should be considered.

Construction Specification 9—Traffic Control

1. Scope

The work shall consist of establishing traffic control and maintaining safe, convenient use of public roads and rights-of-way.

2. Traffic and access

The contractor's operations shall cause no unnecessary inconvenience to the public. The public rights-of-way shall be maintained at all times unless interruption is authorized by proper local authority. Contractor's authorized closing or detour plans shall be provided to the engineer for approval.

Safe and adequate access shall be provided and maintained to all public protection devices and to all critical utility control locations. Facility access shall be continuous and unobstructed unless otherwise approved.

3. Storage of equipment and material in public streets

Construction materials and equipment shall not be stored or parked on public streets, roads, or highways. During any material or equipment loading or unloading activities that may temporarily interfere with traffic, an acceptable detour shall be provided for the duration of the activity. Any associated expense for this activity is the responsibility of the contractor.

Excavated material, including suitable material that is intended for adjacent trench backfill or other earth backfill as specified in section 5 of this specification, shall not be stored on public streets, roads, or highways that remain in service for the public. Any waiver of this requirement must be obtained from the proper local authority and approved by the engineer. All excess and unsuitable material shall be removed from the site as soon as possible. Any spillage shall be removed from roadways before they are used by the public.

4. Street closures, detours, and barricades

The contractor shall comply with the requirements of all applicable responsible units of government for closure of any street, road, or highway. The contractor shall provide the required barriers, guards, lights, signs, temporary bridges, and flaggers together with informing the public of any detours and construction hazards by the most suitable means available, such as local newspapers or radio stations. The contractor is also responsible for compliance with additional public safety requirements that may arise during construction. The contractor shall furnish, install, and, upon completion of the work, promptly remove all signs, warning devices, and other materials used in the performance of this work.

Unless otherwise specified, the contractor shall notify, in writing, the fire chief, police chief, county sheriff, state patrol, schools that operate school buses, or any other government official as may be appropriate no less than 7 days before closing, partly closing, or reopening any street, road, or highway.

Unless otherwise specified, the contractor shall furnish to the engineer a written plan showing the proposed method of signing, barricading for traffic control, and safety for street detours and closures.

All temporary detours will be maintained to ensure use of public rights-of-way is provided in a safe manner. This may include dust control, grading, and graveling as required in section 7 of this specification.

5. General and specific references

All signs, signals, barricades, use of flaggers, and other traffic control and public safety devices shall conform to the general requirements set forth in the Manual of Uniform Traffic Control Devices (MUTCD) and the latest edition of *Standard Highway Signs and Standard Alphabets for Highway Signs* and/or OSHA *Construction Industry Standards (29 CFR Part 1926), Subpart G, Signs, Signals, and Barricades* unless otherwise specified in section 7 of this specification.

6. Measurement and payment

For items of work for which specific lump sum prices are established in the contract, payment for the work is made at the contract lump sum price. Progress payments will be made based upon the percentage of estimated total time that traffic control will be required unless otherwise specified in section 7 of this specification. Payment will constitute full compensation for all flaggers, labor, materials, equipment, and all other items necessary and incidental to completion of the work.

Compensation for any item of work described in the contract, but not listed in the bid schedule will be included in the payment for the item of work to which it is made subsidiary. Such items and items to which they are made subsidiary are identified in section 7 of this specification.

7. Items of work and construction details

Instructions for use Construction Specification 10—Water for Construction

1. Applicability

Construction Specification 10 is applicable to all water required at the construction site except for water used for mixing or curing grout and concrete covered by Construction Specifications 14, 31, 32, 33, 35, 62, and 63. Construction Specification 10 is to be made a part of the contract when a pay item for water is provided. More than one pay item and method of payment may be used if the source of water is expected to be different, the volume of water required is uncertain, and the cost is expected to vary.

2. Material specifications

No material specifications complement Construction Specification 10.

3. Included items

Items to be included in the contract specifications and drawings follow:

- a. Pay item for water in units of 1,000 gallons with an estimated quantity provided.
- b. Designated source of water with details of ownership and water rights, if applicable.
- c. Cost to the contractor of water at the designated source, if applicable. Note: It may be advantageous for NRCS or sponsor to contract separately with the owner of the water and furnish it to the contractor free at the source. This should be considered only if the net cost to the NRCS or sponsors would be less than if included in the bid by the contractor.
- d. Special requirements pertaining to furnishing and using water, including water quality requirements if quality may be a problem for the purpose intended.

- e. Details on metering, accuracy, gauge certification, location of meter for payment purposes, or other requirements imposed by state and/or local agencies for measuring water use. Specify in section 8 of this specification where meters are located if water losses are a concern between the measured source and the point of delivery or application. A statement, such as meters shall be installed at the point of delivery into the water hauling equipment or application systems; such as, sprinkler systems or flooding systems, may be used.
- f. Details of the costs and expenses that will be included in the pay items if exceptions are to be made in the measurement and payment option selected from section 7.

4. Methods

Section 7, Measurement and payment

Method 1—Used when the cost of water is paid, but the remaining costs of transporting water, distributing it for construction purposes, and application are subsidiary to the items of work they are associated. Only costs of water at the meter are paid for under this method.

Method 2—Used when the cost of water and all other associated transportation, distribution, and application costs are included in the unit cost of water.

Method 3—Used when the water is provided to the contractor without cost and the remaining costs of transportation, distribution, and application are to be paid at the unit price for each 1,000 gallons applied.

When specifications are prepared using electronic procedures and all methods but one are deleted for use in the contract specification, delete from the last paragraph, ***All Methods The following provisions apply to all methods of measurement and payment.*** Left justify the remaining text.

5. Items of work and construction details

Starting at the top of page 10–3, prepare and outline job specific "Items of Work and Construction Details" (IWCD) in accordance with these instructions. For ease of utilization, the use of recyclable color paper for the IWCD should be considered.

Construction Specification 10—Water for Construction

1. Scope

The work consists of furnishing, transporting, measuring, and applying water as specified.

2. Facilities and equipment

The contractor shall install and maintain access and haul roads and furnish, operate, and maintain all pumps, meters, piping, tanks, storage, and other facilities required to load, transport, store, distribute, and use construction water as specified.

These facilities shall be equipped with accurate, work dedicated meters; tanks of known volume; or other devices that provide a correct measurement of water supplied. Meters shall be installed at the point of delivery into water hauling equipment or application system, such as sprinkler systems or flooding systems, as specified.

3. Dust abatement and haul road maintenance

Water for dust abatement and haul road maintenance shall be applied to haul roads and other dust producing areas as needed to prevent air pollution or excessive dust (which causes impaired vision on trafficked roads and in work areas) and to maintain the roads in good condition for safe and efficient operation during periods of use. Roads that may be jointly used with the public and by the contractor's equipment shall have dust abatement provisions acceptable to the public entity that has road maintenance responsibility. Compensation for water used for dust abatement and haul road maintenance shall be as specified in section 8 of this specification.

4. Earthfill, drainfill, and rockfill

Water required for proper installation of earthfill, drainfill, and/or rockfill shall be used in the fill materials as specified in the applicable construction specification(s). Compensation for construction water used for earthfill, drainfill, and/or rockfill shall be as specified in section 8 of this specification.

5. Concrete, mortar, and grout

Water required in the mixing or curing of concrete, shotcrete, roller compacted concrete, or other portland cement mortar or grout shall meet the requirements of the applicable construction specifications and shall be used in conformance with those specifications. Payment for construction water used in these items is covered by the applicable concrete, mortar, or grout specification, or a combination of these.

6. Other construction requiring water

Water required and used for other construction activities under this contract, but not specifically covered by this specification shall be considered subsidiary to the item(s) of work that requires its use.

7. Measurement and payment

Method 1—For water items for which specific unit prices are established in the contract, the volume of water furnished and used in accordance with the specifications will be measured to the nearest 1,000 gallons.

Payment for water is made at the contract unit price. Such payment will constitute full compensation for the direct costs of water. All other costs necessary for applying water are subsidiary to the items of work they are associated.

Method 2—For water items for which specific unit prices are established in the contract, the volume of water furnished and used in accordance with the specifications will be measured to the nearest 1,000 gallons.

Payment for water and the cost associated with transportation, distribution, and application is made at the contract unit price. Such payment will constitute full compensation for completion of the work.

Method 3—For water items for which specific unit prices are established in the contract, the volume of water used in accordance with the specifications will be measured to the nearest 1,000 gallons.

Payment for water is made at the contract unit price. Such payment, excluding water cost, will constitute full compensation for completion of the work.

All methods—The following provisions apply to all methods of measurement and payment:

- The measurement for payment will include all water used except as noted in sections 5, 6, and 8 of this specification. Measurement for payment will not include water that is used inappropriately or in excessive to need.
- Compensation for any item of work described in the contract, but not listed in the bid schedule is included in the payment for the item of work to which it is made subsidiary. Such items and the items to which they are made subsidiary are identified in section 8 of this specification.

8. Items of work and construction details

Instructions for use

Construction Specification 11—Removal of Water

1. Applicability

Construction Specification 11 is applicable to the temporary diversion of surface water and dewatering of the borrow and construction areas during the construction period.

2. Material specifications

No material specifications complement Construction Specification 11.

3. Included items

Items to be included in contract specifications and drawings follow:

- a. Special requirements or restrictions for the diversion system and/or method of diverting surface water.
- b. Special requirements for dewatering the construction site that may affect quality of work and/or construction safety (such as lowering water table before performing excavations and maintaining a maximum water level during construction operations).
- c. Special requirements for dewatering borrow areas, such as removal of surface water and subsurface drainage to contribute to proper soil moisture conditions during borrow excavation operations. A contract bid item should be included if water problems may be expected in the borrow area and additional work, such as installation and operation of a pumping system, could be expected.
- d. Information on alternate borrow sources that may not require dewatering.
- e. Special requirements for the control of erosion and water pollution. Requirements included in this specification should be directly associated with dewatering and be compatible with Construction Specification 5, Pollution Control, if also used as a contract bid item.

- f. Waiver of the requirement that the contractor furnish a site specific plan outlining procedures to divert surface water and dewatering the construction site, if a plan in writing is not necessary.
- g. Depending on the magnitude and complexity expected, diverting surface water and dewatering may require separate bid items.
- h. Provisions for payment, if payment is to be made on a unit price basis for pumping to dewater borrow areas and construction sites as follows:
 - (1) Contract bid item for pumping to dewater borrow areas or construction sites.
 - (2) At least one lump sum contract bid item that will include compensation for the work and cost of preparation for pumping.

4. Methods

Section 7, Measurement and payment

Method 1—Intended for use when removal of water is to be covered by one or more lump sum contract bid items. The procedures to be used to determine progress payments should be outlined in section 8.

Method 2—Intended for use when pumping to dewater borrow areas is to be measured and paid for as a unit price bid item of work.

When all methods but one are deleted for use in a contract specification, delete from the last paragraph **All Methods The following provisions apply to all methods of measurement and payment.** Left justify the remaining text.

5. Items of work and construction details

Starting at the top of page 11-3, prepare and outline job specific "Items of Work and Construction Details" (IWCD) in accordance with these instructions. For ease of utilization, the use of recyclable color paper for the IWCD should be considered.

Construction Specification 11—Removal of Water

1. Scope

The work consists of the removal of surface water and ground water as necessary to perform the construction required by the contract in accordance with the specifications. It shall include: (1) constructing, installing, building, and maintaining all necessary temporary water containment facilities, channels, and diversions; (2) furnishing, installing, and operating all necessary pumps, piping, and other facilities and equipment; and (3) removing all such temporary works and equipment after their intended function is no longer required.

2. Diverting surface water

The contractor shall install, maintain, and operate all cofferdams, channels, flumes, sumps, and all other temporary diversion and protective works needed to divert streamflow and other surface water through or around the construction site. Control of surface water shall be continuous during the period that damage to construction work could occur. Unless otherwise specified and/or approved, the diversion outlet shall be into the same drainageway that the water would have reached before being diverted.

The contractor shall furnish the contracting officer, in writing, a proposed plan for diverting surface water before beginning any construction activities for which a diversion is required, unless waived in section 8 of this specification. Acceptance of this plan or the waiving of the plan requirement will not relieve the contractor of the responsibilities related to this activity during the process of completing the work as specified.

3. Dewatering the construction site

Foundations, cutoff trenches, and all other parts of the construction site shall be dewatered and kept free of standing water and muddy conditions as necessary for the proper execution of the work. The contractor shall furnish, install, operate, and maintain all drains, sumps, pumps, casings, well points, and all other equipment required to properly dewater the site as specified. Dewatering systems that cause a loss of soil fines from the foundation areas will not be permitted.

The contractor shall furnish the contracting officer, in writing, a proposed plan for dewatering before commencing with any construction activity for which dewatering may be required, unless waived in section 8 of this specification. Acceptance of this plan or the waiving of the plan requirement will not relieve the contractor of the responsibilities for completing the specified work.

4. Dewatering borrow areas

The contractor shall maintain all borrow areas free of surface water or otherwise provide for timely and effective removal of surface and subsurface water that accumulates within the borrow area, unless waived in section 8 of this specification. Borrow material shall be processed as necessary to achieve proper and uniform moisture content at the time of placement.

If pumping to dewater borrow areas is included as a bid item of work in the bid schedule, each pump discharge pipe shall be equipped with a water meter. The meter shall be such that the measured quantity of water is accurate within 3 percent of the true quantity. The contractor shall provide necessary support to perform accuracy tests of the water meter when requested by the contracting officer.

5. Erosion and pollution control

Removal of water from the construction site, including the borrow areas, shall be accomplished so that erosion and the transporting of sediment and other pollutants are minimized. Dewatering activities shall be accomplished in a manner that the water table water quality is not altered. Pollution control activities

shall not conflict with the requirements of Construction Specification 5, Pollution Control, if it is a part of this contract.

6. Removal of temporary works

When temporary works are no longer needed, the contractor shall remove and return the area to a condition similar to that which existed before construction. Areas where temporary works were located shall be graded for sightly appearance with no obstruction to natural surface waterflows or the proper functioning and access to the works of improvement installed. The contractor shall exercise extreme care during the removal stages to minimize the loss of soil sediment and debris that was trapped during construction.

Pipes, casings, and any other material used to dewater the site shall be removed from temporary wells. The wells shall be filled to ground level with clean gravel or other suitable material approved by the contracting officer. The contractor shall exercise extreme care to prevent pollution of the ground water by these actions.

7. Measurement and payment

Method 1—Items of work listed in the bid schedule for removal of water, diverting surface water, and dewatering construction sites and borrow areas are paid for at the contract lump sum prices. Such payment will constitute full compensation for all labor, equipment, tools, and all other items necessary and incidental to the completion of the work.

Method 2—Items of work listed in the bid schedule for removal of water, diverting surface water, dewatering construction sites, and dewatering borrow areas are paid for at the contract lump sum prices. Such payment will constitute full compensation for furnishing, installing, operating, and maintaining the necessary trenches, drains, sumps, pumps, and piping and for all labor, equipment, tools, and all other items necessary and incidental to the completion of the work. The exception is that additional payment for pumping to dewater borrow areas and the removal of water will be made as described in the following paragraph.

If pumping to dewater borrow areas is a contract bid item, payment is made at the contract unit price, which shall be the price per 1,000 gallons shown in the bid schedule. Such payment will constitute full compensation for pumping only. Compensation for equipment and preparation and for other costs associated with pumping is included in the lump sum payment for removal of water or the lump sum payment for dewatering the borrow areas. Payment is made only for pumping that is necessary to dewater borrow areas that cannot be effectively drained by gravity or that must have the water table lowered to be usable as a suitable borrow source. Pumping for other purposes will not be included for payment under this item.

All Methods—The following provisions apply to all methods of measurement and payment. Compensation for any item of work described in the contract, but not listed in the bid schedule is included in the payment for the contract line item to which it is made subsidiary. Such items and the items to which they are made subsidiary are identified in section 8 of this specification.

8. Items of work and construction details

Instructions for use Construction Specification 12—Relief Wells

1. Applicability

Construction Specification 12 is applicable to the construction of pressure relief wells in foundations of structures.

2. Material specification

Material Specification 521, Aggregates for Drainfill and Filters, and 554, Steel Pipe, complement Construction Specification 12.

3. Included items

Items to be included in contract specifications and drawings follow:

- a. Plan location of each well.
- b. Profile along the line of wells showing the spacing and estimated depths of the wells.
- c. Sectional elevation of typical wells showing:
 - (1) Location of the well screens, if required
 - (2) Diameter and vertical extent of the filter
 - (3) Details of the outlet at the upper end of the filter
 - (4) Details of couplings and special fittings and appurtenances, such as tees, check valves, caps, and appurtenant housings
- d. Special limits on time of installation. For example, relief wells must be installed before any structural load is placed on the foundation or before a specific phase of construction.
- e. The type and size of pipe.
- f. The type and size of well screens including the size and pattern of screen openings or slots.
- g. The grading requirements of the filter material.
- h. Section 7, note in section 13 when well development is required.

- i. Acceptable methods of plugging abandoned wells in section 13. Requirements placed on the contractor must be in conformance with State and local regulations for this activity.

4. Methods

Two methods are included in Section 11, Measurement, and three methods in Section 12, Payment. These methods are self-explanatory, but it must be noted that methods 1 and 2 of section 11 are, respectively, complementary to methods 1 and 2 of section 12.

When specifications are prepared using electronic procedures and all methods but one are deleted for use in the contract specification, delete from the last paragraph, ***All Methods The following provisions apply to all methods of measurement and payment.*** Left justify the remaining text.

5. Items of work and construction details

Starting at the top of page 12-5, prepare and outline job specific "Items of Work and Construction Details" (IWCD) in accordance with these instructions. For ease of utilization, the use of recyclable color paper for the IWCD should be considered.

Construction Specification 12—Relief Wells

1. Scope

The work consists of installing and developing pressure relief wells in foundations of earth structures.

2. Material

The well screen shall be of the specified type and size, and the size and pattern of the screen openings shall conform to the details shown on the drawings. Each screen shall be equipped with a bottom plug of the same material as the screen.

The riser pipe and fittings shall conform to the requirements of Material Specifications 547, 551, and 554 for the type of pipe specified in section 13 of this specification. Filter material shall conform to the requirements of Material Specification 521 and shall be graded as specified in section 13 of this specification.

3. Location and depth of wells

The plan location and depth of each well shown on the drawings are based on design estimates. The final depth and location of the components of each well will be determined by the engineer on the basis of the examination of the well log and samples recovered during drilling. The location of a well will be changed by the engineer where obstructions encountered during drilling require abandonment of the proposed well location.

4. Drilling

Unless otherwise specified, the wells shall be drilled vertically by a rotary drilling procedure. The diameter of each well shall be adequate to permit the placement of the specified thickness of filter material. As determined by the engineer, drilling methods that may reduce the yield of the well will not be permitted. The well shall be cased with a temporary casing of a type that:

- a. Has sufficient thickness to retain its shape and maintain the true section throughout its total depth, and
- b. Is removable in a manner that does not disturb the filter, well screen, or riser pipe.

5. Installing riser pipe and screen

The riser, consisting of the riser pipe, well screens, couplings, and fittings, shall be measured and inspected as it is assembled and placed in the well. Spiders or other centering devices shall be attached to the assembled riser in sufficient numbers to center it within the well and to accurately maintain its position during the placement of the filter material.

Before the riser is placed, filter materials shall be placed at the bottom of the well to the elevation specified by the engineer for the bottom of the well screen. The riser shall be placed in the well in such a manner as to avoid shock and to prevent damage to any of its components. The relief outlet or top of the riser shall be securely maintained at the designated elevation during the placement of the filter material.

6. Placing filter/drainfill

The filter material shall be placed by tremie, or by another method approved by the engineer, to an elevation not less than 1 foot above the top of the highest well screen. At the initial placement operations, the tremie shall rest on the bottom of the well and be filled with filter material. The tremie and the temporary casing shall be raised in increments of not more than 2 feet, allowing the filter material to flow from the bottom of the tremie. The top surface of the filter material in the tremie shall be maintained above the water surface at all times. The top surface of the filter material in the well shall be maintained a minimum of 2 feet above the bottom of the casing as the casing is raised.

7. Developing

Following filter material placement and when specified in section 13 of this specification, the well shall be developed by an approved method. The contractor shall submit a plan for accomplishing the work to the engineer for review before development of the well.

All materials pulled into the screen during development shall be removed. Filter material shall be added to the annular space around the screen as needed to maintain the top of the filter at the specified elevation.

Any well that continues to produce appreciable amounts of fines for 4 hours after development will be abandoned and relocated unless otherwise continued by the engineer.

8. Backfilling

After the well has been developed, the annular space around the riser pipe above the filter material shall be filled with selected moist impervious earthfill or portland cement concrete. Backfill shall be placed in layers not to exceed 12 inches in thickness, and each layer shall be tamped firmly into place. The temporary casing shall be withdrawn in increments as the backfill is placed.

9. Abandoned wells

All abandoned wells shall be plugged as specified in section 13 of this specification. When a well is abandoned after development, the well screen and riser pipe shall be salvaged, if possible.

10. Logging and sampling

The contractor shall conduct drilling operations in a manner that allows the engineer to take representative disturbed soil samples of all materials encountered.

11. Measurement

Method 1—The amount of well drilling is measured to the nearest foot of well drilled and cased. Wells abandoned for causes other than the fault of the contractor will be included in the measurement for payment.

The volume of filter material and backfill material is computed to the nearest 0.1 cubic yard from measurements of the vertical well space occupied by each and the outside diameters of the casing and riser. Filter material and backfill material for wells abandoned for causes not attributed to actions of the contractor will be included in the measurement for payment.

The amounts of pipe and well screen installed in the riser and outlet assembly are measured to the nearest linear foot at the time the riser is assembled. Pipe and well screen that cannot be salvaged from wells abandoned for causes not attributed to actions of the contractor will be included in the measurement for payment.

The couplings and special fittings and appurtenances are counted at the time the riser is assembled. Couplings and special fittings and appurtenances that cannot be salvaged from wells abandoned for causes not attributed to actions of the contractor will be included in the measurement for payment.

The time required to develop each well is measured to the nearest half hour. Time required to develop wells abandoned for causes not attributed to actions of the contractor will be included in the measurement for payment.

Method 2—The amount of well drilling is measured to the nearest foot of well drilled and cased. Wells abandoned for causes not attributed to actions of the contractor will be included in the measurement for payment.

The volume of each grading of filter material placed is computed to the nearest 0.1 cubic yard from measurements of the vertical well space occupied by each and the diameters of the casing and riser. Filter in wells abandoned for causes not attributed to actions of the contractor will be included in the measurement for payment.

The amounts of pipe, couplings, fittings, appurtenances, and well screen installed in the riser and outlet assembly are measured to the nearest linear foot at the time the riser is assembled. Pipe, couplings, fittings, appurtenances, and well screen that cannot be salvaged from wells abandoned for causes not attributed to actions of the contractor will be included in the measurement for payment.

The time required to develop each well is measured to the nearest half hour. Time required to develop wells abandoned for causes not attributed to actions of the contractor will be included in the measurement for payment.

Backfill is not measured.

12. Payment

Method 1—Payment for each item of work will constitute full compensation for all labor, equipment, materials, and all other items necessary and incidental to the completion of the work included in the item.

Payment for drilling and casing each size of well is made at the contract unit price for that size of well and will include compensation for drilling, casing, and pulling casing.

Payment for furnishing and placing filter material is made at the contract unit price for that grading of filter material.

Payment for furnishing, placing, and compacting backfill is made at the contract unit price.

Payment for furnishing and installing each type and size of pipe is made at the contract unit price for that type and size of pipe.

Payment for furnishing and installing each type and size of well screen is made at the contract unit price for that type and size of well screen.

Payment for furnishing and installing each coupling is made at the contract unit price for that type and size of coupling.

Payment for each special fitting or appurtenance is made at the contract unit price for that type and size of fitting or appurtenance.

Payment for developing each well is made at the contract unit price for developing that size of well.

Method 2—Payment for each item of work will constitute full compensation for all labor, equipment, materials and all other items necessary and incidental to the completion of the work included in the item.

Payment for drilling, casing, and backfilling each size of well is made at the contract unit price for that size of well and includes compensation for drilling, casing, pulling casing, and backfilling.

Payment for furnishing and placing filter material is made at the contract unit price for that grading of filter material.

Payment for furnishing and installing each type and size of pipe complete with all couplings, fittings, and appurtenances (except well screens) is made at the contract unit price for that type and size of pipe.

Payment for furnishing and installing each type and size of well screen is made at the contract unit price for that type and size of well screen.

Payment for developing each well is made at the contract unit price for developing that size of well.

Method 3—Measurement is not made. Items of work listed in the bid schedule for installing, operating, and removal of relief wells will be paid for at the contract lump sum prices. Such payment will constitute full compensation for all labor, equipment, tools, and all other items necessary and incidental to the completion of the work.

All methods—The following provisions apply to all methods of measurement and payment. Compensation for any item of work described in the contract, but not listed in the bid schedule is included in the payment for the item of work to which it is made subsidiary. Such items and the items to which they are made subsidiary are identified in section 13 of this specification.

13. Items of work and construction details

Instructions for use Construction Specification 13—Piling

1. Applicability

Construction Specification 13 is applicable to the furnishing and installation of timber piles, steel piles, steel sheet piles, precast concrete piles, and shells for cast-in-place piles. It is not applicable to the installation of drilled, cast-in-place piles.

2. Material specifications

The following material specifications complement Construction Specification 13:

511—Steel Piles

512—Wood Piles

513—Precast Concrete Piles

514—Cast-in-Place Concrete Piles

Include Construction Specification 31, Concrete for Major Structures, or 32, Structure Concrete, as appropriate, when not included in the contract for other concrete installation.

3. Included items

Items to be included in construction specifications and drawings follow:

- a. Plan showing the location of all piles, including test piles, if any.
- b. Foundation profiles and sections showing:
 - (1) Log of borings, including penetration test results
 - (2) Required or estimated pile penetration
 - (3) Cutoff elevations
- c. Required bearing capacities. (Note: Specify (1) required bearing capacity or (2) required penetration or (3) required bearing capacity and minimum penetration, as appropriate.)
- d. For timber piles, state the type, class, species and length of piles required. For Type I piles, state where the piles will be inspected. For Type II piles, state the type of treatment and minimum retention of preservative per cubic foot of pile.

- e. Details of precast or cast-in-place concrete piles including dimensions, reinforcement details, class of concrete, size of aggregate, and type of cement and slump required.
- f. Nominal size and weight of section for H-bearing piles.
- g. Authorization to use gravity drop hammers, if appropriate.
- h. Details of load tests that will be required, if appropriate.
- i. Methods of measurement and payment if the standard specification includes more than one method.

4. Methods

Section 12, Measurement and payment

Methods 1 and 2—Intended for use when a considerable number of piles of about the same length are required. Method 1 provides for a single pay item for furnishing and driving piles. Method 2 provides for separate pay items for furnishing piles and driving piles.

Method 3—Used when the lengths of piles required are quite variable. It is particularly suitable where the cutoff portions of the piles may be salvaged and used on the job, such as when steel bearing piles are specified.

Method 4—Used for sheet pile walls when the required depth of penetration is known.

When specifications are prepared using electronic procedures and all methods but one are deleted for use in the contract specification, delete from the last paragraph, **All Methods The following provisions apply to all methods of measurement and payment.** Left justify the remaining text.

5. Items of work and construction details

Starting at the top of page 13-6, prepare and outline job specific "Items of Work and Construction Details" (IWCD) in accordance with these instructions. For ease of utilization, the use of recyclable color paper for the IWCD should be considered.

Construction Specification 13—Piling

1. Scope

The work consists of furnishing and installing the specified kinds and types of piles at the locations shown on the drawings.

2. Material

Piles shall conform to the requirements of following material specifications as appropriate to the kinds of piles specified. For piles of materials other than those listed, the material requirements outlined in section 14 of this specification shall apply.

511—Steel Piles

512—Wood Piles

513—Precast Concrete Piles

514—Cast-in-Place Concrete Piles

3. Site preparation

All excavation within the area to be occupied by bearing piles shall be completed before the piles are driven.

4. Protection of pile heads

The heads of all piles shall be protected during driving by suitable caps, rings, heads, blocks, mandrels, and other devices.

The heads of timber piles shall be fitted into a steel head block or fitted with heavy steel or wrought iron rings or wire wrapping.

The heads of steel piles shall be cut square and fitted with a steel driving cap.

The heads of precast concrete piles and casings shall be fitted into cushion type drive caps having a rope or other suitable cushion next to the pile head and fitting into a casting that in turn supports a timber shock block.

Driving heads, mandrels, and other devices shall be provided by the contractor as needed for special types of piles and shall conform to the recommendations of the pile manufacturer.

5. Piles, general

The contractor shall notify the engineer before pile driving operation commences. Such notice shall be far enough in advance, a minimum of 24 hours, to provide the engineer adequate time to be present for the driving operations. Piles shall be driven only in the presence of the engineer or authorized representative.

The determination of piling order lengths shall be the contractor's responsibility unless otherwise specified.

Unless otherwise approved, piles shall be driven with steam, air, diesel powered hammers or a combination of hammers, or by vibration or water jets. Water jets may be used only when specifically authorized by the engineer. Where jetting is authorized, the jets shall be withdrawn before the specified depth or bearing capacity is obtained and the piles shall be driven with the hammer to the final penetration.

When drop hammers are permitted, the height of drop shall not be more than 8 feet for concrete piles or 12 feet for steel and timber piles, unless otherwise specified.

The driving of piling with followers shall be allowed only when expressly approved by the engineer.

Piles shall not be driven within 20 feet of concrete less than 7 days after placement, including concrete placed in cast-in-place piles with or without predriven shells or casings.

The contractor shall not attempt to drive piles beyond the point of refusal, as indicated by excessive bouncing of the hammer or kicking of the pile.

6. Bearing piles

Bearing piles shall be driven to the position, line, and batter specified on the drawings. Each pile shall be driven continuously and without interruption to the specified depth or until the specified bearing capacity is obtained. Deviation from this procedure is permitted only when interruption of driving is caused by conditions that could not reasonably be anticipated.

When a diesel hammer is used, it shall be operated at full throttle when blows are counted for determination of bearing capacity except that throttle adjustments shall be made as necessary to prevent the nonstriking parts of the hammer from rising from the pile on the ram upstroke.

7. Sheet piles

The piling shall be driven in a manner that ensures perfect interlocking throughout the entire length of each pile. The piles shall be held in proper alignment during driving by assembling frames or other suitable temporary guide structures. Temporary guide structures shall be removed when they have served their purpose.

Anytime the forward edge of the sheet pile wall is found to be out of correct alignment,

- a. The piling already assembled and partly driven shall be driven to the required depth.
- b. Taper piles shall then be driven to bring the forward edge into correct alignment before additional regular piling is assembled and driven. The maximum permissible taper in a single pile shall be 0.25 inch per foot of length.

8. Estimating bearing capacity

When load tests are not required, the bearing capacity of each pile shall be estimated using one of the following formulas, as appropriate:

Gravity hammers:

$$R = \frac{2WH}{S+1}$$

Single-acting steam or air hammers and diesel hammers having unrestricted rebound of the ram:

$$R = \frac{2WH}{S+0.1}$$

Double-acting steam or air hammers and diesel hammers having enclosed rams:

$$R = \frac{2H(W + AP)}{S + 0.1} \quad \text{or} \quad R = \frac{2E}{S + 0.1}$$

where:

R = safe bearing capacity, in pounds

W = weight of striking parts of hammer, in pounds

- H = height of fall, in feet
A = area of piston, in square inches
P = pressure of steam, air, or other gas exerted on the hammer piston or ram, in pounds per square inch
E = the manufacturer's rating for foot-pounds of energy developed by double-acting steam or air hammers, or 90 percent of the average equivalent energy developed by diesel hammers having enclosed rams as evaluated by gauge and chart readings, in foot-pounds
S = average penetration for the last 5 to 10 blows of a gravity hammer or the last 10 to 20 blows for steam, air, or diesel powered hammers, in inches per blow

These formulas are applicable when:

- The hammer has a free fall.
- The head of the pile is not crushed.
- The penetration is reasonably quick and uniform.
- There is no sensible bounce after the blow.
- A follower is not used.

Twice the height of the bounce shall be deducted from **H** to determine its value in the formula.

If case water jets are used in conjunction with the driving, these formulas are used to determine the bearing power from the results of driving after the jets have been removed.

9. Load tests

When load tests are specified, the test loads shall be applied gradually, without impact, and in a manner that no lateral forces are applied to the pile. Load testing shall not be started until 24 hours after driving of the test pile is completed unless otherwise specified in section 14 of this specification. Except as otherwise specified, load tests shall be performed according to the following procedures.

The total test load shall be twice the specified working load and shall be applied to the pile in increments equal to 25 percent of the working load. Settlement of the top of the pile shall be measured to an accuracy of 0.01 inch before and after the application of each load increment and at 2, 4, 8, 15, 30, and 60 minutes after, and then every 2 hours until the next load increment is applied. Additional load shall not be applied until the rate of settlement is less than 0.01 inch in 1 hour.

The total test load shall remain on the pile for a minimum of 24 hours. Settlement shall be measured at 6-hour intervals during this period and at the end of the period, at least twice during removal of the load, and immediately after all of the test load is removed. The net settlement shall be measured about 24 hours after the total load has been removed.

If settlement continues in excess of 0.01 inch per hour under less than the total test load, no additional load shall be applied. However, the load that has been applied shall remain on the pile a minimum of 24 hours, and settlement measurements while the load is on the pile and during and after removal of the load shall be made as if it were the total test load.

10. Cutting off piles

The contractor shall cut the piles at the specified elevations. The length of pile cut off shall be sufficient to permit the removal of all damaged material. Steel shells or concrete casings for cast-in-place concrete piles shall be cut off at the specified elevation before being filled with concrete.

Steel bearing piles shall be cut off in clean, straight lines as shown on the drawings. Any irregularities shall be leveled off with deposits of weld metal or by grinding before placement of bearing caps.

Precast concrete piles and concrete casings shall be cut off in a manner that prevents damage to the rest of the pile or casing or to the projecting reinforcement required for connecting the piles to the structure.

Timber piles that are to be capped shall be accurately cut off so that true bearing is obtained on every pile without the use of shims.

11. Defective piles

Any pile damaged in driving, driven out of proper location, driven below the specified cutoff elevation, or inaccurately cut off shall be corrected by one of the following methods, as approved by the engineer:

- a. The defective pile shall be pulled and replaced or re-driven.
- b. A new pile shall be driven adjacent to the defective pile.
- c. The defective pile shall be spliced or built up or a sufficient part of the footing shall be extended to properly embed the pile.

Pile shells abandoned in place after driving shall be filled with concrete or sand-cement grout as appropriate to the conditions that are present.

All piles pushed up by the driving of adjacent piles or by any other cause shall be re-driven to final grade.

Any sheet pile ruptured in the interlock or otherwise damaged during driving shall be pulled and replaced.

12. Correcting surface heave

Any excess material resulting from displacement of earth by pile driving shall be removed. Materials disturbed by pile driving shall be conditioned and compacted to a minimum density equal to adjacent undisturbed material.

13. Measurement and payment

Method 1—For items of work for which specific unit prices are established in the contract, each type, kind, and length of pile driven in place is counted. Payment for furnishing and driving each type, kind, and length of pile is made at the contract unit price. Such payment will constitute full compensation for all labor, equipment, materials, and all other items necessary and incidental to the completion of the work.

Method 2—For items of work for which specific unit prices are established in the contract, each type, kind, and length of pile furnished, accepted, and stockpiled in good condition at the site of the work is counted. Payment for furnishing each type, kind, and length of pile is made at the contract unit price. Payment for driving each type and kind of pile is made at the contract unit price. Such payment will constitute full compensation for all labor, equipment, materials, and all other items necessary and incidental to the completion of the work.

Method 3—For items of work for which specific unit prices are established in the contract, the length of each type and kind of pile driven is computed to the nearest foot as the difference between the measured length of pile before driving and measured length of pile cut off after driving. Payment for furnishing and driving each type and kind of pile is made at the contract unit price. Such payment will constitute full payment for all labor, equipment, materials, and other items necessary and incidental to the completion of the work.

Method 4—For items of work for which specific unit prices are established in the contract, the area of sheet pile walls, acceptably placed in accordance and within the neat lines shown on the drawings, is computed to the nearest square foot. Payment is made at the contract unit price for each type, kind, and

weight of piling. Such payment will constitute full payment for all labor, equipment, materials, and other items necessary and incidental to the completion of the work.

All Methods—The following provisions apply to all methods of measurement and payment:

The measurement of the number of linear feet of piles (or number of piles) furnished and the number of piles driven shall include test and tension piles specified in the contract. Piles furnished and driven at the option of the contractor are not included. No payment is made for furnishing or driving pile, including test piles, to replace piles lost or damaged before the completion of the contract while in stockpile or during handling and driving.

When load tests are specified, payment for each test is made at the contract unit price per test. Such payment will constitute full compensation for all labor, equipment, materials, and all other items necessary and incidental to perform the test, except furnishing and driving piling.

When splices are specified, payment for each splice is made at the contract unit price. Such payment shall constitute full compensation for labor, equipment, materials, and all other items necessary and incidental to the completion of the work.

Compensation for any item of work described in the contract, but not listed in the bid schedule is included in the payment for the item of work to which it is made subsidiary. Such items and the items to which they are made subsidiary are identified in section 14 of this specification.

14. Items of work and construction details

Instructions for use

Construction Specification 14—Pressure Grouting

1. Applicability

Construction Specification 14 is applicable to the drilling and pressure grouting of structure foundations with suspension grouts.

2. Material specifications

The following material specifications complement Construction Specification 14:
522—Aggregates for Portland Cement Concrete
531—Portland Cement

3. Included items

Items to be included in contract specifications and drawings follow:

- a. Plan and profile of the grouting layout. Include region to be grouted, location, and spacing of lines and holes. Show the depth of holes, location, and logs of drill holes used in the geologic investigation.
- b. Mode of drilling (rotary, percussion, or rotary-percussion) and diameter of grout holes.
- c. Inclination of holes (angle to vertical) if inclined holes are required.
- d. Designate the location and distance for transport of core boxes into storage.
- e. Number and depth of check holes to be drilled and mode of drilling.
- f. Details of testing and sampling in overburden, if required. Include method of measurement and payment.
- g. Location and placement details of capping concrete or concrete slabs, if required.
- h. Method of grouting (packer or stage). As a rule, packer grouting is the preferred method unless rock conditions prohibit the seating of packers in the hole. If analysis shows stage grouting must be used, the reasoning for the decision should be documented.
- i. Area boundaries and depth of stages for stage grouting. Depth intervals (lifts) for packer grouting.
- j. Criteria for split spacing (cubic feet of dry solids per linear foot of hole, usually 0.5 cubic foot per foot of hole).
- k. Sequence in which grout hole rows are to be grouted, usually upstream row first.
- l. Design pressures at the collar for various grout mixes and various depth intervals (see chart in section 13 of the specification).
- m. Limitations and requirements on the sequence of drilling and grouting, usually 50 feet.
- n. Minimum distance to be maintained between grouting and drilling operations, and minimum age of grout at which drilling in grouted holes or adjacent to grouted holes will be permitted, normally 12 hours.
- o. Specify the minimum distance between grouted area and blasting site and maximum allowable blasting intensity. Criteria: Particle velocity maximum of 1 inch per second at the location of the grouted rock.
- p. Minimum distance between grout and water injections, concrete structures, and drains.
- q. Specify type of cement to be used in grout mix and the starting ratios if different from section 14.
- r. Specify to which gradation sand is to conform as per gradation limits in section 2.
- s. Type and quality of admixtures. If calcium chloride is to be used, specify that it shall conform to ASTM D 98. Specify: *high sodium, Wyoming grade bentonite* if bentonite is specified in section 18.

- t. Type and quality of bulk fillers. (Specify section 2 gradation limits or other numerical gradation. Note approval of fly ash source, if applicable.)
- u. Pollution control measures (PCM)—When Construction Specification 5, Pollution Control, does not provide guidance for the grouting operations, include requirements in this specification. PCM are to be installed and maintained by the contractor to prevent waste grout materials, chemical wastes, and soil from entering the stream. A plan for pollution control is to be submitted by the contractor to the engineer for review before installation of any measures. After grouting has been completed, pollution control measures are to be removed. A minimum of one sediment basin is generally required. Cross reference these requirements with Construction Specification 5.
- v. The quantity variation clause applies to pressure grouting. Quantity estimates should not include token amounts, but should reflect the best estimate of expected grout take based on site exploration data and engineering geology.
- w. Bid items for mobilization for pressure grouting, if applicable. A separate bid item should be considered if mobilization for grouting equipment will involve a significant amount of work and if grouting is not the principal item of construction work under the contract. If grouting is the main job, a general mobilization item using Construction Specification 8 should be used for all mobilization.
- x. If Construction Specification 94, Contractor Quality Control, is not a part of the contract and if this specification is being used in a Federal contract and the contractor is required to keep detailed records for quality control, modify Section 15, Records, by inserting in Section 18, Items of work and construction details, the altered roles of the engineer and contractor.
- y. As an alternate to the item just above this one, use Construction Specification 94 and detail the contractor's quality control activities that are required.

4. Methods

No methods are outlined in the specification. Section 18 shall provide a clear statement of the items listed under Section 17, Measurement and payment, that will apply to work requirements for measurement and payment purposes.

5. Items of work and construction details

Starting at the top of page 14–9, prepare and outline job specific "Items of Work and Construction Details" (IWCD) in accordance with these instructions. For ease of utilization, the use of recyclable color paper for the IWCD should be considered.

Construction Specification 14—Pressure Grouting

1. Scope

The work consists of drilling grout holes, exploratory holes, and check holes; pressure testing, pressure washing, and injecting suspension grout under pressure; and includes furnishing of all materials, labor, and equipment as described and specified.

2. Material

Portland Cement—Portland cement shall conform to the requirements of Material Specification 531, Portland Cement, for the specified type. If the cement contains lumps or foreign material that would clog the grouting equipment or interfere with grout injection, it shall be screened through a 100-mesh screen. Cement shall be furnished in bags (94 lb) unless special equipment is provided for storing, handling, and weighing bulk cement as specified in section 3 of this specification.

Water—Water used shall be clean and free from injurious amounts of oil, acid, organic matter, or other deleterious substances.

Sand—Sand for grout shall conform to Material Specification 522, Aggregates for Portland Cement Concrete, and, unless otherwise specified, the gradation shall be within the numerical limits as follows:

Sieve designation (U.S. std. square mesh)	Percent passing by weight
16	100
50	20 – 50
100	10 – 30
200	0 – 5

Sand included in the mix shall be measured in cubic-foot boxes or other volumetric method approved by the engineer, or by dry unit weight with correction for moisture content.

Bulk fillers—Bulk fillers other than sand shall be of the type and quality specified in section 18 of this specification. Bulk fillers included in the mix shall be measured in cubic-foot boxes or by dry unit weight with correction for moisture content, if applicable.

Admixtures—Admixtures shall be the type and quality specified in section 18 of this specification.

Storage and supply—A sufficient quantity of all materials shall be on hand to ensure that grouting operations will not be interrupted or delayed. Materials shall be stored and protected at all times and at all locations so that the quality of the materials is maintained.

3. Equipment

All drilling and grouting equipment shall be of a type and capacity and in condition to perform the work described.

Drilling equipment—Drilling equipment shall be capable of drilling angle holes up to 45 degrees from vertical unless otherwise specified in section 18 of this specification.

For exploratory holes, all drilling equipment used in rock shall be the rotary type and shall be equipped with hydraulic feed.

Cores shall be drilled with standard ballbearing, swivel type, N-size, double or triple tube split inner core barrels or equivalent size wire-line coring equipment.

Equipment for drilling grout and check holes shall be rotary, percussion, or rotary-percussion type as specified in section 18 of this specification. No core recovery will be required, and the type of bit used shall be optional. Equipment using air alone for flushing cuttings shall not be used. When percussion drilling equipment using water for flushing cuttings is used, the lifting rate of the flushing water shall be not less than 18 inches per second.

Grouting equipment—The equipment shall be capable of mixing and pumping grout having a mix ratio, by volume, of one part water, one part cement, and two parts bulk filler, such as sand or fly ash.

Mixers—Unless otherwise specified, mixers shall be high speed colloidal type and capable of thoroughly mixing water, cement, and bulk fillers to produce a grout of uniform texture and consistency. Mixers shall match the capacity of the pumping plant.

Holdover tank—A holdover tank shall be furnished if a single compartment mixer is used. It shall be equipped with mechanical agitators to prevent segregation of the grout and shall have sufficient capacity to temporarily store the grout and thus provide a continuous supply. The outflow shall pass through a No. 16 wire mesh screen if the grout contains particles or foreign matter that would interfere with its proper flow into the voids it is intended to fill.

Pumps—Grout pumps shall be long stroke, multiple piston or the helical screw type. The capacity shall be not less than 3 cubic feet per minute at 200 pounds per square inch for the maximum grout mix of 1:1:2 (w:c:bf), by volume.

Cement and fly ash-handling equipment—If bulk cement or fly ash is used, it shall be stored in weather tight bins or silos equipped and arranged to discharge directly into a weighing hopper, and hence, directly into the grout mixer without spillage and without intermediate handling.

Air supply—The air supply shall meet the requirement of the pumps and shall not be less than 200 cubic feet per minute per plant.

Water meter—One water meter that has a reset and is graduated in tenths of gallons or hundredths of cubic feet shall be used with each mixer.

Pressure gauges—One pressure gauge shall be installed at the pump and one at the collar of the hole. Gauges shall be nonclogging or use gauge savers or grease to prevent clogging. Spare gauges shall be available at the plant at all times.

Hoses, valves, and fittings—Hoses, valves, and fittings shall be compatible with the maximum pressures specified. Hose from pump to grout header and return shall not be smaller than 1.5-inch (ID), and the pipe between header and packer shall not be smaller than 0.75-inch (ID). Double or single packers may be required for grouting and pressure testing. Packers shall fit tightly in the holes at all testing and grouting pressures.

4. Arrangement of grouting equipment

The arrangement of grouting equipment shall provide a return line from the header back to the mixer or holdover tank. This permits continuous circulation of the grout. The grout pressure shall be controlled at the header or at the end of the return line.

The hose between the takeoff at the grout supply line to the header at the hole shall not be longer than 15 feet.

Grouting several holes simultaneously from the same grout pump (multiple header arrangement) is not permitted.

Each hole shall be equipped with a shutoff valve below the hand coupling union. This permits shutoff at refusal pressure and removal of the header to another hole while still maintaining pressure in the completed hole.

The header arrangement shall include a blowoff valve and a control valve used to check hole back pressure before header removal. It must also have a return line valve. The header shall be connected to the supply line by a U-shaped pipe arrangement or other fashion that prevents fallout of solids into the hole from the bypassing grout during low rates of grout acceptance.

5. Communications

A suitable voice communications system between individuals at the pump units and the holes shall be maintained by the contractor.

6. Grout mixtures

Composition—Grout shall consist of a mixture of portland cement, water, sand, bulk filler, and additives, as specified. Grout mixes and sequences of changes in mix ratio or composition shall be as specified in section 13 of this specification or as approved by the engineer.

Mix ratios—Grout mix ratios are expressed in cubic feet of water to a bag of cement. Bulk fillers are expressed in cubic feet to a bag of cement. Other additives are expressed in percent to a bag of cement and measured in pounds, gallons, or pints.

7. Grout caps and concrete slabs

Concrete for grout caps and slabs, if required, shall be placed as shown on the drawings. The concrete shall be a workable mixture of portland cement, fine and coarse aggregates, and water, containing not less than 6 bags of cement per cubic yard of concrete, and not more than 6 gallons of water per bag of cement, including the free moisture of the aggregates.

Portland cement shall conform to the requirements of Material Specification 531 for the type specified. Aggregates shall consist of sound and durable particles and shall conform to the limitations for deleterious substances and the grading requirements of ASTM Specification C 33. Coarse aggregates shall be size 7, 67, 57, or 467 as defined in ASTM Specification C 33.

Batching, mixing, and placing shall be conducted in a manner that produces a uniform, well-graded, and dense concrete.

When ready-mixed concrete is furnished, the contractor shall furnish the engineer a delivery ticket showing the time of loading and the quantities of materials used for each load of concrete. Concrete shall be placed within 1.5 hours after introduction of the cement to the aggregates or within 45 minutes when the temperature of the concrete is 85 degrees Fahrenheit or greater.

Surfaces against which concrete is to be placed shall be cleaned of all soil, loose rock, and other loose material and shall be moist when the concrete is placed.

Concrete shall be placed only when the engineer is present.

The concrete shall be prevented from drying for a curing period of at least 5 days after it is placed. Exposed surfaces shall be kept continuously moist for the entire period, or shall be coated with an acceptable curing compound as soon as free water has disappeared.

8. Drilling overburden

Unless otherwise specified, holes drilled through overburden shall be cased with steel. Casings shall be removed after completion of the grouting operations unless otherwise approved by the engineer. Holes in overburden shall be backfilled with grout or a sand-cement mixture or by tamping soil into the holes to approximately the bulk density of the surrounding overburden, unless otherwise specified in Section 18 of this specification.

9. Drilling rock

The location, inclination, and depth of holes shall be as shown on the drawings or as directed by the engineer.

Rod dope, grease, and other solid or liquid lubricants are not permitted.

The contractor shall perform such exploratory drilling as may be required to determine the condition of the rock before grouting and the effectiveness of the grouting operation as the work progresses. All exploratory holes shall be cored and shall be pressure tested when directed by the engineer. Exploratory holes shall be drilled with an N-size core barrel as specified in section 3 of this specification. Rock core samples shall be carefully placed in correct sequence in labeled core boxes furnished by the contractor. The contractor shall transport the core boxes to the location designated in section 18 of this specification.

Unless otherwise specified, grout holes shall have a diameter not less than 2 15/16 inches (NX).

10. Washing grout holes

When authorized by the engineer and prior to grout injection, grout holes shall be washed with water and air to remove mud, drill cuttings, and other materials that will interfere with the grout take of the hole. Grout holes to be washed and the sequence of washing shall be approved by the engineer. Washing under pressure using packers or pressure testing shall be performed when specified. Washing time for each hole shall be approved by the engineer.

If mud is moved into a hole by grouting nearby holes after the hole has been washed, the mud will be removed by rewashing the hole.

The air and water pressure will be adjusted to provide the maximum cleaning condition for the holes as determined by the engineer. Water and air shall be introduced simultaneously under pressure and at the same elevation in the hole. The water pump shall be capable of producing 200 gpm of water at a minimum of 100 pounds per square inch. The air supply shall be capable of furnishing a minimum of 200 cubic feet per minute at 100 pounds per square inch.

Unless approved by the engineer, no holes within 100 feet of a previously grouted hole shall be washed unless the grout has been placed for at least 48 hours.

11. Pressure testing

In holes to be pressure tested, the packer or packers shall be set at intervals as directed by the engineer. Each interval shall be tested at water pressures up to the specified design grouting pressure for that interval, unless otherwise directed by the engineer. Pressures exceeding the specified design pressures shall not be applied unless specifically authorized by the engineer.

The flow shall be read at 1 minute intervals. The test is completed when the rate of take is steady for at least 3 consecutive minutes at the maximum pressure for the section being tested. The flow readings shall be recorded on a form supplied by or approved by the NRCS.

Pressure test equipment shall be calibrated at the site to determine the pressure loss in the equipment at various flow rates and test depths. Pressure tests and calibration of pressure test equipment shall be performed in the presence of the engineer.

12. Packer and stage grouting

For packer grouting, the holes shall be drilled to the total depths and shall be grouted in lifts starting at the bottom. If the drill water is lost completely, the hole shall be grouted at that depth and drilling continued not less than 24 hours after grouting. The packer lifts and related pressures shall be as specified except as otherwise directed by the engineer.

If stage grouting becomes necessary, it shall be performed in successive depth intervals (stages) in each hole beginning at the rock surface and progressing to the deeper stages. All of the holes in a specified area shall be drilled and grouted in each stage before grouting of the succeeding stage is begun. The stages and the grouting pressures for each stage shall be as specified unless otherwise directed by the engineer.

Each stage of a hole shall be washed with water and air simultaneously and immediately before grouting. Washing under pressure or pressure testing shall be performed as specified in section 10 of this specification.

13. Grout injection

The pumping rate shall not exceed 3 cubic feet per minute unless otherwise approved by the engineer. Grout pressures shall be as specified in section 18 of this specification, but shall not exceed the refusal pressures shown as follows:

Grout refusal pressures for mix ratios

Rock cover (ft)	----- Gauge pressure at collar in PSI for the mix ratios (by volume) -----							
	1:1:2	1:1:1	1:1:3/5	1:1 W:C	2:1	3:1	5:1	water
5	1	1	1	1	1	1	2	3
10	1	1	2	2	3	3	4	5
20	1	2	3	5	7	8	9	10
40	8	12	14	17	21	23	26	30
60	22	26	28	34	40	43	46	52
80	36	41	44	52	60	64	68	75
100	50	56	60	70	80	84	90	99

- Notes:** (1) 1:1:3/5 = 5 water : 5 cement : 3 sand
 (2) Overburden counts as 50% rock cover (10 feet of overburden = 5 feet of rock cover)
 (3) For depths and mix ratios other than those shown, linear interpolation shall be made to determine maximum pressure.

Grouting, particularly in zones near the surface, shall be accomplished with extreme caution to prevent uplift of the rock or excessive leakage at the surface.

The contractor shall caulk surface cracks that allow excessive loss of grout. Cracks may be caulked by mechanical means or with fast setting mortar. If necessary, grouting shall be temporarily suspended or the pressure shall be reduced to permit the caulking of leaks. Accelerators may be added to the grout for the same purpose if approved by the engineer.

If grout injected into one hole appears in adjacent holes, the interconnected holes shall be plugged temporarily with packers set just above the level at which the grout is entering. Holes grouted by interconnection shall be split spaced.

The quantity of grout prepared in advance shall be kept to a minimum. Grout that has remained in the mixer or holdover tank with or without agitation for more than an hour shall be discarded.

Grout temperatures shall be no lower than 50 degrees Fahrenheit. The grouted soil, rock, or concrete shall be no colder than 40 degrees Fahrenheit when grout is injected and for at least 48 hours thereafter. Insulation or heat shall be applied to the surface for 24 hours before grouting and 48 hours after if required to keep the soil, rock, or concrete above the minimum required temperature.

When the hole shows signs of refusal, a thinner mix shall be used to prevent or remove clogging.

A hole shall be considered grouted when the grout take at the design pressure is less than 1 cubic foot of grout in 10 minutes.

If a hole continues to accept grout after a specified amount of the thickest workable grout mixture has been injected, the engineer may specify a reduced pump speed and/or the use of accelerators, or may direct that the pumping be halted temporarily to permit the grout to set. In which case, the hole shall be flushed with about 5 to 8 cubic feet of water and rested for at least 4 hours.

Grouting shall be discontinued in holes that do not respond to the above procedure. The holes shall be redrilled and regouted later, or the area of high grout absorption shall be grouted from adjacent holes until the design objective has been achieved.

14. Grouting procedure

The procedures and grout mixes described below are general guidelines and may be altered in the field by the engineer to suit the conditions encountered and to meet the design objectives.

Unless on-the-site experience indicates otherwise and in lieu of pressure testing, each stage or lift of a hole to be grouted shall be started with about 15 cubic feet (three batches) of water:cement mix to be no thinner than 5:1 (w:c), by volume, unless otherwise specified in section 18 of this specification.

If the hole continues to take grout at a pumping rate not to exceed 3 cubic feet per minute and at a pressure equal to or less than specified as refusal pressure, the mix ratio shall be changed to 3:1 (w:c). If the majority of the holes accept the 3:1 without signs of slowdown in the rate of take, holes in that stage or location may be started with a 3:1 instead of the 5:1 mix. A change to a different location or stage may require a return to the 5:1 starter mix.

Grout mixes shall be thickened from 5:1 to 3:1 to 2:1 to 1:1 after which sand and/or fly ash shall be added to the mix in a graduated manner (5:5:1S, 5:5:2S, ...). The water-cement ratio shall not be less than one.

15. Records

Unless otherwise specified, the contractor shall keep drilling logs and complete records of all grouting operations. These records include time logs of grout mixes and admixtures used in each stage or lift for each hole, related pressures and pumping rates, back-pressures, and observations on excessive leakage and other nonroutine conditions. The drilling log shall include date, hole location, depth of rock, and depths to various rock features. Rock features shall be described as hard, soft, weathered, cracks, or cavities. The contractor quality control activities are outlined in Construction Specification 94, when applicable.

Unless otherwise specified, the contractor shall cooperate in providing all information related to drilling and grouting activities required by the contract.

Unless otherwise specified, one copy of the records shall be provided the engineer at the completion of each shift.

16. Cleanup

After grouting is completed, the contractor shall remove the grouting plant and all related parts, equipment, and supplies from the site. The cleanup includes unused materials and waste.

17. Measurement and payment

For items of work for which specific unit prices or lump sum prices are established in the contract, measurement and payment for pressure grouting is made as described below. Such payment will constitute full compensation for all labor, materials, equipment, and all other items necessary and incidental to the completion of the work.

Mobilization—Payment for mobilization is made at the contract lump sum price. Such payment will include compensation for moving grouting equipment and supplies to the site of the work, assembling the plant at the site, moving on the site as work progresses, and removal from the site upon completion of the work. Sixty percent of the lump sum price will be paid when the plant is assembled at the site and grouting work is begun. The remaining 40 percent will be paid after the work is completed, the plant is removed from the site, and cleanup is complete.

Drilling overburden—Drilling overburden is measured by determining to the nearest foot the total linear feet of accepted hole drilled in the overburden. Payment for drilling overburden is made at the contract unit price, which will include compensation for placing and removing casings.

Drilling rock—Drilling rock is measured by determining to the nearest foot the total linear feet of accepted hole of each size drilled in rock without coring. Payment for drilling rock is made at the contract unit price for each size of hole.

Coring rock—Coring rock is measured by determining to the nearest foot the total linear feet of accepted hole of each size cored in rock. Payment for coring rock is made at the contract unit price for each core size, which will include compensation for furnishing and handling the core boxes, storing cores, and recording observations as specified.

Pressure tests—Pressure testing is measured by determining the total time to the nearest quarter hour that pressure is applied to the holes in making the required tests. A quarter hour will be added for setting up equipment for each testing period. No extra payment will be made for calibrating pressure test equipment. Payment for pressure tests is made at the contract unit price.

Washing grout holes—Measurement for payment is determined by the total time, to the nearest one-tenth hour, that water is actually applied to the hole. No extra payment will be made for setting up equipment. Payment for washing grout holes is made at the contract unit price.

Connections to grout holes—Connections to grout holes are measured by determining the number of connections made of the grout supply hose to the holes to be grouted. The number of connections for payment will not exceed one per hole for packer grouting or one for each stage for stage grouting. The exception is if grouting is interrupted to permit the grout to set, then one additional connection will be measured for payment each time grouting at the same elevation in the same hole is resumed. Payment for connections to grout holes is made at the contract unit price.

Placing grout—Grout placed is measured to the nearest cubic foot by counting the number of batches of each grout mixture injected in the holes as specified and multiplying by the number of cubic feet per batch. The number of cubic feet per batch for each grout mixture is determined as the average of the measured volumes of at least three batches of the mixture, or it is calculated as the sum of the absolute volumes of water, cement, sand, and bulk fillers used in the mixture. Absolute volume is defined as:

$$\frac{\text{weight (lb) of material}}{\text{bulk specific gravity of material} \times 62.4}$$

Admixtures shall not be considered in determining batch volume. The weight and specific gravity for sand shall be based on saturated surface dry conditions.

Payment for placing grout is made at the contract unit price, which includes compensation for handling all materials for the purpose of mixing and placing grout, sealing surface leaks, and maintaining grout records. Payment is not made for grout lost by failure of the contractor to caulk surface leaks or for grout otherwise wasted because of the actions of the contractor.

Cement—Cement for grout is measured on the basis of the number of bags of cement (94 lb) or equivalent weight of bulk cement used in the grout. Cement used in concrete for capping or other purposes is not included. Payment for cement is made at the contract unit price. Payment is not made for cement in grout wasted because of mechanical failure or the actions of the contractor.

Sand and bulk fillers—Sand and bulk fillers are measured by volume or equivalent weight, adjusted for moisture content where applicable, to the nearest cubic foot of each used in the grouting operation. Payment is made at the contract unit price for sand and each type of bulk filler specified. Payment is not made for sand or bulk filler wasted because of mechanical failure or the actions of the contractor.

Admixtures—Liquid admixtures are measured by volume to the nearest gallon. Dry admixtures are measured by weight to the nearest pound. Payment for admixtures is made at the contract unit price for each type of admixture specified. Payment is not made for admixtures wasted because of mechanical failure or the actions of the contractor.

Grout caps and concrete slabs—Capping and slab concrete are measured to the nearest 0.1 cubic yard by determining the combined weights of cement, aggregates, and water used in concrete mixed and placed as specified, and dividing by a unit weight of 4,000 pounds per cubic yard. Payment for capping concrete is made at the contract unit price, which includes compensation for furnishing and handling all materials (including cement) and for mixing, transporting, placing, and curing the concrete.

Subsidiary items—Compensation for any item of work described in the contract, but not listed in the bid schedule is included in the payment for the item of work to which it is made subsidiary. Such items and the items to which they are made subsidiary are identified in section 18 of this specification.

18. Items of work and construction details

Instructions for use Construction Specification 21—Excavation

1. Applicability

Construction Specification 21 is applicable to all types of excavation. The specification defines classes of excavation and includes special requirements for certain types of excavation, but does not establish and define all types of excavation. It is intended that the types of excavation be established on a job or project basis, as needed.

The *class* of excavation defines the kind of material to be excavated. The *type* defines the functional purpose of the excavation. Established types of excavation may include (but are not restricted to):

- Foundation excavation with or without stripping
- Cutoff, keyway, or core trench excavation
- Channel excavation
- Structure excavation
- Auxiliary spillway excavation
- Abutment shaping excavation
- Borrow area excavation

Any of the established types may include excavation of materials in any class. However, the excavation of a given class of material may be more difficult in one type of excavation than in another. These factors must be carefully considered as a basis for establishing types of excavation to be designated on the drawings and listed in the bid schedule.

For projects involving considerable quantities of excavation of different classes of material under conditions that vary in different part of the works, bids must be asked, and payments made, on the basis of both type and class of excavation. For such projects, the bid schedule must be set up in terms of both type and class of excavation (for example: channel excavation, common; and channel excavation, rock).

For projects involving only one type of excavation and for projects involving small quantities of excavation, it may be sufficient to include only the classes of excavation in the bid schedule.

2. Material specifications

No material specifications complement Construction Specification 21, Excavation.

3. Included items

Items to be included in contract specifications and drawings follow:

- a. The horizontal and vertical extent of each type of excavation. Indicate the vertical extent as approximate where the exact depth required is not known.
- b. Designation and definition of types of excavation.
- c. Excavation pay limits when method 1, section 9, is used.
- d. Surface finish requirements, such as grading tolerances. This may be especially important at the crest of an auxiliary spillway.
- e. The location and limits of all borrow areas. Outline all surface grading requirements following completion of borrow material utilization.
- f. The location and limits of all waste areas. When borrow areas serve also as waste areas, coordination of construction activities may be important.
- g. Boring logs and test pit logs pertinent to all areas to be excavated. In addition to descriptions of materials, logs must also include water table elevations and dates of observation, where applicable. For purposes of the construction drawings, no indications of correlation of materials

between logs shall be shown. Interpretation of materials is to be avoided and left to the contractor for determination.

- h. Existing access and haul roads.
- i. Special requirements for dewatering and keeping the excavation dry, with cross reference to Construction Specification 11, Removal of Water, where applicable.
- j. Special requirements for control of blasting, including written plans and approvals, if applicable.
- k. Special requirements for control of erosion, water pollution, and air pollution, with cross reference to Construction Specification 5, Pollution Control, as applicable.
- l. Requirements for control of the size gradation of excavated rock where necessary to obtain material of a particular gradation for rock fill or riprap.
- m. Methods of measurement and payment, if the standard specification includes more than one method.
- n. Requirements for concrete to fill voids from overexcavation (refer to Construction Specification 31, Concrete for Major Structures, or 32, Structure Concrete) if requirements in section 8 are not adequate.

4. Methods

Section 4, Use of excavated materials

Method 1—Intended for use when the quality, condition, and relative location of significant quantities of the materials to be excavated are known to be suited to the economic construction of the required earthfills and earth backfills, and particularly where alternate sources of material are less desirable or do not exist.

Method 2—Intended for use when the known data indicate that the use of alternate sources of earthfill materials may result in more economical construction of the required earthfills and earth backfills.

Section 5, Disposal of waste materials

Method 1—Intended for use when areas for wasting unsuitable and/or excess materials are available at the site, when the waste fill will beneficially supplement the function of the permanent works, or if no known market is available for such waste materials as may be produced.

Method 2—Intended for use when areas for wasting unsuitable and excess material are not readily available at the site or if a known market for such waste materials is readily available.

Section 9, Measurement and payment

Note in section 10 when volume calculations other than the average cross-sectional end area method are used and describe the applicable method. Example: *In lieu of computing excavation volumes by the method of average cross-sectional end areas, the volume may be computed by the prismatic formula method with the assistance of computer aided design program.*

Method 1—Intended for excavations where the pay limits can best be defined on the drawings.

Method 2—Intended for excavations bounded by simple plane surfaces and constant or gradually varying cross section throughout.

Method 3—Intended for excavations where the lower limits are determinable only by examination of the materials encountered and where the lower limits have been designated on the drawings as approximate or to be determined by the engineer during construction.

Method 4—Intended for structure excavation bounded by fairly simple plane surfaces where pay limits are not shown on the drawings.

When specifications are prepared using electronic procedures and all methods but one are deleted for use in a contract specification, delete

from the last paragraph *All Methods The following provisions apply to all methods of measurement and payment.* Left justify the remaining text.

5. Items of work and construction details

Starting at the top of page 21-5, prepare and outline job specific "Items of Work and Construction Details" (IWCD) in accordance with these instructions. For ease of utilization, the use of recyclable color paper for the IWCD should be considered.

Construction Specification 21—Excavation

1. Scope

The work shall consist of the excavation required by the drawings and specifications and disposal of the excavated materials.

2. Classification

Excavation is classified as common excavation, rock excavation, or unclassified excavation in accordance with the following definitions or is designated as unclassified.

Common excavation is defined as the excavation of all materials that can be excavated, transported, and unloaded using heavy ripping equipment and wheel tractor-scrappers with pusher tractors or that can be excavated and dumped into place or loaded onto hauling equipment by excavators having a rated capacity of one cubic yard or larger and equipped with attachments (shovel, bucket, backhoe, dragline, or clam shell) appropriate to the material type, character, and nature of the materials.

Rock excavation is defined as the excavation of all hard, compacted, or cemented materials that require blasting or the use of ripping and excavating equipment larger than defined for common excavation. The excavation and removal of isolated boulders or rock fragments larger than 1 cubic yard encountered in materials otherwise conforming to the definition of common excavation shall be classified as rock excavation. The presence of isolated boulders or rock fragments larger than 1 cubic yard is not in itself sufficient cause to change the classification of the surrounding material.

For the purpose of these classifications, the following definitions shall apply:

Heavy ripping equipment is a rear-mounted, heavy duty, single-tooth, ripping attachment mounted on a track type tractor having a power rating of at least 250 flywheel horsepower unless otherwise specified in section 10.

Wheel tractor-scraper is a self-loading (not elevating) and unloading scraper having a struck bowl capacity of at least 12 cubic yards.

Pusher tractor is a track type tractor having a power rating of at least 250 flywheel horsepower equipped with appropriate attachments.

Unclassified excavation is defined as the excavation of all materials encountered, including rock materials, regardless of their nature or the manner in which they are removed.

3. Blasting

The transportation, handling, storage, and use of dynamite and other explosives shall be directed and supervised by a person(s) of proven experience and ability who is authorized and qualified to conduct blasting operations.

Blasting shall be done in a manner as to prevent damage to the work or unnecessary fracturing of the underlying rock materials and shall conform to any special requirements in section 10 of this specification. When specified in section 10, the contractor shall furnish the engineer, in writing, a blasting plan before blasting operations begin.

4. Use of excavated material

Method 1—To the extent they are needed, all suitable material from the specified excavations shall be used in the construction of required permanent earthfill or rockfill. The suitability of material for specific purposes is determined by the engineer. The contractor shall not waste or otherwise dispose of suitable excavated material.

Method 2—Suitable material from the specified excavations may be used in the construction of required earthfill or rockfill. The suitability of material for specific purposes is determined by the engineer.

5. Disposal of waste materials

Method 1—All surplus or unsuitable excavated materials are designated as waste and shall be disposed of at the locations shown on the drawings.

Method 2—All surplus or unsuitable excavated materials are designated as waste and shall be disposed of by the contractor at sites of his own choosing away from the site of the work. The disposal shall be in an environmentally acceptable manner that does not violate local rules and regulations.

6. Excavation limits

Excavations shall comply with OSHA Construction Industry Standards (29CFR Part 1926) Subpart P, Excavations, Trenching, and Shoring. All excavations shall be completed and maintained in a safe and stable condition throughout the total construction phase. Structure and trench excavations shall be completed to the specified elevations and to the length and width required to safely install, adjust, and remove any forms, bracing, or supports necessary for the installation of the work. Excavations outside the lines and limits shown on the drawings or specified herein required to meet safety requirements shall be the responsibility of the contractor in constructing and maintaining a safe and stable excavation.

7. Borrow excavation

When the quantities of suitable material obtained from specified excavations are insufficient to construct the specified earthfills and earth backfills, additional material shall be obtained from the designated borrow areas. The extent and depth of borrow pits within the limits of the designated borrow areas shall be as specified in section 10 or as approved by the engineer.

Borrow pits shall be excavated and finally dressed to blend with the existing topography and sloped to prevent ponding and to provide drainage.

8. Overexcavation

Excavation in rock beyond the specified lines and grades shall be corrected by filling the resulting voids with portland cement concrete made of materials and mix proportions approved by the engineer. Concrete that will be exposed to the atmosphere when construction is completed shall meet the requirements of concrete selected for use under Construction Specification 31, Concrete for Major Structures, or 32, Structure Concrete, as appropriate.

Concrete that will be permanently covered shall contain not less than five bags of cement per cubic yard. The concrete shall be placed and cured as specified by the engineer.

Excavation in earth beyond the specified lines and grades shall be corrected by filling the resulting voids with approved, compacted earthfill. The exception to this is that if the earth is to become the subgrade for riprap, rockfill, sand or gravel bedding, or drainfill, the voids may be filled with material conforming to the specifications for the riprap, rockfill, bedding, or drainfill. Before correcting an overexcavation condition, the contractor shall review the planned corrective action with the engineer and obtain approval of the corrective measures.

9. Measurement and payment

For items of work for which specific unit prices are established in the contract, the volume of each type and class of excavation within the specified pay limits is measured and computed to the nearest cubic yard by the method of average cross-sectional end areas or by methods outlined in section 10 of this specification. Regardless of quantities excavated, the measurement for payment is made to the specified pay limits except that excavation outside the specified lines and grades directed by the engineer to remove unsuitable material is included. Excavation required because unsuitable conditions result from the contractor's improper construction operations, as determined by the engineer, is not included for measurement and payment.

Method 1—The pay limits shall be as designated on the drawings.

Method 2—The pay limits shall be defined as follows:

- a. The upper limit shall be the original ground surface as it existed before the start of construction operations except that where excavation is performed within areas designated for previous excavation or earthfill, the upper limit shall be the modified ground surface resulting from the specified previous excavation or earthfill.
- b. The lower and lateral limits shall be the neat lines and grades shown on the drawings.

Method 3 —The pay limits shall be defined as follows:

- a. The upper limit shall be the original ground surface as it existed before the start of construction operations except that where excavation is performed within areas designated for previous excavation or earthfill, the upper limit shall be the modified ground surface resulting from the specified previous excavation or earthfill.
- b. The lower and lateral limits shall be the true surface of the completed excavation as directed by the engineer.

Method 4—The pay limits shall be defined as follows:

- a. The upper limit shall be the original ground surface as it existed before the start of construction operations except that where excavation is performed within areas designated for previous excavation or earthfill, the upper limit shall be the modified ground surface resulting from the specified previous excavation or earthfill.
- b. The lower limit shall be at the bottom surface of the proposed structure.
- c. The lateral limits shall be 18 inches outside of the outside surface of the proposed structure or shall be vertical planes 18 inches outside of and parallel to the footings, whichever gives the larger pay quantity, except as provided in d below.
- d. For trapezoidal channel linings or similar structures that are to be supported upon the sides of the excavation without intervening forms, the lateral limits shall be at the underside of the proposed lining or structure.
- e. For the purposes of the definitions in b, c, and d, above, any specified bedding or drainfill directly beneath or beside the structure will be considered to be a part of the structure.

All methods—The following provisions apply to all methods of measurement and payment.

Payment for each type and class of excavation is made at the contract unit price for that type and class of excavation. Such payment will constitute full compensation for all labor, materials, equipment, and all other items necessary and incidental to the performance of the work except that extra payment for backfilling overexcavation will be made in accordance with the following provisions.

Payment for backfilling overexcavation, as specified in section 8 of this specification, is made only if the excavation outside specified lines and grades is directed by the engineer to remove unsuitable material and if the unsuitable condition is not a result of the contractor's improper construction operations as determined by the engineer.

Compensation for any item of work described in the contract, but not listed in the bid schedule is included in the payment for the item of work to which it is made subsidiary. Such items and the items to which they are made subsidiary are identified in section 10 of this specification.

10. Items of work and construction details

Instructions for use Construction Specification 23—Earthfill

1. Applicability

Construction Specification 23 is applicable to all types of earthfill including fill sections constructed of rocky soils and embankments constructed of soft or friable rock that is expected to break down during compaction.

2. Material specifications

No material specifications complement Construction Specification 23.

3. Included items

Items to be included in the contract specifications and drawings

- a. Complete plans and cross sections of the required earthfills and earth backfills.
- b. Pay limits, where applicable.
- c. Borrow areas or other sources of material.
- d. Designation and description of the types of material required in the various parts of the work.
- e. Maximum allowable size of rock particles.
- f. Special requirements for foundation preparation.
- g. Maximum layer thickness before compaction for earthfill. (Table A-23 may be used as a guide. This table gives upper limits for the general classes of material listed. The specified maximum layer thickness may need to be substantially less than the tabulated value to obtain adequate compaction.)
- h. Maximum layer thickness before compaction for earth backfill by manually directed power tampers. (The maximum thickness that can be adequately compacted depends upon the tampers and upon the soil being placed. It varies from about 4 inches for plastic clays to about 8 inches for coarse grained material of low plasticity.)
- i. Special instructions for sectional or phased construction, where applicable.
- j. Allowable range of moisture content for each item. For example:
 - (1) "The moisture content of the fill matrix at the time of compaction shall be neither less than 2 percent below optimum moisture content nor more than 2 percent above optimum moisture content."
 - (2) "The moisture content of the fill material shall be maintained within the limits required to: (a) prevent bulking or dilatance of the material under the action of the hauling or compacting equipment, (b) prevent the adherence of the earthfill material to the treads and tracks of the equipment, and (c) ensure the crushing and blending of the soil clods and aggregations into a reasonably homogeneous mass."
- k. Compaction class for each item. (Table A-23 may be used as a guide.)
 - l. For Class A compaction—Compaction test method and required percent of maximum density. Typical compaction test results, if applicable.
 - m. For Class B compaction—Minimum mass density.
 - n. For Class C compaction—Type of roller, minimum weight or contact pressure of roller, minimum vibrating force and frequency for vibrating roller, and minimum number of passes.
 - o. Special rapid methods for moisture control (quick dry, speedy, alcohol, nuclear gauge), if used. These methods are only used on soils where they prove to be a reliable approximation to ASTM D 2216. When rapid methods are used, a reference to the

procedure to be followed should be included.

- p. When the *family of curves* and the one-point Proctor is the intended method for soil density standard determination and verification, it should be referenced and so specified in section 10.
- q. Special requirements, where applicable, for placing earth backfill adjacent to structures, such as reduced compactive effort for high, thin walled structures. This may include monitoring stresses and wall movements and/or specifying minimum in-place concrete strength requirements before the forms or other supports are removed or earth backfilling commences. Minimum in-place concrete strength requirements shall be determined by the designer and clearly stated.
- r. Required minimum strength of concrete, determined according to section 6, for starting compaction of backfill adjacent to structures, if applicable. Use of minimum strength is encouraged over minimum times listed in section 6.
- s. Methods of measurement and payment.
- t. Embedded structures or other elements whose volume will be excluded from the earthfill volume for payment. Major items may be listed for exclusion. The cost of measuring, computing, checking, recordkeeping, and other similar activities must clearly justify the exclusion.
- u. Special requirements pertaining to furnishing and applying water including designated source and details of ownership and water rights, if applicable, and water quality requirements if quality may be a concern.
- v. Special requirements for control of erosion, water pollution, and air pollution, with appropriate cross reference to Construction Specification 5, Pollution Control.
- w. Surface finish requirements, such as completed surface grade tolerances.

4. Methods

Section 9, Measurement and payment

Method 1—Intended for structure earth backfill and other cases where pay limits can best be shown on the drawings.

The selected methods for pay limits must be compatible with those selected for use in Construction Specification 21, Excavation.

Methods 6 or 7 must be used with any or all methods 1 through 5.

- a. Method 6 is intended for use when no separate payment is to be made for water.
- b. Method 7 is intended for use with Construction Specification 10, Water for Construction, when the contractor is to be paid under a separate item for the water needed to bring the earthfill and earth backfill materials to the specified moisture content.

When specifications are prepared using electronic procedures and all methods but one are deleted for use in a contract specification, delete from the last paragraph ***All Methods The following provisions apply to all methods of measurement and payment.*** Left justify the remaining text.

5. Items of work and construction details

Starting at the top of page 23–6, prepare and outline job specific "Items of Work and Construction Details" (IWCD) in accordance with these instructions. For ease of utilization, the use of recyclable color paper for the IWCD should be considered.

Table A-23 Compaction class

Grading characteristics of soil fill material % > no. 4	% fines (passing #200)	Appropriate compaction classes	----- Maximum layer thickness ----- (before compaction)			
			tamping roller (in)	pneum. roller (in)	vibrating roller (in)	40,000 lb track tractor (in)
0 – 35	Over 5	A	9	9	—	—
	Under 5	A	9	12	24	—
		B, C	—	18	30	12
35 – 65	25 – 50	A	9	12	24	—
		B, C	9	18	24	—
	5 – 25	A	—	12	24	—
		B, C	—	18	24	—
Under 5	B, C	—	24	24	18	
Over 65	Over 5	B, C	—	18	24	—
	Under 5	B, C	—	24	24	18

Note: Tabulated values are upper limits. Actual maximum layer thickness for uniform compaction of a given soil material may be substantially lower. Maximum size of rock or rock fragments should not exceed two-thirds of the layer thickness prior to compaction. Soil plasticity should be a consideration.

For weathered or weakly indurated rock materials:

For material, such as shales, schists, disintegrated granite, soft sandstone, and siltstone, the appropriate compaction classes depend upon the degree of breakdown under the action of the excavating and compacting equipment. The maximum layer thickness before compaction must be determined on the basis of special laboratory tests or field compaction tests, or both. Field test fills should be considered to determine the least effort required to meet minimum density requirements.

Construction Specification 23—Earthfill

1. Scope

The work consists of the construction of earth embankments, other earthfills, and earth backfills required by the drawings and specifications.

Earthfill is composed of natural earth materials that can be placed and compacted by construction equipment operated in a conventional manner.

Earth backfill is composed of natural earth material placed and compacted in confined spaces or adjacent to structures (including pipes) by hand tamping, manually directed power tampers or vibrating plates, or their equivalent.

2. Material

All fill material shall be obtained from required excavations and designated borrow areas. The selection, blending, routing, and disposition of material in the various fills shall be subject to approval by the engineer.

Fill materials shall contain no frozen soil, sod, brush, roots, or other perishable material. Rock particles larger than the maximum size specified for each type of fill shall be removed prior to compaction of the fill.

The types of material used in the various fills shall be as listed and described in the specifications and drawings.

3. Foundation preparation

Foundations for earthfill shall be stripped to remove vegetation and other unsuitable material or shall be excavated as specified.

Except as otherwise specified, earth foundation surfaces shall be graded to remove surface irregularities and shall be scarified parallel to the axis of the fill or otherwise acceptably scored and loosened to a minimum depth of 2 inches. The moisture content of the loosened material shall be controlled as specified for the earthfill, and the surface material of the foundation shall be compacted and bonded with the first layer of earthfill as specified for subsequent layers of earthfill.

Earth abutment surfaces shall be free of loose, uncompacted earth in excess of 2 inches in depth normal to the slope and shall be at such a moisture content that the earthfill can be compacted against them to produce a good bond between the fill and the abutments.

Rock foundation and abutment surfaces shall be cleared of all loose material by hand or other effective means and shall be free of standing water when fill is placed upon them. Occasional rock outcrops in earth foundations for earthfill, except in dams and other structures designed to restrain the movement of water, shall not require special treatment if they do not interfere with compaction of the foundation and initial layers of the fill or the bond between the foundation and the fill.

Foundation and abutment surfaces shall be no steeper than one horizontal to one vertical unless otherwise specified. Test pits or other cavities shall be filled with compacted earthfill conforming to the specifications for the earthfill to be placed upon the foundation.

4. Placement

Earthfill shall not be placed until the required excavation and foundation preparation have been completed and the foundation has been inspected and approved by the engineer. Earthfill shall not be placed upon a frozen surface nor shall snow, ice, or frozen material be incorporated in the earthfill matrix.

Earthfill shall be placed in approximately horizontal layers. The thickness of each layer before compaction shall not exceed the maximum thickness specified in section 10 or shown on the drawings. Materials placed by dumping in piles or windrows shall be spread uniformly to not more than the specified thickness before being compacted.

Hand compacted earth backfill shall be placed in layers whose thickness before compaction does not exceed the maximum thickness specified for layers of earth backfill compacted by manually directed power tampers.

Earth backfill shall be placed in a manner that prevents damage to the structures and allows the structures to assume the loads from the earth backfill gradually and uniformly. The height of the earth backfill adjacent to a structure shall be increased at approximately the same rate on all sides of the structure.

Earthfill and earth backfill in dams, levees, and other structures designed to restrain the movement of water shall be placed to meet the following additional requirements:

- (a) The distribution of materials throughout each zone shall be essentially uniform, and the earthfill shall be free from lenses, pockets, streaks, or layers of material differing substantially in texture, moisture content, or gradation from the surrounding material. Zone earthfills shall be constructed concurrently unless otherwise specified.
- (b) If the surface of any layer becomes too hard and smooth for proper bond with the succeeding layer, it shall be scarified parallel to the axis of the fill to a depth of not less than 2 inches before the next layer is placed.
- (c) The top surface of embankments shall be maintained approximately level during construction with two exceptions: A crown or cross-slope of about 2 percent shall be maintained to ensure effective drainage, or as otherwise specified for drainfill or sectional zones.
- (d) Dam embankments shall be constructed in continuous layers from abutment to abutment except where openings to facilitate construction or to allow the passage of streamflow during construction are specifically authorized in the contract.
- (e) Embankments built at different levels as described under (c) or (d) above shall be constructed so that the slope of the bonding surfaces between embankment in place and embankment to be placed is not steeper than 3 feet horizontal to 1 foot vertical. The bonding surface of the embankment in place shall be stripped of all material not meeting the requirements of this specification and shall be scarified, moistened, and recompacted when the new earthfill is placed against it. This ensures a good bond with the new earthfill and obtains the specified moisture content and density at the contact of the in-place and new earthfills.

5. Control of moisture content

During placement and compaction of earthfill and earth backfill, the moisture content of the material being placed shall be maintained within the specified range.

The application of water to the earthfill material shall be accomplished at the borrow areas insofar as practicable. Water may be applied by sprinkling the material after placement on the earthfill, if necessary. Uniform moisture distribution shall be obtained by disking.

Material that is too wet when deposited on the earthfill shall either be removed or be dried to the specified moisture content prior to compaction.

If the top surface of the preceding layer of compacted earthfill or a foundation or abutment surface in the zone of contact with the earthfill becomes too dry to permit suitable bond, it shall either be removed or scarified and moistened by sprinkling to an acceptable moisture content before placement of the next layer of earthfill.

6. Compaction

Earthfill—Earthfill shall be compacted according to the following requirements for the class of compaction specified:

Class A compaction—Each layer of earthfill shall be compacted as necessary to provide the density of the earthfill matrix not less than the minimum density specified in Section 10 or identified on the drawings. The earthfill matrix is defined as the portion of the earthfill material finer than the maximum particle size used in the compaction test method specified.

Class B compaction—Each layer of earthfill shall be compacted to a mass density not less than the minimum density specified.

Class C compaction—Each layer of earthfill shall be compacted by the specified number of passes of the type and weight of roller or other equipment specified or by an approved equivalent method. Each pass shall consist of at least one passage of the roller wheel or drum over the entire surface of the layer.

Earth backfill—Earth backfill adjacent to structures shall be compacted to a density equivalent to that of the surrounding in-place earth material or adjacent required earthfill or earth backfill. Compaction shall be accomplished by hand tamping or manually directed power tampers, plate vibrators, walk-behind, miniature, or self-propelled rollers. Unless otherwise specified heavy equipment including backhoe mounted power tampers or vibrating compactors and manually directed vibrating rollers shall not be operated within 2 feet of any structure. Towed or self-propelled vibrating rollers shall not be operated within 5 feet of any structure. Compaction by means of drop weights operating from a crane or hoist is not permitted.

The passage of heavy equipment will not be allowed:

- Over cast-in-place conduits within 14-days after placement of the concrete
- Over cradled or bedded precast conduits within 7 days after placement of the concrete cradle or bedding
- Over any type of conduit until the backfill has been placed above the top surface of the structure to a height equal to one-half the clear span width of the structure or pipe or 2 feet, whichever is greater, except as may be specified in section 10.

Compacting of earth backfill adjacent to structures shall not be started until the concrete has attained the strength specified in section 10 for this purpose. The strength is determined by compression testing of test cylinders cast by the contractor's quality control personnel for this purpose and cured at the work site in the manner specified in ASTM C 31 for determining when a structure may be put into service.

When the required strength of the concrete is not specified as described above, compaction of earth backfill adjacent to structures shall not be started until the following time intervals have elapsed after placement of the concrete.

Structure	Time interval (days)
Vertical or near-vertical walls with earth loading on one side only	14
Walls backfilled on both sides simultaneously	7
Conduits and spillway risers, cast-in-place (with inside forms in place)	7
Conduits and spillway risers, cast-in-place (inside forms removed)	14
Conduits, pre-cast, cradled	2
Conduits, pre-cast, bedded	1
Cantilever outlet bents (backfilled both sides simultaneously)	3

7. Reworking or removal and replacement of defective earthfill

Earthfill placed at densities lower than the specified minimum density or at moisture contents outside the specified acceptable range of moisture content or otherwise not conforming to the requirements of the specifications shall be reworked to meet the requirements or removed and replaced by acceptable earthfill. The replacement earthfill and the foundation, abutment, and earthfill surfaces upon which it is placed shall conform to all requirements of this specification for foundation preparation, approval, placement, moisture control, and compaction.

8. Testing

During the course of the work, the engineer will perform quality assurance tests required to identify material; determine compaction characteristics; determine moisture content; and determine density of earthfill in place. Tests performed by the engineer will be used to verify that the earthfills conform to contract requirements of the specifications and not as a replacement for the contractor's quality control program. The contractor shall perform all quality control testing in conformance with the approved quality control system for Method 1 and the approved quality control plan for Method 2 in Construction Specification 94, Contractor Quality Control as required to assure that work performed meets contract requirements.

Densities of earthfill requiring Class A compaction will be determined in accordance with ASTM D 1556, D 2167, D 2922, or D 2937 except that the volume and moist weight of included rock particles larger than those used in the compaction test method specified for the type of fill will be determined and deducted from the volume and moist weight of the total sample before computation of density or, if using the nuclear gauge, added to the specified density to bring it to the measure of equivalent composition for comparison. The density so computed is used to determine the percent compaction of the earthfill matrix. Unless otherwise specified, moisture content is determined by one of the following methods: ASTM D 2216, D 3017, D 4643, D 4944, or D 4959.

9. Measurement and payment

For items of work for which specific unit prices are established in the contract, the volume of each type and compaction class of earthfill and earth backfill within the specified zone boundaries and pay limits is measured and computed to the nearest cubic yard by the method of average cross-sectional end areas. Unless otherwise specified in section 10, no deduction in volume is made for embedded items, such as, but not limited to, conduits, inlet structures, outlet structures, embankment drains, sand diaphragm and outlet, and their appurtenances.

The pay limits shall be as defined below, with the further provision that earthfill required to fill voids resulting from overexcavation of the foundation, outside the specified lines and grades, will be included in the measurement for payment only under the following conditions:

- Where such overexcavation is directed by the engineer to remove unsuitable material, and
- Where the unsuitable condition is not a result of the contractor's improper construction operations as determined by the engineer.

Earthfill beyond the specified lines and grades to backfill excavation required for compliance with OSHA requirements will be considered subsidiary to the earthfill bid item(s).

Method 1—The pay limits shall be as designated on the drawings.

Method 2—The pay limits shall be the measured surface of the foundation when approved for placement of the earthfill and the specified neat lines of the earthfill surface.

Method 3—The pay limits shall be the measured surface of the foundation when approved for placement of the earthfill and the measured surface of the completed earthfill.

Method 4—The pay limits shall be the specified pay limits for excavation and the specified neat lines of the earthfill surface.

Method 5—The pay limits shall be the specified pay limits for excavation and the measured surface of the completed earthfill.

Method 6—Payment for each type and compaction class of earthfill and earth backfill is made at the contract unit price for that type and compaction class of earthfill. Such payment will constitute full compensation for all labor, material, equipment, and all other items necessary and incidental to the performance of the work.

Method 7—Payment for each type and compaction class of earthfill and earth backfill is made at the contract unit price for that type and compaction class of earthfill. Such payment will constitute full compensation for all labor, material, equipment, and all other items necessary and incidental to the performance of the work except furnishing, transporting, and applying water to the foundation and earthfill material. Water applied to the foundation and earthfill material is measured and payment made as specified in Construction Specification 10.

All methods—The following provisions apply to all methods of measurement and payment. Compensation for any item of work described in the contract, but not listed in the bid schedule is included in the payment for the item of work to which it is made subsidiary. Such items and the items to which they are made subsidiary are identified in section 10 of this specification.

10. Items of work and construction details

Instructions for use Construction Specification 24—Drainfill

1. Applicability

Construction Specification 24 is applicable to the placing of drainfill in all types of structure drainage systems, such as:

- a. Drainage systems installed beneath concrete structures, lining, or pavements
- b. Wall drains for concrete structures
- c. Embankment drainage systems
- d. Interceptor drains installed adjacent to structures
- e. Foundation drains

2. Material specifications

Material Specification 521, Aggregates for Drainfill and Filters, complements Construction Specification 24.

3. Included items

Items to be included in contract specifications and drawings

- a. The location, extent, and dimensions of each drain.
- b. The grading limits of each type of drainfill.
- c. The allowable percentage of material (non-plastic) passing No. 200 Sieve.
- d. The source of drainfill materials, when applicable.
- e. Specifications for control of moisture if required. If water is to be added and is to be included in a separate pay item for water, add the statement in section 9: *Water applied to the drainfill material is measured and payment made as specified in Construction Specification 10, Water for Construction.*
- f. Class of compaction. Also specify the weight and number of passes of the compacting equipment required if more than the minimum amounts specified in Section

6. (Class A provides for control of compaction by minimum density requirements determined by ASTM D 698 for fine grain material. Classes I, II, and III specify the method of compaction. Relative density tests during construction generally should be made in connection with the method specifications to evaluate the compaction being accomplished and be compared to test data outlined in ASTM D4254. Class I is intended for use where highest densities are required, Class II is intermediate, and Class III may be used for wall drains in uncompacted backfill or for other applications where strength is not important.

Specify in section 9 the ASTM D 698 procedure to be modified to consist of one point value for maximum dry density determined on an oven-dried representative sample of the drainfill material. The procedure shall be repeated three times to obtain an average value for the one point.

When specifying Class II compaction, note in section 9 the method (a, b, or c) that applies. Note also if one or more of the methods are to be excluded.

- g. Special requirements for placing drainfill adjacent to new concrete as set forth in section 4.

4. Methods Section 2, Material

Method 1—Intended for use in specifications for drainage systems in areas where commercial aggregate is available in sufficient quantity to meet project needs.

Method 2—Intended to be used in specifications for drainage systems in areas where the contractor will need to process the material from designated sources.

Section 8, Measurement and payment

Method 1—Intended for use when quantities are determined from volume measurements and payment is made to the nearest cubic yard.

Method 2—Intended for use when quantities are determined by weight and payment is by the ton.

5. Items of work and construction details

Starting at the top of page 24-4, prepare and outline job specific "Items of Work and Construction Details" (IWCD) in accordance with these instructions. For ease of utilization, the use of recyclable color paper for the IWCD should be considered.

Construction Specification 24—Drainfill

1. Scope

The work consists of furnishing, placing, and compacting drainfill required in the construction of structure drainage systems.

2. Material

Method 1—Drainfill material shall conform to the requirements of Material Specification 521, Aggregates for Drainfill and Filters. A minimum of 30 days before delivery of materials to the site, the contractor shall inform the engineer in writing of the source(s) from which drainfill material will be obtained. The contractor shall provide the engineer free access to the source(s) for the purpose of obtaining samples for testing.

Method 2—Drainfill material shall be sand, gravel, or crushed stone, or mixtures thereof, obtained from the specified sources. The material shall be selected as necessary to avoid the inclusion of organic matter, clay balls, excessive fine particles, or other substances that would interfere with their free-draining properties.

3. Base preparation

Foundation surface and trenches shall be clean and free of organic matter, loose soil, foreign substance, and standing water when the drainfill is placed. Earth surfaces upon or against which drainfill will be placed shall not be scarified.

4. Placement

Drainfill shall not be placed until the subgrade has been inspected and approved by the engineer. Drainfill shall not be placed over or around pipe or drain tile until the installation of the pipe or tile has been inspected and approved.

Drainfill shall be placed uniformly in layers not to exceed 12 inches thick before compaction. When compaction is accomplished by manually controlled equipment, the layers shall not exceed 8 inches thick. The material shall be placed to avoid segregation of particle sizes and to ensure the continuity and integrity of all zones. No foreign material shall be allowed to become intermixed with or otherwise contaminate the drainfill.

Traffic shall not be permitted to cross over drains at random. Equipment cross-overs shall be maintained, and the number and location of such crossovers shall be established and approved before the beginning of drainfill placement. Each crossover shall be cleaned of all contaminating material and shall be inspected and approved by the engineer before the placement of additional drainfill material.

Any damage to the foundation surface or the trench sides or bottom occurring during placement of drainfill shall be repaired before drainfill placement is continued.

The upper surface of drainfill constructed concurrently with adjacent zones of earthfill shall be maintained at a minimum elevation of 1 foot above the upper surface of adjacent earthfill.

Drainfill over and/or around pipe or drain tile shall be placed to avoid any displacement in line or grade of the pipe or tile.

Drainfill shall not be placed adjacent to structures until the concrete has attained the strength specified in section 9 of this specification. The strength shall be determined by compression testing of concrete

test cylinders cast and field cured at the project site in accordance with ASTM Method C 31 for determining when a structure may be placed into service.

When the required strength of the concrete is not specified as described above, placement of drainfill adjacent to concrete structures shall not be commenced until the following item intervals have elapsed following placement of the concrete:

Structure type	Time interval (days)
Vertical or near-vertical wall with earth loading on one side only (retaining walls and counterforts)	14
Walls backfilled on both sides simultaneously	7
Conduits and galleries, cast-in-place (with inside forms in place)	7
(inside forms removed)	14
Conduits, precast, cradled	2
Conduits, precast, bedded	1
Cantilever outlet bents backfilled on both sides simultaneously	3

5. Control of moisture

The moisture content of drainfill material shall be controlled as specified in section 9 of this specification. When additional water is required, it shall be applied in a manner to avoid excessive wetting to adjacent earthfill. Except as specified in section 9 of this specification, control of moisture content will not be required.

6. Compaction

Drainfill shall be compacted according to the following requirements for the class of compaction specified:

Class A compaction—For drainfill materials with more than 70 percent passing the 3/4 inch sieve, each layer of drainfill shall be compacted to a minimum dry density of not less than the density specified in section 9 of this specification as determined by ASTM D 698. For drainfill materials with 70 percent or less passing the 3/4 inch sieve, each layer of drainfill shall be compacted to a relative density of not less than 70 percent as determined by ASTM D 4254.

Class I compaction—Each layer of drainfill shall be compacted by a minimum of two passes over the entire surface with a steel-drum vibrating roller weighing at least 5 tons and exerting a vertical vibrating force of not less than 20,000 pounds at a minimum frequency of 1,200 times per minute, or by an approved equivalent method.

Class II compaction—Each layer of drainfill shall be compacted by one of the following methods or by an approved equivalent method. (A pass is defined as at least one complete coverage of the roller wheel, tire, or drum over the entire surface for each layer.)

- a. A minimum of two passes over the entire surface with a pneumatic-tired roller exerting a minimum pressure of 75 pounds per square inch.
- b. A minimum of four passes over the entire surface with the track of a crawler-type tractor weighing at least 20 tons.
- c. Controlled movement of the hauling equipment so that the entire surface is traversed by not less than one tread track of the loaded hauling equipment.

Class III compaction—No compaction will be required beyond that resulting from the placing and spreading operations.

When compaction other than Class III compaction is specified, material placed in trenches or other locations inaccessible to heavy equipment shall be compacted by manually controlled pneumatic or vibrating tampers as specified in section 9 of this specification.

Heavy equipment shall not be operated within 2 feet of any structure. Vibrating rollers shall not be operated within 5 feet of any structure. Compaction by means of drop weights operating from cranes, hoists, or similar equipment will not be permitted.

7. Testing

The contractor shall conduct such tests as necessary to verify that the drainfill material and the in-place drainfill meets the specification requirements.

The engineer shall be granted access to perform such tests as are required to verify that the drainfill materials and the drainfill in place meets the requirements of the specifications. These tests are not intended to provide the contractor with information needed to assure that the materials and workmanship meet the specification requirements. These verification tests will not relieve the contractor of the responsibility of performing required tests for that purpose.

8. Measurement and payment

Method 1—For items of work for which specific unit prices are established in the contract, the volume of drainfill within the neat lines shown on the drawings are measured and computed to the nearest cubic yard. Where the engineer directs placement of drainfill outside the neat lines to replace unsuitable foundation material, the volume of such drainfill is included. The volume included is only to the extent that the unsuitable condition is not a result of the contractor's improper construction operation in the determination of the engineer.

Payment for drainfill is made at the contract unit price for each type of drainfill, complete in place. Except as otherwise specified in section 9 of this specification, such payment will constitute full compensation for all labor, equipment, material, and all other items necessary and incidental to the performance of the work.

Method 2—For items of work for which specific unit prices are established in the contract, the quantity of drainfill placed within the specified limits is computed to the nearest 0.1 ton by actual weight. Where the engineer directs placement of drainfill outside the neat lines to replace unsuitable foundation material, the weight of such drainfill is included. The weight included is only to the extent that the unsuitable condition is not a result of the contractor's improper construction operation in the determination of the engineer.

Payment for drainfill is made at the contract unit price for each type of drainfill, complete in place. Except as otherwise specified in section 9 of this specification, such payment will constitute full compensation for all labor, equipment, material, and all other items necessary and incidental to the performance of the work.

Compensation for any item of work described in the contract, but not included in the bid schedule is included in the payment for the item of work to which it is made subsidiary. Such items and the items to which they are made subsidiary are identified in section 9 of this specification.

9. Items of work and construction details

Instructions for use Construction Specification 25—Rockfill

1. Applicability

Construction Specification 25 is applicable to rockfill constructed of hard, durable rock with sufficiently open grading to drain freely. It does not apply to riprap slope protection nor to earthfill constructed of rocky soils or of soft rock that is expected to break down during compaction activities.

2. Material specifications

No material specifications complement Construction Specification 25.

3. Included items

Items to be included in contract specifications and drawings

- a. Complete plans and cross-sections of the required fills. Include any required construction tolerances measured from the lines and grades shown on the drawings.
- b. Zoning plans, including gradation requirements for material in each zone.
- c. Specifications for bedding.
- d. Pay limits where applicable.
- e. The source of each type of fill.
- f. Screening or other processing requirements.
- g. Specifications for wetting during placement and compaction, if required. If water is to be added and is to be included in the separate pay item for water, add the statement: *Water applied to the fill material will be measured and payment will be made as specified in Construction Specification 10, Water for Construction.*

- h. Class of compaction for rockfill. Specify more passes or heavier equipment if test fills or other sources of information indicate the need for it. (Class I is intended for use where the highest degree of compaction is required. Class II is intermediate, and Class III is for use where no special compaction is needed.)

When specifying Class II compaction, note in section 10 the method (a, b, or c) that applies. Note also if one or more of the methods are to be excluded.

- i. Class of compaction for bedding. Also specify more passes or heavier equipment if more than minimum amounts specified in section 8 may be needed.

4. Methods

Section 5, Placement

Method 1—Intended for use whenever the grading of materials within the fill is not a critical element of the design.

Method 2—Intended for use when the piping or cracking potential of the core zone is a critical element of the design or when the percentage of large rock is relatively low and special slope protection is desired.

5. Items of work and construction details

Starting at the top of page 25–4, prepare and outline job specific "Items of Work and Construction Details" (IWCD) in accordance with these instructions. For ease of utilization, the use of recyclable color paper for the IWCD should be considered.

Construction Specification 25—Rockfill

1. Scope

The work consists of the construction of rockfill zones of embankments and other rockfills required by the drawings and specifications, including bedding where specified.

2. Material

Material for rockfill and bedding shall be obtained from the specified sources unless otherwise specified in section 10 of this specification. The material shall be excavated, selected, processed, and handled as necessary to conform to the specified gradation requirements.

3. Foundation preparation

Foundations for rockfill shall be stripped to remove vegetation and other unsuitable material or shall be excavated as specified.

Except as otherwise specified, earth foundation surfaces shall be graded to remove surface irregularities, and test pits or other cavities shall be filled with compacted earthfill of approximately the same kind and density as the adjacent foundation material.

Rock foundation surfaces shall be cleared of all loose material not conforming to the specifications for the rockfill.

Abutments for rockfill zones of embankments shall be prepared as specified above for foundations.

Rockfill and/or bedding shall not be placed until the foundation preparation is completed and the foundation and excavations have been inspected and approved.

4. Bedding

When a bedding layer beneath rockfill is specified, the bedding material shall be spread uniformly on the prepared subgrade surfaces to the depth indicated. Compaction of the bedding material shall be as specified in section 10 of this specification.

5. Placement

Method 1—The rock shall be dumped and spread into position in approximately horizontal layers not to exceed 3 feet in thickness. It shall be placed to produce a reasonably homogeneous stable fill that contains no segregated pockets of large or small fragments or large unfilled spaces caused by bridging of the larger rock fragments.

Method 2—The rock shall be dumped and spread into position in approximately horizontal layers not to exceed 3 feet in thickness. The rock shall be placed so that the completed fill shall be graded with the smaller rock fragments placed in the inner portion of the embankment and the larger rock fragments placed on the outer slopes. Rock shall be placed to produce a stable fill that contains no large unfilled spaces caused by bridging of the larger fraction.

6. Control of moisture

The moisture content of rockfill material shall be controlled as specified in section 10 of this specification. When the addition of water is required, it shall be applied in a manner to avoid excessive wetting of adjacent earthfill. Except as specified in section 10 of this specification, control of the moisture content is not required.

The moisture content of the bedding material shall be controlled to ensure that bulking of the sand materials does not occur during compaction operations.

7. Compaction of rockfill

Rockfill shall be compacted as described below for the class of compaction specified or by an approved equivalent method.

Class I compaction—Each layer of fill shall be compacted by at least four passes over the entire surface with a steel-drum vibrating roller that weighs at least 5 tons and exerting a vertical vibrating force of not less than 20,000 pounds at a frequency not less than 1,200 times per minute.

Class II compaction—Each layer of fill shall be compacted by at least four passes over the entire surface by a track of a crawler-type tractor weighing at least 20 tons.

Class III compaction—No compaction is required beyond that resulting from the placing and spreading operations.

Heavy equipment shall not be operated within 2 feet of any structure. Vibrating rollers shall not be operated within 5 feet of any structure. Compaction by means of drop weights operating from a crane, hoist, or similar equipment is not permitted.

When compaction other than Class III compaction is specified, rockfill placed in trenches or other locations inaccessible to heavy equipment shall be compacted by manually controlled pneumatic or vibrating tampers or by equivalent methods approved by the engineer.

8. Compaction of bedding

Bedding shall be compacted according to the following requirements for the Class of compaction specified:

Class A compaction—Each layer of bedding shall be compacted to a relative density of not less than 70 percent as determined by ASTM Method D 4254.

Class I compaction—Each layer of bedding shall be compacted by at least two passes over the entire surface with a steel-drum vibrating roller weighing at least 5 tons and exerting a vertical vibrating force not less than 20,000 pounds at a frequency not less than 1,200 times per minute, or an approved equivalent method.

Class II compaction—Each layer of bedding shall be compacted by one of the following methods or by an equivalent method approved by the engineer:

- a. At least two passes over the entire surface with pneumatic rubber-tired roller exerting a minimum pressure of 75 pounds per square inch. A pass is defined as at least one passage of the roller wheel, track, tire, or drum over the entire surface of the bedding layer.
- b. At least four passes over the entire surface with the track of a crawler-type tractor weighing a minimum of 20 tons.
- c. Controlled movement of the hauling equipment so that the entire surface is traversed by a minimum of one tread track of the loaded equipment.

Class III compaction—No compaction is required beyond that resulting from the placing and spreading operations.

Heavy equipment shall not be operated within 2 feet of any structure. Vibrating rollers shall not be operated within 5 feet of any structure. Compaction by means of drop weights operating from a crane, hoist, or similar equipment is not permitted.

When compaction other than Class III is specified, bedding placed in trenches or other locations inaccessible to heavy equipment shall be compacted by manually controlled pneumatic or vibrating tampers or by equivalent methods approved by the engineer.

9. Measurement and payment

For items of work for which specific unit prices are established in the contract, the volume of each type of rockfill, including bedding, with the zone boundaries and limits specified on the drawings or established by the engineer is measured and computed to the nearest cubic yard by the method of average cross-sectional end areas.

Payment for each type of rockfill is made at the contract unit price for that type of fill. Except as otherwise specified in section 10 of this specification, such payment will constitute full compensation for all labor, equipment, material, and all other items necessary and incidental to the performance of the work including furnishing, placing, and compacting the bedding material.

Compensation for any type of work described in the contract, but not listed in the bid schedule is included in the payment for the item of work to which it is made subsidiary. Such items and the items to which they are made subsidiary are identified in section 10 of this specification.

10. Items of work and construction details

Instructions for use Construction Specification 26—Topsoiling

1. Applicability

Construction Specification 26 is applicable to the furnishing and spreading of topsoil to selected areas of the construction site for the purpose of establishing vegetative cover to minimize soil erosion and provide aesthetic improvement.

2. Material specifications

No material specifications complement Construction Specification 26.

3. Included items

Items to be included in contract specifications and drawings follow:

- a. Limits of source areas for obtaining topsoil.
- b. Limits of areas on which topsoil is to be spread.
- c. Depth of topsoil layer following the spreading operation.
- d. Limits and locations for stockpile areas, if critical.
- e. Limitation of rock sizes to be included in the topsoil to be spread.
- f. Restriction of woody vegetation that may be included in the topsoil to be spread.
- g. Note in the Measurement and payment section if the measurements will be slope measured or horizontal measurements for use in computing the area covered.
- h. Extent of compaction required for the topsoil.

4. Methods

The methods in Section 5, Spreading, and Section 6, Measurement and payment, are self-explanatory.

When progress payments are anticipated, outline in section 7 the procedures that will be implemented to determine progress amounts.

When specifications are prepared using electronic procedures and all methods but one are deleted for use in a contract specification, delete from the next to last paragraph ***All Methods*** ***The following provisions apply to all methods of measurement and payment.*** Left justify the remaining text. Also, delete from the last paragraph ***All Payment Methods.*** Left justify the remaining text.

5. Items of work and construction details

Starting at the top of page 26–3, prepare and outline job specific "Items of Work and Construction Details" (IWCD) in accordance with these instructions. For ease of utilization, the use of recyclable color paper for the IWCD should be considered.

Construction Specification 26—Topsoiling

1. Scope

The work consists of furnishing and spreading topsoil to specified depths at locations shown on the drawings.

2. Quality of topsoil

Topsoil shall consist of friable surface soil reasonably free of grass, roots, weeds, sticks, rocks, or other unsuitable material. Additional quality requirements, if any, are in section 7 of this specification.

3. Furnishing

Method 1—Topsoil shall be salvaged from designated earth surfaces that will be disturbed by construction activities. After designated sites have been cleared and grubbed, the topsoil shall be removed from the designated areas and stockpiled at locations shown on the drawings or acceptable to the engineer. Unsuitable material encountered during removal of topsoil shall be disposed of at locations shown on the drawings or approved by the engineer, or it will be otherwise hauled and disposed of at locations removed from the construction site. The contractor is responsible for complying with all local rules and regulations and the payment of any and all fees that may result from the disposal at locations outside the construction work limits.

Method 2—Topsoil shall be furnished from an offsite source designated by the contractor. The engineer shall be granted access to the source for inspection and acceptance before delivery to the site. Test results and samples shall be provided when specified in section 7 of this specification.

4. Stockpiling

Stockpiles of topsoil shall not conflict with the requirements of Construction Specification 5, Pollution Control, when made a part of this contract.

5. Spreading

Method 1—Spreading shall not be conducted when the ground or topsoil is frozen, excessively wet, or otherwise in a condition detrimental to uniform spreading operations. Surfaces designated to receive a topsoil application shall be lightly scarified just before the spreading operation.

Following the spreading operation, the topsoil surface shall be left reasonably smooth and without ruts or surface irregularities that could contribute to concentrated waterflow downslope.

Method 2—Spreading shall not be performed when the ground or topsoil is frozen, excessively wet, or otherwise in a condition detrimental to uniform spreading operations. Surfaces designated to receive a topsoil application shall be lightly scarified just before the spreading operation. Where compacted earthfills are designated to be topsoiled, the topsoil shall be placed concurrently with the earthfill and shall be bonded to the compacted fill with the compacting equipment.

Following the spreading operation, the topsoil surface shall be left reasonably smooth and without ruts or surface irregularities that could contribute to concentrated waterflow downslope.

6. Measurement and payment

Method 1—The total surface covered by topsoil is measured and the area(s) computed to the nearest square yard. Payment for furnishing and placing topsoil is made at the contract unit price.

Method 2—The total surface covered by topsoil, except the surface area of embankments, levees, dikes, and other earthfills not included for payment, is measured and the area(s) computed to the nearest square yard.

Payment for topsoil spread on the surface of embankments, levees, dikes, and other earthfills is included in the measurement and payment for that item of earthfill where topsoil application occurred.

Method 3—For items of work for which specific unit prices are established in the contract, the volume of topsoil furnished and spread is computed to the nearest cubic yard by the method of average cross-sectional end areas from surveys of the excavated topsoil stockpile or, if not stockpiled, cross-sectional surveys of the borrow area(s). Payment for furnishing and spreading topsoil is made at the contract unit price.

All methods—The following provisions apply to all methods of measurement and payment. Compensation for any item of work described in the contract, but not listed in the bid schedule is included in the payment for the item of work to which it is made subsidiary. Such items and the items to which they are made subsidiary are identified in section 7 of this specification.

All payment methods—Payment will constitute full compensation for all labor, equipment, material, and all other items necessary and incidental to the completion of the work. This includes excavating, stockpiling, hauling, spreading, and the wasting of unsuitable excavated material.

7. Items of work and construction details

Instructions for use Construction Specification 27—Diversions and Waterways

1. Applicability

Construction Specification 27 is applicable to diversion and waterway construction where the extent of earth excavation and embankment installations is considered minor.

2. Material specifications

No material specifications complement Construction Specification 27.

3. Included items

Items to be included in contract specifications and drawings follow:

- a. Location of diversion(s) and waterway(s) in plan view.
- b. Typical cross section(s) for diversion and waterway.
- c. Locations of special borrow area(s) and waste or disposal area(s), if required.
- d. Profile when structure (diversion or waterway) location is known.

- e. Clear and concise information needs to be provided in the specifications to ensure bid item integrity. This is especially true when other earthwork construction specifications are being used in the adjacent areas.
- f. Method of measurement and payment. When specifications are prepared using electronic procedures and all methods but one are deleted for use in a contract specification, delete from the last paragraph ***All Methods The following provisions apply to all methods of measurement and payment.*** Left justify the remaining text.

4. Items of work and construction details

Starting at the top of page 27-3, prepare and outline job specific "Items of Work and Construction Details" (IWCD) in accordance with these instructions. For ease of utilization, the use of recyclable color paper for the IWCD should be considered.

Construction Specification 27—Diversions and Waterways

1. Scope

The work consists of all excavations, shaping, grading, and earthfills required to construct the diversions and waterways as shown on the drawings or as staked in the field.

2. Material

The earth material used in constructing the earthfill portions of the diversions or waterways shall be suitable material obtained from required excavations or earth material obtained from designated borrow areas. Material for earthfills shall be free from frozen material, brush, roots, sod, stones over 6 inches in diameter, or other objectionable material.

3. Foundation preparation

Foundations for earthfill shall be stripped to remove vegetation and other unsuitable materials or shall be excavated as specified.

Except as otherwise specified, earth foundation surfaces shall be graded to remove surface irregularities and shall be scarified parallel to the axis of the earthfill or otherwise acceptably scored and loosened to a minimum depth of 2 inches. The moisture content of the loosened material shall be controlled as specified for the earthfill, and the surface material of the foundation shall be compacted and bonded with the first layer of earthfill as specified for subsequent layers of earthfill.

Earth abutment surfaces shall be free of loose, uncompacted earth in excess of 2 inches in depth normal to the slope and shall be at such a moisture content that the earthfill can be compacted against them to produce a good bond between the earthfill and the abutments.

4. Placement

Earthfill material shall not be placed until the required foundation preparation is complete, inspected, and approved for placement. Earthfill shall not be placed upon a frozen surface. Earthfill shall be placed in horizontal layers not exceeding 9 inches in thickness. The moisture content of the earthfill materials shall be sufficient to obtain firm and suitable compaction. Compaction shall be obtained by routing the hauling and spreading equipment over the earthfill material so that the entire surface of each layer is traversed by not less than one track tread of the loaded equipment, or equivalent methods approved by the engineer.

5. Excavation

Excavation shall be to the lines and grades shown on the drawings or as staked in the field. All surplus and unsuitable material is designated as waste and shall be disposed of at locations shown on the drawings or at a location approved by the engineer.

6. Measurement and payment

Method 1—For items of work for which specific unit prices are established in the contract, the length of waterway or diversion is determined to the nearest linear foot by measurement along the centerline of the waterway or diversion. Such payment will constitute full compensation for all labor, material, equipment, and all other items necessary and incidental to the performance of the work.

Method 2—For items of work for which specific lump sum prices are established in the contract, the quantity of waterways or diversions is not measured for payment. Payment for waterways and diversions is made at the contract lump sum price and shall constitute full compensation for all labor, material, equipment, and all other items necessary and incidental to the performance of the work.

Method 3—The pay limits for excavation and earthfill shall be as designated on the drawings. Payment for excavation and earthfill to construct the waterways and diversions is separately measured and computed to the nearest cubic yard by the method of average cross-sectional end areas. Payment for excavation and earthfill is made at the unit price bid and shall constitute full compensation for all labor, material, equipment, and all other items necessary and incidental to the performance of the work.

All methods—The following provisions apply to all methods of measurement and payment. Compensation for any item of work described in the contract, but not listed in the bid schedule is included in the payment for the item of work to which it is made subsidiary. Such items and the items to which they are made subsidiary are identified in section 7 of this specification.

7. Items of work and construction details

Instructions for use Construction Specification 28—Lime Treated Earthfill

1. Applicability

Construction Specification 28 is applicable to the treatment of clayey soils for the construction or repair of earthfills for dams, dikes, and similar engineering works using hydrated lime.

2. Material specifications

Material Specification 593, Lime, complements Construction Specification 28.

3. Included items

Items to be included in the contract specifications and drawings follow:

- a. Work limits of area to be treated and processing area.
- b. Treatment procedures or sequence of operations if different or in addition to those in this basic specification.
- c. Type of lime to be used.
- d. Rate of application of lime. This is expressed as a percentage of dry weight of the soil.
- e. Source of soil to be treated.
- f. Location and thickness of zone to be treated.
- g. Maximum layer thickness before compaction. (Refer to Instruction for use of Construction Specification 23.)
- h. Maximum layer thickness before compaction for earth backfill compacted by manually directed power tampers. (Refer to Instruction for use of Construction Specification 23.)
- i. Compaction class.
- j. Construction Specification 5, Pollution Control, shall address weather for spreading, location of work area, storage of materials, and disposal of waste materials and containers.
- k. Special equipment needed.

- l. Construction Specification 23, Earthfill, needs to be included.
- m. Measurement and payment for lime by the ton as a separate bid item.

4. Methods

Section 6, Lime application

Method 1—Intended for dry application of lime.

Method 2—Intended for the application of lime as a water slurry mix.

Section 11, Measurement and payment

Method 1—Intended for cases where pay limits can best be shown on the drawings.

Methods 2 through 5—Self-explanatory.

Methods 6 or 7—Must be used with any or all methods 1 through 5. Method 6 is intended for use when no separate payment is to be made for water. Method 7 is intended for use with Construction Specification 10, Water for construction, when the contractor is to be paid under a separate item for the water.

When specifications are prepared using electronic procedures and all methods but one are deleted from use in the contract specification, delete from the last paragraph *All Methods The following provisions apply to all methods of measurement and payment*. Left justify the remaining text.

5. Items of work and construction details

Starting at the top of page 28–5, prepare and outline job specific "Items of Work and Construction Details" (IWCD) in accordance with these instructions. For ease of utilization, the use of recyclable color paper for the IWCD should be considered.

Construction Specification 28—Lime Treated Earthfill

1. Scope

The work consists of furnishing lime, mixing lime with soil, curing, and placing the lime treated soil.

2. Material

Soil material shall be obtained from the designated area(s). The selection of the material shall be as outlined in section 12 of this specification. Soil material shall contain no frozen soil, sod, brush, roots, or other perishable material. Rock particles larger than the maximum size specified for each type of earthfill shall be removed before treatment operations.

Water shall be clean and free from injurious amounts of oil, acid, alkali, organic matter, or other deleterious substances.

Hydrated lime shall meet the requirements of Material Specification 593.

3. Equipment

All equipment necessary for the proper construction of the work shall be on the work site before the lime treatment operations start. Unless otherwise specified, mixing equipment shall include the combined use of heavy disk plows and high speed rotary mixers. Disks shall be at least 24 inches in diameter, and rotary mixers shall be capable of mixing lifts at least 9 inches thick traveling at a minimum speed of 4 miles per hour and covering a minimum width of 6 feet.

All equipment used to convey or transport lime to or on the work site shall be covered or enclosed to avoid lime dust problems.

4. Site preparation

The contractor shall prepare, mix, and cure the lime treated earth material in the area(s) shown on the drawings.

Before lime treatment operations start, the processing area used for mixing and curing shall be stripped of topsoil and graded to a relatively smooth and uniform surface.

After the area is no longer required for mixing and curing, it shall be regraded as required, disked to a depth of 4 inches, and covered uniformly with the removed topsoil.

5. Lime proportioning

The amount of lime shall be as specified in section 12 of this specification. Adjustment in the amount of lime may be required as the work progresses and shall be adjusted as requested and approved by the engineer.

6. Lime application

Lime shall not be applied when the temperature is below 40 degrees Fahrenheit or is expected to drop below 40 degrees Fahrenheit within 24 hours. Lime will not be applied during high wind conditions that hinder effective application or cause pollution by drift offsite.

Method 1—Hydrated lime shall be uniformly applied in dry form on the soil surface at a rate that will attain the specified proportioning and lightly sprinkled with water to minimize dusting and blowing.

Method 2—Hydrated lime shall be mixed with water to form a slurry before application to the soil surface. The slurry shall be a mixture of 1 ton lime to a minimum volume of 500 gallons of water. Agitation shall be accomplished through integral paddles, recirculating pumps, or a combination of these devices. The lime and water shall be maintained as a uniform mixture until application to the soil surface.

The slurry shall be uniformly applied to the soil surface at a rate that will attain the specified proportioning. The slurry shall be applied under pressure through spray bars.

7. Mixing

The soil, lime, and water shall be mixed by disking and use of rotary mixers until a uniform mixture is obtained. During initial mixing with dry lime, a minimum of two cycles of water application followed by mixing with disks and high speed rotary mixers shall be accomplished.

The depth of the lift for treatment shall be no greater than the depth that can be effectively mixed by the equipment. The cycle of watering and mixing shall continue until the soil, lime, and water are thoroughly processed to a uniform mixture without lumps of soil or lime. When mixing is complete, the water content of the mix shall not be less than standard optimum water for the soil-lime mixture, when tested in accordance with ASTM D 698, Procedure A.

After mixing, the lime treated layer shall be sealed to minimize evaporation loss, lime carbonation, and excessive wetting from rainfall or other sources. Sealing shall be accomplished by lightly compacting the surface of the treated layer with a pneumatic tire or smooth wheel roller or by other methods approved by the engineer.

The mixing of lime, soil, and water shall be completed within the same workday it is started.

8. Placement

Lime-treated earthfill shall not be placed until the required excavation and foundation preparation have been completed and the foundation has been inspected and approved by the engineer. Earthfill shall not be placed upon a frozen surface, nor shall snow, ice, or frozen material be incorporated in the earthfill.

Immediately before placement of lime-soil mixture, the subgrade shall be scarified and moistened to create a water content that allows suitable bonding of lime-soil mixture. Surface free water shall not be present during placement operations.

Lime-treated earthfill shall be placed in approximately horizontal layers. The thickness of each layer before compaction shall not exceed the maximum thickness specified in section 12 or shown on the drawings. Material placed by dumping in piles or windrows shall be spread uniformly to not more than the specified thickness before being compacted.

During placement and compaction of the lime-soil mixture, the moisture content of the material being placed shall be maintained within the specified range. The water content of the mixture at the time of placement and compaction shall not be less than standard optimum moisture when tested in accordance with ASTM D 698, Procedure A.

9. Compaction

Lime-treated earthfill shall be compacted in accordance with section 6 of Construction Specification 23, Earthfill, for the specified class.

10. Curing

The lime and soil mixture shall be cured at least 72 hours unless otherwise specified in section 12. The water content of the mixture shall be maintained at or above standard optimum water content during the curing period by sprinkling with water, remixing, and resealing.

After the required curing time has occurred and before use as earthfill, the treated material shall be thoroughly remixed. Final mixing shall be accomplished so that all nonslaked lime particles retained on the No. 4 sieve are removed. The remaining material shall have all clods reduced in size to meet the following gradation:

Minimum passing 2-inch sieve = 100 percent

Minimum passing no. 4 sieve = 60 percent

11. Measurement and payment

For items of work for which specific unit prices are established in the contract bid schedule:

- (1) The quantity of lime used for lime treatment is measured to the nearest ton by actual weight.
- (2) The volume of lime stabilized earthfill within the specified zone boundaries and pay limits shown on the drawings are measured and computed to the nearest cubic yard by the method of average cross-sectional end areas. Unless otherwise specified, no deduction in volume is made for embedded conduits and appurtenances.

The pay limits for lime-treated earthfill shall be as defined below, with the further provision that lime stabilized earthfill required to fill voids resulting from overexcavation of the foundation and/or placed outside the specified lines and grades will be included in the measurement for payment only where such placement is approved by the engineer. Such approval will only be granted for the purpose of filling overexcavation that results from the removal of unsuitable material and where placement outside the lines and grades were not a result of contractor's improper construction operations as determined by the engineer.

Method 1—The pay limits shall be as designated on the drawings.

Method 2—The pay limits shall be the measured surface of the foundation when approved for placement of lime treated earthfill and the specified neat lines of the earthfill surface.

Method 3—The pay limits shall be the measured surface of the foundation when approved for placement of lime treated earthfill and measured surface of the completed earthfill.

Method 4—The pay limits shall be the specified pay limits for excavation and specified neat lines of the earthfill surface.

Method 5—The pay limits shall be the specified pay limits for excavation and measured surface of the completed earthfill.

Method 6—Payment for the lime treated earthfill is made at the contract unit price for that type of earthfill. Such payment will constitute full compensation for all labor, material, equipment, and all other items necessary and incidental to the performance of the work including stripping topsoil, grading, and spreading topsoil over the processing area following completion of lime treated earthfill activities. No separate payment will be made for water applied to the foundation and used for preparing hydrated lime.

Method 7—Payment for lime treated earthfill is made at the contract unit price for that type of earthfill. Such payment will constitute full compensation for all labor, material, equipment, and all other items necessary and incidental to the performance of the work, including stripping topsoil, grading, and spreading topsoil over the processing area following completion of lime treated earthfill activities. It does

not include furnishing, transporting, and applying water to the foundation and earthfill material. Water applied to the foundation and earthfill material is measured and payment made as specified in Construction Specification 10, Water for Construction.

All methods—The following provisions apply to all methods of measurement and payment. Compensation for any item of work described in the contract, but not listed in the bid schedule is included in the payment for the item of work to which it is made subsidiary. Such items and the items to which they are made subsidiary are identified in section 12 of this specification.

12. Items of work and construction details

1. Applicability

Instructions for use Construction Specifications 29—Soil-Cement

Construction Specification 29 is applicable to all soil-cement fills.

2. Material specifications

The following material specifications complement Construction Specification 29:

531—Portland Cement

534—Curing Compound (for concrete)

3. Included items

Items to be included in the contract specifications and drawings follow:

- a. Complete plans and cross sections of the required soil-cement fills.
- b. Borrow areas or other sources of material. Any grading and shaping requirements of borrow areas.
- c. Soil-cement soil gradation and Atterberg limits.
- d. Cement content of the soil-cement mixture.
- e. Cement type and types of admixtures.
- f. Required pozzolan content.
- g. Allowable range of moisture content of the soil-cement mixture at the time of compaction.
- h. Compaction requirement for subgrade and soil-cement.
- i. The maximum compacted layer thickness.
- j. Pay limits where applicable.
- k. The method of curing process required. If a concrete curing compound is designated, specify type of curing compound required.
- l. Minimum capacity of the mixing plant, if applicable.
- m. Any special instructions about the use of soil material that does not have similar gradation and Atterberg limits to those tested.

- n. All surfaces that are to be bonding surfaces need to be identified (i.e., soil-cement surfaces that are to receive an overlying layer of soil-cement or concrete that requires bonding of the two materials).
- o. The minimum strength of soil-cement determined by the design investigation using available borrow materials and the cement content specified.
- p. If required, specify in section 15 the durability requirements as outlined in ASTM D 559 and D 560 to evaluate alternative design mixes as provided in section 2(b).

4. Methods

Methods in Section 5, Design of soil-cement mixture, and Section 6, Mixing, are self-explanatory.

Section 12, Protecting and curing

Method 1—An environmentally sound, economical curing process that provides either a clear or an opaque white moisture barrier.

Method 2—Provides the best environment for curing, but will most likely be the most expensive. It is suggested for small areas or to reduce shrinkage cracking to the least extent.

Method 3—Adaptable for smaller areas and offers the economy to reuse sheeting. Windy conditions may disrupt this curing method.

Section 14, Measurement and payment

Method 1—Use when cement is included in the unit price for soil-cement.

Method 2—Use when the cement is paid for as a separate unit priced item apart from the soil-cement.

Sections 5, 6, 12, and 14

When specifications are prepared using electronic procedures and all methods but one are deleted for use in a contract specification, delete from the last paragraph *All Methods. The following provisions apply to all methods of measurement and payment.* Left justify the remaining text.

5. Items of work and construction details

Starting at the top of page 29-8, prepare and outline job specific "Items of Work and Construction Details" (IWCD) in accordance with these instructions. For ease of utilization, the use of recyclable color paper for the IWCD should be considered.

Construction Specification 29—Soil-Cement

1. Scope

The work consists of furnishing, placing, compacting, and curing a mixture of soil material, portland cement, and water. The mixture shall be uniformly mixed, blended, compacted, finished, and cured as specified. It shall conform to the lines, grades, thicknesses, and cross section(s) shown on the drawings.

2. Material

Soil material shall be obtained from the required excavations or designated borrow locations and shall meet the requirements outlined in this section.

Deleterious material, such as sod, brush, or roots, shall be separated from soil material during the selection, blending, and routing operations. Rock particles larger than 2 inches in any dimension shall be removed before mixing.

Soil material, cement content, and moisture content other than those specified in section 15 may be used as approved by the engineer. Proposed alternatives must meet one of the following requirements to be considered:

- a. If the soil material to be used has gradation and Atterberg limits similar to the soils specified, the same cement content and water content shall be used. The contractor shall provide gradation and Atterberg limit test data from a qualified soil testing laboratory verifying gradation and Atterberg limits.
- b. If the soil material does not have gradation and Atterberg limits similar to the soils specified, the contractor shall provide soil-cement durability tests, moisture-density relations data, Atterberg limits, and gradation tests from a qualified soil testing laboratory. The soil-cement mix ratio and water content shall also be provided by the laboratory. As a minimum, the following durability tests shall be provided: ASTM D 559 and ASTM D 560. The moisture-density relations are to be in accordance with ASTM D 558. The tests must indicate a soil-cement of a quality equal to or exceeding the quality specified.

Portland cement shall conform to the requirements of Material Specification 531, Portland Cement, for the specified type. Mixing of different brands or types of cement is not permitted.

Portland cement shall be furnished in bags, barrels, or bulk. Bagged cement that is stored at the job site shall be used in the same order as the deliveries arrived on the site. Each shipment of bagged cement shall be handled and stored so that it may be readily distinguished from other shipments. Emptied cement bags shall be disposed of by the contractor at offsite locations selected by the contractor. Burning of emptied cement bags is permitted if identified on the burning permit as an allowable activity.

Water used in mixing or curing soil-cement shall be clean and free from injurious amounts of oil, acid, alkali, organic matter, or other deleterious substances, and shall meet the requirements for water as specified in ASTM C 94.

Pozzolanic material, when used, shall comply with the requirements of ASTM C 618 Class C or F, Specifications for Fly Ash, and Raw or Calcined Natural Pozzolan, except the loss on ignition shall not exceed 3 percent.

Curing compounds, when used, shall conform to the requirements of Material Specification 534, Concrete Curing Compound, for the type of curing compound specified. Application of the curing compound shall be in accordance with section 12 of this specification and the manufacturer's recommendations.

3. Operations of pits or stockpiles of soil material

All work required in the opening and operation of borrow areas or stockpiles shall be performed by the contractor. The borrow areas or stockpiles shall be opened in a manner to expose a near vertical face of the soil material for a suitable working depth. Exposed cut faces shall not exceed 5 feet in height without benching back if it poses a threat to construction personnel or others. The contractor shall conform to OSHA Construction Industry Standards (29 CFR Part 1926) Subpart P, Excavations, Trenching, and Shoring, during all excavation operations.

Material shall be excavated in successive vertical cuts extending across the pit or stockpile. When approved by the engineer, successive horizontal cuts on a horizontal oriented working face may be permitted in homogeneous soils. All pockets or strata of unsuitable material not meeting the quality requirements specified in Section 2, Material, shall be wasted. The method of operating the pit or stockpile and the blending of material shall be adjusted as necessary to obtain material conforming to the specifications. Upon completion of the work, the pits shall be graded and dressed to minimize erosion and to provide free drainage.

4. Foundation preparation

Before soil-cement processing commences, the subgrade placement area shall be graded, shaped, and compacted in conformance with the lines and grades shown on the drawings. The subgrade shall firmly support the construction equipment. Immediately before placement of the soil-cement, the compacted subgrade surface shall be moistened to approximately the same moisture content as specified for the soil-cement, and shall be kept moist until the soil-cement is placed.

5. Design of soil-cement mixture

The materials and proportions of the soil-cement mixture shall constitute the job-mix. After a job-mix has been approved, the source, character, or grading of the soil and the type, brand, or quantity of cement or pozzolanic material shall not be changed without prior approval of the engineer. A change in material or proportions requires the establishment of a new job-mix supported by evidence, as required for the initial job-mix, that the proposed new material and mix proportions will produce soil-cement of the strength specified.

The use of calcium chloride or other accelerants or antifreeze compounds is not permitted unless approved by the engineer.

Method 1—The contractor shall determine the mix proportions and submit the job-mix design along with the supporting test results to the engineer for approval before incorporating any of the material into the work. The brand of cement and the location of the soil material source shall be included with the job-mix design data. The mix design shall be such that the soil-cement meets or exceeds the minimum compressive strength specified. A new mix design shall be submitted for approval any time the contractor requests a change in material or a proportioning of material from that given in the approved mix design. In no case will the engineer's review and approval of a mix design relieve the contractor of responsibility to provide soil-cement meeting the contract specifications.

A maximum of 15 percent of the total weight of cement may be replaced with fly ash at a rate of 1.2 pounds of fly ash per pound of cement replaced.

Method 2—The contractor shall furnish the soil, fly ash, cement, and moisture content as specified in section 15 of this specification. During the course of the work, the engineer may adjust the job-mix proportions as needed to achieve the specified compressive strength.

All methods—The percent of cement to be used in the mix is determined by dividing the weight of cement by the oven-dry weight of the soil material.

6. Mixing

The mixing plant shall produce a mixture of soil, cement, and water that is uniform in color and at the required moisture and cement content throughout. The plant shall be equipped with measurement devices that proportion the mix in the specified quantities. Before all measurement devices are used, they shall be calibrated and certified by a qualified technician approved by the engineer. The actual quantities of the mix shall not vary more than 2 percent from the approved job-mix quantities unless otherwise approved. The moisture content shall be the percentage of moisture in the mixture at the time of compaction.

The engineer shall have full and free access to the mixing plant at all times for inspection of the plant's operation and for sampling the soil-cement mixture and its components.

Method 1—Mixing of the soil, cement (including fly ash), and water shall be accomplished in a stationary mixing plant. The plant may be either a batch type or a continuous flow type design. The plant may use either weight or volume proportioning. The scale or metering devices shall be sensitive to 1 percent of the maximum load that may be required or imposed. The mixer shall be a pugmill, revolving-blade, or rotary-drum system.

Facilities for efficiently storing, handling, and proportioning unmixed materials shall be provided at the plant.

Method 2—Mixing of the soil, cement (including fly ash), and water shall be accomplished in a truck mixer. The mixer shall meet the requirements for truck mixers contained in ASTM C 94.

Method 3—Mixing of the soil-cement shall be accomplished in place. Mixing of the soil, cement (including fly ash), and water shall be accomplished by a single or multiple transverse shaft mixer, a traveling pugmill, or similar equipment approved by the engineer. A motor grader or similar equipment is not acceptable in lieu of the mixing equipment specified.

Soil material to be mixed in place shall be formed into windrows or divided into known grid areas. If windrows are used, they shall be prepared to a known size with a sizing device. The tops of the windrows shall be flattened or slightly trenched to receive the cement.

The cement quantity necessary to meet the specified cement-to-soil ratio shall be distributed uniformly on the windrowed soil or over the prepared grid areas. After spreading, cement that has been displaced or is found to be less than that specified shall be properly adjusted or replaced before starting mixing operations.

The mixing operation shall be accomplished so that no unmixed seams of soil are between layers. Excessive streaking of the soil cement below the layer being mixed is not allowed.

All methods—The following provisions apply to all methods of mixing. The mixing time shall be controlled so that all ingredients are mixed as long as necessary to ensure a thorough, uniform, homogeneous mixture of soil, cement, pozzolanic material (if used), and water. Mixing time shall be adjusted based on tests and field determinations. Mixing time is considered as the interval between the time the cement contacts the soil and water and the time the mixture leaves the mixing unit or when the mixer speed is reduced to the agitating speed. The soil and cement shall be mixed sufficiently to prevent cement balls from forming before the water is added. The water may be applied through the mixing machine or separately by approved pressure distributing equipment.

Soil that has plastic silt or clay lumps larger than 1 inch shall be pulverized or screened out of the raw soil before mixing.

7. Transporting

The soil-cement mixture shall be transported from the mixing plant to the site of placement in vehicles having tight, clean, smooth beds or mixer trucks. Haul time shall not exceed 30 minutes.

The contractor shall protect the soil-cement mixture if transported during unfavorable weather. Any material excessively wet by precipitation is subject to rejection.

Equipment shall not be operated on a finished and compacted layer of soil-cement except where specifically permitted. Any damage resulting to the finished surface of the soil-cement from such an operation shall be repaired by the contractor at no cost to the owner.

Earth ramps crossing over completed soil-cement must have a minimum compacted thickness of 2 feet. Where ramps are constructed over soil-cement that is not to finished grade, all foreign material and the uppermost inch of the top layer of soil-cement must be removed before the soil-cement installation is continued.

8. Placement

Soil-cement shall not be placed until the required excavations and preparation of the foundation are completed and the foundation has been inspected and approved by the engineer.

Equipment for spreading the soil-cement mixture shall be suitable for the purpose and shall be operated to produce a reasonably smooth, uniform surface. The equipment shall be controllable so as to produce uniform layers not more than the specified maximum thickness. The layer of soil-cement, or each successive lift when layering is required, shall be spread and compacted as soon as possible after the preceding layer is completed and approved. Soil-cement shall be placed in horizontal layers or layers conforming to the plane of the subgrade.

When the time between completion of compaction on a layer and start of placement of the next layer is more than 2 hours, the contractor shall scarify the surface to a depth of 1 inch at a maximum spacing of 12 inches unless specified otherwise in section 15 or approved by the engineer. The contractor shall clean off the scarified surface thoroughly by power brooming or other approved methods before proceeding. The entire broomed surface shall then be thoroughly moistened before the next layer of soil-cement is placed.

Soil-cement placement operations may commence when the air temperature is not less 40 degrees Fahrenheit and a rising temperature is expected for the work period. Soil-cement shall not be placed on a frozen foundation or if the soil to be processed is frozen or if weather conditions are such that the material being processed cannot be completely compacted and protected before the onset of damaging weather (overnight lows below 40 degrees Fahrenheit, cold fronts, rainstorms). The use of accelerators or antifreeze compounds is not allowed unless otherwise specified. The temperature of fresh soil-cement shall not be allowed to drop below 32 degrees Fahrenheit for 7 days after placement. If temperatures are expected to be below 45 degrees Fahrenheit, the contractor's method for protection shall be approved by the engineer before placement of any soil-cement.

When the mean air temperature does not exceed 90 degrees Fahrenheit, the moisture content at the time of compaction shall be within the range specified. When the mean air temperature exceeds 90 degrees Fahrenheit or conditions promoting rapid drying of the soil-cement mixture exist, the moisture content of the mixture may be increased up to 2 percentage points above optimum unless otherwise specified. Any increase in moisture content shall be less than the quantity that causes the soil-cement to become unstable during the compaction and finishing operations.

9. Compaction

Equipment—Compaction equipment used shall be capable of uniformly compacting the soil-cement mixture to the specified density. It shall not have tamping feet or projections that penetrate to previously compacted layers. Compaction with only the wheels of the hauling equipment is not an acceptable method of compaction.

Compaction requirements—Soil-cement shall be uniformly compacted to a density not less than the minimum density specified. Optimum moisture and maximum density shall be determined by ASTM D 558. Natural Resources Conservation Service Test No. S-6 (USBR Test E-25), Rapid Compaction Control Method as referenced in NEH-19, may be used as equivalent to ASTM D 558.

Compaction shall start as soon as possible after spreading. Elapsed time between the addition of water to the soil-cement mixture and the start of compaction shall not exceed 60 minutes. The elapsed time between addition of water to the soil-cement mixture and completion of compaction shall not exceed 90 minutes.

Other requirements—If the surface of a layer of soil-cement has been rutted or compacted unduly by hauling or other equipment, the contractor shall scarify and recompact such surfaces within 2 hours of the addition of water to the cement. When required to maintain uniformity of the layer surface, blading in connection with compaction operations shall be employed. If blading is required, raw unmixed soil shall not be bladed onto the mixed soil-cement. When more than 2 hours has occurred from the time water was added to the cement, the damaged soil-cement shall be removed in a manner and to the extent approved by the engineer.

10. Construction joints

At the end of each workday, or when the adjacent placing operation is terminated for more than 2 hours, a vertical construction joint shall be made along all unfinished edges of the thoroughly compacted soil-cement. Just before placing operations are resumed, the construction joint shall be shaved to remove all dry soil-cement and all curing compound from the joint face.

11. Removal and replacement

The soil-cement installation shall be considered defective and shall be removed and replaced in accordance with these specifications when any one of the following conditions occur:

- a. Compaction operations are interrupted for any reason before the completion of compaction and the soil-cement mixture is left undisturbed for more than 30 minutes.
- b. The soil-cement mixture becomes excessively wet before completion of compaction so that the moisture content exceeds the specified limits.
- c. The compacted soil-cement does not meet the density and moisture requirements except that when the moisture is lower than required, the soil-cement mixture may be reworked, thoroughly mixed, and compacted within the time limits stated in section 9, Compaction requirements.
- The finished surface is rough or below grade such that a thin "scab" section would be required to smooth the surface or bring the surface to grade.

12. Protecting and curing

Moistening bonding surface

Compacted surface of soil-cement that is to receive an overlay of soil-cement or concrete shall be kept moist until placement of the overlay or adjacent layer of soil-cement or concrete. The contractor is not required to keep such surfaces moistened for longer than 7 days unless the overlay of soil-cement or concrete is not accomplished within 7 days as a result of the contractor's operations.

Curing finished exposed surface

Method 1—Concrete curing compound conforming to ASTM C 309 of the type specified shall be applied at a rate of not less than 1 gallon per 150 square feet of surface using constantly agitating, pressure spray equipment. This compound shall form a uniform, continuous, adherent film that does not check, crack, or peel.

The surface of each section of soil-cement to be treated with curing compound shall be moistened with a light spray of water immediately after the section has been compacted. As soon as the surface film of moisture disappears, but while the surface still has a damp appearance, the curing compound shall be applied. Special care shall be implemented to ensure ample coverage with the compound at edges, corners, and around rough spots. After application of the curing compound has been completed and the coating is dry to the touch, any required repair of the soil-cement surface shall be performed. To ensure a clean bonding surface, all curing compound or other foreign substances shall be removed from the area before additional soil-cement is applied. Each repair, after being finished, shall be moistened and coated with curing compound in accordance with the foregoing requirements.

Method 2—Curing moisture shall be maintained by sprinkling, flooding, fog spraying, or covering with continuously moistened canvas, cloth mats, straw, sand, or other approved material. Water or covering, or both, shall be applied so that the soil-cement surface is not eroded or otherwise damaged.

Method 3—Waterproof paper or plastic sheeting shall be used to completely cover the soil-cement and prevent moisture loss. Adjoining sheeting shall be overlapped at least 1 foot and weighted or taped to prevent moisture loss at joints. Sheeting shall be anchored sufficiently to prevent displacement by the wind.

All methods—The curing process shall be maintained for 7 days. Any curing compound that is removed from the surface or damaged within 7 days after application shall be repaired immediately. The contractor shall have all equipment and material required for curing at the site ready for use before starting soil-cement placement activities.

13. Inspection and testing

During the course of the work, the engineer will perform quality assurance tests as required to identify materials and determine compaction characteristics, moisture content, and density of soil-cement in place. Tests performed by the engineer will be used to verify that the soil-cement placed conforms to contract requirements of the specifications and not as a replacement for the contractor's quality control program.

The contractor shall conduct all required quality control tests in accordance with the approved Contractor Quality Control Plan to assure that work performed meets contract requirements.

14. Measurement and payment

For items of work for which specific unit prices are established in the contract, the quantity of soil-cement is measured within the specified limits and computed to the nearest cubic yard by the method of average cross-sectional end areas. The quantity of soil-cement required to fill voids resulting from overexcavation outside the neat lines or pay limits is included in the measurement for payment where such overexcavation is directed by the engineer to remove unsuitable foundation material, but only to the extent that the unsuitable condition is not a result of the contractor's improper construction operations, as determined by the engineer.

Method 1—Payment for soil-cement is made at the contract unit price per cubic yard. The payment will constitute full compensation for all labor, material, equipment, transportation, tools, and all other items necessary and incidental to completion of the work, but not including other items listed for payment elsewhere in the contract.

Method 2—Payment for soil-cement is made at the contract unit price per cubic yard. The payment will constitute full compensation for all labor, material, equipment, transportation, tools, and all other items necessary and incidental to completion of the work, but not including furnishing and handling cement or other items listed for payment elsewhere in the contract.

Measurement for payment of cement is made to the nearest 100 pounds by actual weight. For each load of cement delivered, the contractor shall furnish to the engineer a statement-of-delivery ticket showing the weight of the cement in the load. Payment for cement is made at the contract unit price for furnishing and handling the cement, and such payment will constitute full compensation for all material, labor, equipment, storage, transportation, and other items necessary and incidental to furnishing and handling the cement. No payment is made for cement used in wasted soil-cement, replacement of damaged or defective soil-cement, extra soil-cement required as a result of overexcavation, and excavations intentionally performed to facilitate operations.

All methods—The following provisions apply to all methods of measurement and payment. Compensation for any item of work described in the contract, but not listed in the bid schedule is included in the payment for items of work to which it is made subsidiary. Such payment and the items to which they are made subsidiary are identified in section 15 of this specification.

15. Items of work and construction details

Instructions for use

Construction Specification 31—Concrete for Major Structures

1. Applicability

Construction Specification 31 is applicable to the types of concrete construction entailed in NRCS operations where high material quality is not negotiable. Supplementary specifications are required for works of a special nature, such as:

- a. Placing concrete under water.
- b. Concrete exposed to seawater.
- c. Concrete exposed to alkali soils or alkaline water.
- d. High strength concrete using microsilica.
- e. Special finishes, such as sack rubbed, stone rubbed, and treatment with cement-based coatings.

Examples of such specifications and guides are in Standard Specifications for Highway Bridges, AASHTO, and the ACI Manual of Concrete Practice.

2. Material specifications

The following material specifications complement Construction Specification 31:

Aggregates—Specification 522, Aggregates for Portland Cement Concrete

Cement—Specification 531, Portland Cement

Fly ash—Specification 532, Mineral Admixtures for Concrete

Blast-furnace slag—Specification 532, Mineral Admixtures for Concrete

Air-entraining admixtures—Specification 533, Chemical Admixtures for Concrete

Water-reducing and/or retarding admixtures—Specification 533, Chemical Admixtures for Concrete

Plasticizing admixtures—Specification 533, Chemical Admixtures for Concrete

Accelerating and water-reducing and accelerating admixtures—Specification 533, Chemical Admixtures for Concrete

Curing compounds—Specification 534, Concrete Curing Compound

Preformed joint filler—Specification 535, Preformed Expansion Joint Filler

Sealing compound for joints—Specification 536, Sealing Compound for Joints in Concrete and Concrete Pipe

Nonmetallic waterstops—Specification 537, Nonmetallic Waterstops

Metal waterstops—Specification 538, Metal waterstops

Dowels—Specification 539, Steel Reinforcement (for concrete)

Metal—Specification 581, Metal

3. Included items

Items to be included in contract specifications and drawings follow:

- a. Complete engineering and structural detail drawings of the structure. (See Section 6, National Engineering Handbook.)
- b. Type, size, and quality of joint filler, waterstops, and metal plates.
- c. Deviations, if any, from the specified concrete temperature ranges in Section 21, Concreting in cold weather.
- d. Specify dowel size, spacing, length, and treatment of moveable dowel ends (plastic sleeve, grease). Also specify deviations, if any, from dowels specified.
- e. Deviations, if any, from specifications requiring:
 - (1) Placement of slab concrete in a single layer
 - (2) Consolidation of concrete with vibrators
- f. Section 3, Concrete mix design, method 1. Specify or consider the following items:
 - (1) Class of concrete
 - (2) Type of cement

- (3) If water-cement ratios greater than 0.50 are allowed, they must be specified in Section 25.
- (4) Any deviation from the air content and slump specified in section 3, method 1, must be specified in section 25. (The air content specified in section 3 may not be reduced for structures where the average annual minimum air temperature is below 20 degrees Fahrenheit.)
- (5) Aggregate data. Specify only the nominal maximum size of coarse aggregate and not the ASTM size designation for coarse aggregates. If Material Specification 522 does not apply, specify the applicable specification and/or the salient properties for aggregate.
- (6) Types of admixtures, if any.
- (7) Fly ash and slag considerations. Specify in section 25 if fly ash or ground blast-furnace slag is required or is not allowed in the design mix as a partial substitute for cement. Specify in section 25 if the fly ash class is restricted to either Class F or C (ASTM C 618). If fly ash or slag is not mentioned in section 25, the contractor has the option to use either fly ash (Class F or C) or slag (any grade) in the design mix under method 1, section 3.
- g. Section 3, Concrete mix design, method 2. Specify the material proportions and batch weights for the initial job mix, which includes water-cement ratio, cement type and content/cy, coarse aggregate nominal maximum size and content/cy, fine aggregate content/cy, percent air content required, slump requirements, fly ash class and content/cy (if any), slag grade and content/cy (if any), and any other admixtures that will be used.
- h. Section 9, Conveying. The hot weather limitations for nonplasticized concrete may be waived by the engineer if the concrete continues to remain within the allowable slump range and the temperature of the concrete does not exceed 90 degrees Fahrenheit. This is consistent with industry practices, but the waiver must be based on the performance of the concrete onsite, and the engineer should exercise caution and judgment when waiving the limitations.
- i. Section 10, Placing. Specify a placement plan when required. Placement plans should be considered only when complex placement and/or control is required or expected or when a high volume of concrete is involved.
- j. Section 16, Removal of forms, supports, and protective coverings.
- (1) **Strength test option.** Specify a minimum concrete compressive strength for the form removal of structure member in section 25. The designer and the government assume the risk of form removal at that designated strength.
- (2) **Cumulative time option.** Form removal time for this option is based upon the structural live load (the final inservice load the member must support) being substantially greater than the structural dead load (load of the member only) and no significant horizontal loads on the member when the forms are removed. If the structural dead load is near to or larger than the structural live load, identify in section 25 the members that require longer form removal times. (See footnote 2 for the accumulative form removal time table in the construction specification.) For walls and columns where forms may be removed quickly and may be exposed to significant horizontal loads, such as wind loads, different removal times should be specified or the Strength Test option required. (See footnote 3 for the accumulative form removal time table.) ACI 347R, Guide to Formwork for Concrete, Paragraph 3.7.2.3 may be used as a reference for removal times.

- k. Specify the finish in section 25 if a finish other than that required in sections 17 and 18 is needed, such as an architectural surface, a special finish, or other necessary restrictions. USBR Concrete Manual, Chapter VI, Sections 119 and 121 may be used as a reference for different finishes.
- l. Section 22, Concreting in hot weather. Extreme conditions for formed concrete is a matter of professional judgment on the part of the engineer. Extreme conditions for flatwork and slab construction is defined as when the evaporation rate exceeds 0.2 pound per square foot per hour. Another method that may be specified in section 25 or approved is figure 11–8, page 135, "Design and Control of Concrete," Thirteenth Edition, Portland Cement Association, 5420 Old Orchard Road, Skokie, IL 60077-1083.
- m. Section 23, Acceptance of concrete work.
- (1) **Concrete strength.** The basic premise for acceptance is the approved job mix is delivered to the structure. Strength test failing to meet the required criteria occasionally occurs although concrete strength and uniformity are satisfactory. The probabilities of a low strength test result from a job mix meeting the criteria in section 3 are:
- 9 percent chance (1 in 11) that an individual strength test will fall below f'_c
 - 1 percent chance (1 in 100) that an individual strength test will fall more than 500 pounds per square inch below f'_c
 - 1 percent chance that the average of three consecutive strength tests will fall below f'_c

Allowances should be made for such statistically expected variations in deciding whether the strength level

being produced is adequate. The criterion of an individual strength test falling more than 500 pounds per square inch below f'_c adapts well to small numbers of tests (small concrete volumes) and is the strongest indicator that something is wrong with the concrete mix. Although there is a 1 percent chance that concrete strength will not meet this criteria, verification of the in-place strength should be required if it does not meet the criteria and the contractor is required to take actions to improve the strength test averages. The criterion of the average of three consecutive tests being equal to or greater than the f'_c is a good trend indicator and not as critical as the other criterion. An occasional average below f'_c can be tolerated; however, if it occurs two or more consecutive times, consideration should be given to verifying the in-place concrete strength and requiring the contractor to take actions to improve the strength test averages.

- (2) **Structure dimensions.** Specify acceptable tolerances for the structure if the tolerances shown under Structure Dimensions affect the function, strength, or appearance of the structure.

4. Methods

Section 3, Concrete mix design

Method 1—Intended for use when strength is to be used as one of the criteria for acceptance of the concrete and the contractor is to be responsible for the mix.

Method 2—Intended for use when the engineer is to be responsible for and prescribe the concrete mix and strength will not govern acceptance from the contractor.

Section 13, Construction joints

Method 1—Intended for use in circumstances where maximum bond between old and new concrete is desired. When such joint treatment is specified, it is permissible to design horizontal construction joints as flat plane surfaces without keyways or metal plates. Method 1 is preferred for all structures that are continuously or intermittently exposed to water.

Method 2—Intended for use in circumstances where bond between old and new concrete is not a critical element.

Section 24, Measurement and payment

Method 1—Intended for use with method 1 in section 3 when the design and control of the concrete mix is the responsibility of the contractor (that is, when the compressive strength of the concrete is one of the criteria determining acceptability).

Method 2—Intended for use with method 2 in section 3 when the job mix is designed and controlled by the engineer. A bid item for cement should be included in the specification and the bid schedule.

When all methods but one are deleted for use in a contract specification, delete from the last paragraph **All Methods The following provisions apply to all methods of measurement and payment.** Left justify the remaining text.

5. Items of work and construction details

Starting at the top of page 31-21, prepare and outline job specific "Items of Work and Construction Details" (IWCD) in accordance with these instructions. For ease of utilization, the use of recyclable color paper for the IWCD should be considered.

Construction Specification 31—Concrete for Major Structures

1. Scope

The work consists of furnishing, forming, placing, finishing, and curing portland cement concrete as required to build the structures designated in section 25 of this specification.

2. Material

Aggregates shall conform to the requirements of section 25 and Material Specification 522, Aggregates for Portland Cement Concrete, unless otherwise specified.

Portland cement shall conform to the requirements of Material Specification 531, Portland Cement, for the specified type. One brand only of any type of cement shall be used in any single structure as defined in section 25.

Fly ash shall conform to the requirements of Material Specification 532, Mineral Admixtures for Concrete.

Blast-furnace slag used as a partial substitution of portland cement in concrete shall conform to the requirements of Material Specification 532, Mineral Admixtures for Concrete.

Air-entraining admixtures shall conform to the requirements of Material Specification 533, Chemical Admixtures for Concrete. If air-entraining cement is used, any additional air-entraining admixture shall be of the same type as that in the cement.

Plasticizing admixtures shall conform to the requirements of Material Specification 533, Chemical Admixtures for Concrete.

Water-reducing and/or retarding admixtures shall conform to the requirements of Material Specification 533, Chemical Admixtures for Concrete.

Accelerating and water-reducing and accelerating admixtures, if specified in section 25, shall conform to the requirements of Material Specification 533, Chemical Admixtures for Concrete.

Curing compound shall conform to the requirements of **Material Specification 534, Concrete Curing Compound**.

Preformed expansion joint filler shall conform to the requirements of Material Specification 535, Preformed Expansion Joint Filler.

Sealing compound for joints shall conform to the requirements of Material Specification 536, Sealing Compound for Joints in Concrete and Concrete Pipe.

Waterstops shall conform to the requirements of Material Specifications 537, Nonmetallic Waterstops, and 538, Metal Waterstops, for the specified kinds.

Dowels shall be a plain, round steel bar conforming to the requirements of Material Specification 539, Steel Reinforcement (for concrete).

Metal plates shall conform to the requirements of Material Specification 581, Metal, for structural quality or commercial or merchant quality steel. Structural quality shall be used only if specifically designated in the drawings or specifications.

Water used in mixing and curing concrete shall be clean and free from injurious amounts of oil, salt, acid, alkali, organic matter, or other deleterious substances.

3. Concrete mix design

Method 1

Responsibilities—The contractor is responsible for the design and proportioning of the concrete. Job mixes shall be prepared to meet the quality, consistency, and strength of concrete specified.

Submittals—At least 15 calendar days before the placement of any concrete, the contractor shall provide the engineer with full documentation to support each job mix and any admixtures to be used in the work. The contractor shall furnish test results to the engineer for each admixture showing that it meets the requirements of Material Specification 533, Chemical Admixtures for Concrete. Job mixes are reviewed and accepted or rejected by the engineer within 8 calendar days following the date of submittal. After a job mix has been accepted, neither the source, character, or gradation of the aggregates nor the type or brand of cement or admixtures shall be changed without prior notice to the engineer. Revisions or changes in a job mix that are determined to be significant by the engineer shall follow the same submittal and acceptance process as that for the initial job mix.

Design criteria—The class of concrete shall be as specified in Section 25 and in accordance with the following specified compressive strength.

Class of concrete	Specified compressive strength (f'_c) at 28 days (lb/in ²)
5000	5,000
4000	4,000
3000	3,000
2500	2,500

Maximum water-cement ratio shall be 0.50, unless otherwise specified.

Unless otherwise specified the air content (by volume) of the concrete at the time of placement shall be:

Maximum size aggregate	Air content (%)
3/8 inch to 1 inch	5 to 7
Over 1 inch	4 to 6

The consistency of all concrete shall allow it to be placed without segregation or excessive laitance. Unless otherwise specified, the slump shall be:

Type of structural section	Slump (inches)
Massive sections, pavements, footings	2 ± 1
Heavy beams, thick slabs, thick walls (>12 inches)	3 ± 1
Columns, light beams, thin slabs, thin walls (12 inches or less)	4 ± 1

Superplasticized concrete shall be a concrete mix containing either a water-reducing, high range admixture (ASTM C 494, Type F or G) at a dosage rate that reduces the quantity of water required to produce a concrete mix within the above slump range by 12 percent or more, or a plasticizing admixture (ASTM C 1017) at a dosage rate required to produce an increase in the slump of at least 2 inches more than that specified above.

A water-reducing admixture (ASTM C 494, Type F or G) and/or a plasticizing admixture (ASTM C 1017) may be added to an approved job mix without resubmittal and reapproval of the job mix if the following requirements are met:

- a. The admixture shall be introduced into the concrete mix as specified by the manufacturer and be compatible with other admixtures in the job mix.
- b. The water content shall be equal to or less than that required in the job mix without the admixture.
- c. The cement content shall be the same as that required in the job mix without the admixture.
- d. The air content shall be within the specified range.
- e. The slump shall not exceed 7.5 inches unless the contractor can demonstrate before placement that the job mix can be placed without segregation or excessive laitance at a slump greater than 7.5 inches. The concrete shall retain the increased slump for not less than 30 minutes.
- f. If the admixture is added at the job site, the slump of the concrete before the addition of the admixture shall not exceed the slump specified above for concrete that does not contain the admixture.

Calcium chloride or other corrosive accelerators shall not be used unless otherwise specified.

Fly ash may be used as a partial substitution for portland cement in an amount not greater than 25 percent (by weight) of cement in the concrete mix unless otherwise specified.

Ground granulated blast-furnace slag may be used as a partial substitution for portland cement in amounts between 25 to 70 percent (by weight) of cement in the concrete mix unless otherwise specified.

Job mix criteria—Proportioning of concrete for job mixes shall be based on the standard deviation computed from compressive strength tests of previous batch records or established by laboratory trial mixes. Unless otherwise specified a compressive strength test is the average of the compressive strengths of two standard cured cylinders prepared and tested in accordance with section 4.

For a job mix based upon the standard deviation computed from compressive strength tests of previous batch records, the previous batches shall represent similar material and conditions to those expected for the job mix and have a strength within 1 000 pounds per square inch of the specified compressive

strength (f'_c) at 28 days for the class of concrete specified. The contractor shall provide to the engineer copies of the facility's previous batching records that show the compressive strength results and the batch mix design used.

For a job mix based upon a laboratory trial mix, the trial mix shall contain the actual material to be used in the final job mix, have a slump within 0.75 inches of the maximum allowable slump, and have an air content within 0.5 percent of the maximum allowable air content. The contractor shall provide the engineer with copies of the actual compressive strength test records for the trial mix from the testing facility performing the test.

The trial job mix or previous batch records shall include the water reducing admixture when a water reducing admixture is used in a concrete mix specifically to improve the physical properties of the hardened concrete or change portions of the mix components.

In meeting strength requirements, the selected job mix proportions must produce an average strength, f'_{cr} , exceeding the specified compressive strength, f'_c , by the amount specified below.

n	s_{30}	f'_{cr}
>30	1.00 s	The larger of these
25	1.03 s	two equations:
20	1.08 s	$f'_c + 1.34 s_{30}$
15	1.16 s	$f'_c + 2.33 s_{30} - 500$
<15		$f'_c + 1,000$ for $f'_c < 3,000$ $f'_c + 1,200$ for $f'_c - 5,000$ $f'_c + 1,400$ for $f'_c > 5,000$

where:

- n = number of consecutive compressive strength tests
- s_{30} = standard deviation adjusted to 30 tests, lb/in²
- f'_{cr} = required average compressive strength, lb/in²
- f'_c = specified compressive strength of concrete, lb/in²
- s = standard deviation (lb/in²) computed as $\{[\sum(Xi-Xa)^2]/[n-1]\}^{1/2}$

where:

- Xi = individual strength test result, lb/in²
- Xa = average of n strength test results, lb/in²

Method 2

Responsibilities—The engineer is responsible for the design and proportioning of the job mix. The initial job mix will be as specified in section 25. The engineer may adjust the initial job mix proportions to establish the designated job mix. The engineer will provide the contractor with a copy of each job mix as soon as the material and proportions have been determined. After the job mix has been designated, neither the source, character, or gradation of the aggregates nor the type or brand of cement or admixtures shall be changed without prior approval of the engineer. During the course of the work, the engineer may adjust the job mix proportions and batch weights whenever necessary to meet special job conditions.

The contractor, for each class of concrete, shall be responsible for:

- a. Taking the following actions and furnishing the engineer with the following information at least 35 calendar days before any placement of concrete, unless otherwise designated:
 - (1) Select the source of aggregates and sample and test the gradations of aggregates available.
 - (2) Select the brand and type of cement.
 - (3) Select the brand of admixtures and obtain manufacturer's test data and recommendation of use.
 - (4) Identify the concrete production facility, the type of mixer, and the mixing methods that will be used.
 - (5) Provide from the concrete production facility consecutive compressive strength test records and batching records for concrete mixes that have material, proportions, and compressive strengths within 1 000 pounds per square inch of the proposed design mix.
- b. Batching at least 3 cubic yards of the initial job mix, in the presence of the engineer, for testing and evaluation not less than 30 calendar days before any placement of concrete.

4. Inspecting and testing

During the course of the work, the engineer performs quality assurance testing as required to assure the concrete meets the contract requirements. The engineer shall have free entry to the plant and equipment furnishing concrete under the contract. Proper facilities shall be provided for the engineer to inspect material, equipment, and processes, and to obtain samples of the concrete. All tests and inspections are conducted so as not to interfere unnecessarily with the manufacture, delivery, and placement of the concrete.

Any portion of a batch may be tested by the engineer for any of the purposes shown below. Samples taken for testing shall be representative of that part of the batch.

- a. Determining uniformity of the batch.
- b. Checking compliance with requirements for slump and air content when the batch is discharged over an extended period.
- c. Checking compliance of the concrete with the specifications when the whole amount being placed in a small structure, or a distinct part of a larger structure, is less than full batch.

If concrete is conveyed to the placement location by pumping or conveyor belts, the samples shall be collected at the discharge end.

When a plasticizing admixture is added to the concrete mix at the job site, slump tests are made both before the addition of the admixture to the concrete mix and after the admixture has been incorporated into the concrete mix.

The tests on concrete are performed by the following methods unless otherwise specified:

Type of test	Test method (ASTM designation)
Sampling	C 172
Slump test	C 143
Air content	C 231 or C 173
Compression test specimens	C 31 or C 42
Compressive strength testing	C 39
Unit weight	C 138
Temperature	C 1064

A strength test for concrete is the average of two standard cured concrete cylinders prepared in accordance with ASTM C 31 from the same sample of concrete and tested in accordance with ASTM C 39 at 28 days, unless otherwise specified. If one cylinder shows manifest evidence of improper sampling, molding, curing, or testing, it shall be discarded and the strength of the remaining cylinder shall then be considered the compressive strength of the concrete. Should both cylinders show such defects, the entire test shall be discarded.

If both cylinders are discarded or in-place concrete that was not sampled is in question, the in-place concrete may be sampled by coring in accordance with ASTM C 42. For core tests, these requirements shall be followed:

- a. At least three representative cores shall be taken from each area of concrete in question. If one or more of the cores shows signs of being damaged before testing, it shall be replaced by a new one.
- b. Test cores shall be prepared for testing in accordance with moisture conditioning in ASTM C 42 unless the engineer determines that the concrete in the structure will be dry under service conditions. If the concrete is determined to be dry under service conditions, the cores shall be air dried (temperature 60 °F to 80 °F and relative humidity less than 60%) for 7 days before testing and shall be tested dry.

5. Handling and measurement of material

Aggregates shall be stored or stockpiled in such a manner that separation of coarse and fine particles of each size is avoided and that various sizes do not become intermixed before proportioning. Methods of handling and transporting aggregates shall avoid contamination, excessive breakage, segregation, degradation, or intermingling of various sizes.

Unless otherwise specified, scales shall be beam type or springless dial type. They shall be accurate when static load tested to plus 0.4 percent of the total capacity of the scales. All exposed fulcrums, clevises, and similar working parts of scales shall be kept clean.

Measuring tanks for mixing water shall be of adequate capacity to furnish the maximum amount of mixing water required per batch. Tanks shall be equipped with outside taps and valves to verify their calibration unless other means are provided for readily and accurately determining the amount of water in the tank.

The quantities of each component of the concrete mix shall be measured by the following methods and to the accuracy indicated below:

Cement, fly ash, slag—Cement, except as otherwise specifically permitted, shall be measured by weight or in bags on which the weight is plainly marked. When cement, fly ash, and slag are supplied in bulk and are measured by weight, they shall be weighed on a scale separate from that used for other material and in a hopper entirely free and independent of the hopper used for weighing the aggregate. When fly ash or slag is used in the job mix, the cement and the fly ash or slag may be weighed separately or cumulatively by weighing the cement first and then adding the fly ash or slag to arrive at the composite weight. The weight of the cement and the combined weight of the cement and fly ash or slag shall be within plus or minus 1 percent of the required weight of the cementitious material. When cement is measured in bags, no fraction of a bag shall be used unless weighed.

Aggregates—Aggregates shall be measured by weight unless otherwise specifically permitted. Mix proportions shall be based on saturated, surface-dry weights. The batch weight of each aggregate shall be the required saturated, surface-dry weight corrected by the weight of surface moisture it contains. The weight of each of the specified aggregates shall be within plus or minus 2 percent of the required weight.

Mixing water—Mixing water shall consist of water added to the batch, ice added to the batch, water occurring as surface moisture on the aggregates, and water introduced in the form of admixtures. The added water shall be measured by weight or volume to an accuracy of 1 percent of the required total mixing water. Added ice shall be measured by weight. Wash water shall not be used as part of the mixing water for succeeding batches.

Admixtures—Dry admixtures shall be measured by weight. Paste or liquid admixtures shall be measured by weight or volume. The admixtures shall be within plus or minus 3 percent of the required weight or volume for each specific admixture.

6. Mixers and mixing

Mixers are either stationary parts of a central mixing plant or portable equipment, such as revolving drum truck mixers and volumetric batching/continuous mixing truck mixers. Mixers shall be capable of thoroughly mixing the concrete ingredients into a uniform mass within the specified mixing time and of discharging the mix without segregation. Each mixer or agitator shall bear a manufacturer's rating plate indicating the gross volume of the drum, the capacity of the drum or container in terms of the volume of mixed concrete, and the minimum and maximum mixing speeds of rotation of the drum, blades, or paddles. When the truck mixer is used for truck mixed concrete as described in section 6a(2) or for shrink mixed concrete as described in section 6a(3), the capacity of the drum or container in terms of the volume of mixed concrete shall not exceed 63 percent of the gross volume of the drum. When the truck mixer is used to transport central-mixed concrete as described in section 6a(1), the capacity of the drum or container in terms of the volume of mixed concrete shall not exceed 80 percent of the gross volume of the drum. The mixer shall be operated in accordance with these recommendations.

Concrete shall be uniform and thoroughly mixed when delivered to the forms in a freshly mixed and unhardened state. Variations in slump of more than 1 inch within a batch is considered evidence of inadequate mixing and shall be corrected by changing batching procedures, increasing mixing time, changing mixers, or other means. Mixing time shall be within the limits specified below unless the contractor demonstrates by mixer performance tests that adequate uniformity is obtained by different times of mixing.

No mixing water in excess of the amount called for by the job mix shall be added to the concrete during mixing or hauling or after arrival at the delivery point. Water to compensate for up to a 1-inch loss in slump may be added, not to exceed the design maximum water cement ratio. Withholding some of the mixing water until the concrete arrives on the job, then adding the remaining water and turning the mixer 30 revolutions at mixing speed is allowed to overcome transporting conditions. When loss of slump or workability cannot be offset by these measures, complete mixing shall be performed by onsite batching and mixing or by using a combination of centrally batching and transporting material to the site and adding remainder of material onsite.

Concrete may be furnished by ready-mix methods, by volumetric batching and continuous mixing at the site, or by batch mixing at the site.

a. Ready-mixed concrete

Ready-mixed concrete shall be mixed, transported, and placed in a freshly mixed and unhardened state. The contractor shall furnish the engineer a batch ticket showing amount of concrete in cubic yards, the time of loading, the time the load was discharged, the revolution counter reading at the time of loading and discharge, and the type and actual quantity of each material including all admixtures used in each batch of concrete.

Truck mixers and truck agitators shall be equipped with revolution counters by which the number of revolutions of the drum or blades may be readily verified. Ready-mixed concrete shall be mixed and delivered by one of the following methods:

- (1) Central-mixed concrete—Central-mixed concrete is mixed completely in a stationary mixer and transported to the point of delivery either in a truck agitator, a truck mixer operating at agitating speed, or nonagitating equipment.

When a truck agitator or a truck mixer is used as an agitator and transports concrete that has been completely mixed in a stationary mixer, mixing during transportation shall be at the speed designated by the manufacturer of the equipment as agitating speed. When concrete is transported in a truck mixer or truck agitator, the volume of the mixed concrete shall not exceed 80 percent of the gross volume of the drum. The total number of revolutions of the truck mixer or truck agitator shall not exceed 200 before discharge of the concrete, unless otherwise specified.

The use of nonagitating equipment to transport concrete to the site of the work is permitted only if the consistency and uniformity of the concrete as discharged at the point of delivery meet the requirements of this specification. Bodies of nonagitating hauling equipment shall be constructed so that leakage of the concrete mix, or any part thereof, does not occur. Concrete hauled in opentop vehicles shall be protected from rain and from more than 20 minutes exposure to the sun and wind when the air temperature is above 75 degrees Fahrenheit.

- (2) Truck-mixed concrete—Truck-mixed concrete is completely mixed in a truck mixer. The total volume of all ingredients to be mixed in a revolving drum truck mixer shall not exceed 63 percent of the gross volume of the drum. The concrete ingredients shall be mixed between 70 and 100 revolutions of the drum or blades at the speed designated by the manufacturer as mixing speed. Mixing in excess of 100 revolutions shall be at the speed designated by the manufacturer of the equipment as agitating speed. The total number of revolutions shall not exceed 300 before discharge of the concrete unless otherwise specified.
- (3) Shrink-mixed concrete—Shrink-mixed concrete is partly mixed at a central plant and the mixing is completed in a truck mixer. The mixing time in the central plant mixer is the minimum required to intermingle the ingredients. The volume of the mixed concrete in a truck mixer shall not exceed 63 percent of the gross volume of the truck drum. The mixing shall be completed in a truck mixer. The number of revolutions of the truck mixer drum or blades shall be between 50 and 100 revolutions at the speed designated by the manufacturer as mixing speed. Mixing in excess of 100 revolutions shall be at the speed designated by the manufacturer of the equipment as agitating speed. The total number of revolutions shall not exceed 300 before discharge of the concrete unless otherwise specified.

b. Volumetric batching and continuous mixing at the site

Volumetric batching and continuous mixing at the site is commonly referred to as mobile concrete mixers. Unless otherwise specified volumetric batching and continuous mixing at the construction site is permitted. The batching and mixing equipment shall conform to the requirements of ASTM C 685 and shall be demonstrated before placement of concrete by tests with the job mix to produce concrete meeting the specified proportioning and uniformity requirements. Concrete made by this method shall be produced, inspected, and documented in conformance with sections 6, 7, 8, 13, and 14 of ASTM C 685.

c. Batch mixing at the site

This method of batching and mixing concrete is either by batching and mixing all material onsite using paving mixers or stationary construction mixers or by using a combination of centrally batching part of the mix, transporting it to the site, and adding the rest of the material and mixing onsite.

Paving mixers or stationary construction mixers and associated transport vehicles shall be in accordance with recommended practices described in method 1 for central mixed concrete. The time for mixing a batch of concrete in the mixer drum shall be according to manufacturer's recommendations, but not less than 1 minute plus 0.25 minute for each cubic yard of concrete being mixed (8 yd³ batch = 3 minutes).

When a combination of centrally batching and transporting material to the site and adding rest of material onsite is used, the contractor shall prepare a written plan detailing how the batching and mixing of the concrete material will be accomplished and controlled. This written batching and mixing plan shall be submitted to the engineer for review and approval not less than 10 working days before the placement of concrete. The volume of the mixed concrete in a truck mixer shall not exceed 63 percent of the gross volume of the drum.

The contractor shall furnish the engineer a batching ticket for each batch of fresh concrete. The ticket shows the type, brand, and amount of cement; the type, name, and amount of each admixture; total water added to the batch, which includes free water on the aggregate; maximum size of aggregate; the type and dry weight of fine aggregate; the type and dry weight of coarse aggregate; the time of loading (the time that water was introduced to the cement); and the time the load was discharged.

7. Forms

Forms shall be of good quality wood, plywood, steel, or other approved material and shall be mortar tight. The forms and associated falsework shall be substantial and unyielding and shall be constructed so that the finished concrete conforms to the specified dimensions and contours. Form surfaces shall be smooth and free from holes, dents, sags, or other irregularities and shall be maintained in this condition throughout the work. Forms shall be coated with a nonstaining form release agent before being set into place. Acceptable tolerances for formed structure members are specified in section 23.

When a superplasticized concrete mix is used, forms shall be coated according to the manufacturer's recommendations with a form release agent that is specifically formulated for plasticized concrete. Forms shall be designed to withstand the increased pressures of the superplasticized concrete and the increased impact forces resulting from larger drop heights used in placing the superplasticized concrete.

Metal ties or anchorages that will be embedded in the concrete shall be equipped with cones, she-bolts, or other devices that permit their removal to a depth of at least 1 inch without injury to the concrete. Ties designed to break off below the surface of the concrete shall not be used without cones. If approved fiberglass or plastic form ties are used, the tie ends shall be cut flush with the finished concrete and ground smooth.

All edges that will be exposed shall be chamfered unless finished with molding tools as specified in section 18.

8. Preparation of forms and subgrade

Before placement of concrete, the forms, embedments, and subgrade shall be free of chips, sawdust, debris, water, ice, snow, extraneous oil, mortar, or other harmful substances or coatings. Any form release agent on the reinforcing steel or other surfaces required to be bonded to the concrete shall be removed.

Rock surfaces shall be cleaned by high pressure air-water cutting, sandblasting, or wire brush scrubbing, as necessary, and shall be wetted immediately before placement of concrete. The earth surface shall be firm and damp. Placement of concrete on mud, dried earth, noncompacted fill, or frozen subgrade is not permitted. All ice, snow, and frost shall be removed, and the temperature of all surfaces, including the reinforcing steel and other steel inclusions, to be in contact with the new concrete shall be no colder than 40 degrees Fahrenheit.

Items to be embedded in the concrete shall be positioned accurately and anchored firmly.

Weepholes in walls or slabs shall be formed with nonferrous material.

9. Conveying

Concrete shall be delivered to the site and discharged completely into the forms within 1.5 hours or before the drum of truck has revolved a total of 300 revolutions, whichever comes first, after the introduction of the mixing water to the cement and aggregates or the introduction of the cement to the aggregates. In hot weather or under conditions contributing to quick stiffening of the concrete, or when the temperature of the concrete is 85 degrees Fahrenheit or above, the time between the introduction of the cement to the aggregates and discharge shall not exceed 45 minutes.

Superplasticized concrete can be conveyed and placed when the temperature of the concrete is below 95 degrees Fahrenheit and the slump of the concrete remains within the allowable slump range.

The engineer can allow an appropriate extension of time when the setting time of the concrete is increased a corresponding amount by the addition of an approved admixture. In any case concrete shall be conveyed from the mixer to the forms as rapidly as practicable by methods that prevent segregation of the aggregates or loss of mortar.

10. Placing

Concrete shall not be placed until the subgrade, forms, steel reinforcement, and other embedments are inspected and approved by the engineer. For walls and columns, subsequent higher placements of concrete shall not be placed until the concrete below the new placement has gained sufficient strength to support the concrete dead load and any superimposed loads without distress. Placement sequences and timing shall consider form removal timing covered in section 16.

If a placement plan is required in section 25, concrete shall not be placed until the placement plan has been reviewed and approved by the engineer. The contractor shall have all equipment and material required for curing available at the site ready for use before placement of concrete begins.

Concrete shall be placed only in the presence of the engineer. The contractor shall give reasonable notice to the engineer before each placement. Such notice shall be far enough in advance to give the engineer adequate time to assure that the subgrade, forms, steel reinforcement, and other preparations comply with specifications. Other preparations include, but are not limited to, the concrete batching plant, mixing and delivery equipment and system, placing and finishing equipment and system, schedule of work, workforce, and heating or cooling facilities, as applicable. All deficiencies are to be corrected before concrete is delivered for placing.

Concrete shall be placed and consolidated to prevent segregation of the mix components. The concrete shall be deposited as closely as possible to its final position in the forms. It shall be worked into the corners and angles of the forms and around all reinforcement and embedded items to prevent segregation of aggregates or excessive laitance. The depositing of concrete shall be regulated so that the concrete can be consolidated with a minimum of lateral movement. Concrete placed against a sloping surface shall start at the lowest elevation and work upwards to the highest elevation.

Concrete other than architectural concrete shall not be dropped more than 5 feet vertically unless suitable equipment is used to prevent segregation. Architectural concrete shall not be dropped more than 3 feet vertically unless suitable equipment is used to prevent segregation. When a superplasticized concrete mix is used, concrete other than architectural concrete shall not be dropped more than 12 feet vertically and architectural concrete shall not be dropped more than 10 feet vertically unless suitable equipment is used to prevent segregation.

11. Layers

Slab concrete shall be placed to design thickness in one continuous layer unless otherwise specified. Formed concrete shall be placed in horizontal layers not more than 20 inches deep. Where a superplasticized concrete mix is used, formed concrete may be placed in horizontal layers not more than 5 feet deep.

Successive layers of fresh concrete between construction joints shall be placed at a rate fast enough that the preceding layer is still plastic and can be easily mixed with the fresh concrete such that seams (cold joints) or plane of weakness do not occur. If the surface of a previously placed layer of concrete has taken a set to the degree that it will not flow and mix with the succeeding layer when vibrated, the contractor shall discontinue placing concrete and shall make a construction joint according to the procedure specified in section 13. If placing is discontinued when a layer is incomplete, the ends of the incomplete layer shall be formed by a vertical bulkhead.

12. Consolidating

All concrete shall be consolidated with internal type mechanical vibrators capable of transmitting vibration to the concrete at frequencies not less than 8,000 impulses per minute, unless otherwise specified or approved before placement. Vibration shall be supplemented by spading, rodding, and hand tamping as necessary to ensure smooth and dense concrete along the form surface, in corners, and around embedded items. The contractor shall provide a sufficient number of vibrators to properly consolidate the concrete immediately after it is placed. A sufficient number of standby vibrators shall be kept onsite during the placement of concrete.

Vibration shall compact the concrete and bring it into intimate contact with the forms, reinforcing steel, and other embedded items while removing voids and pockets of entrapped air. The location, insertion, duration, and removal of the vibrators shall be such that maximum consolidation of the concrete is achieved without causing segregation of the mortar and coarse aggregate or causing water or cement paste to flush to the surface. Vibration shall be applied to the freshly deposited concrete by rapidly inserting the vibrator and slowly, in an up and down motion, removing the vibrator at points uniformly spaced at not more than 1.5 times the radius of the area visibly effected by vibration. Generally, this is at 5 to 10 seconds per foot on 14-inch spacings or less. The area visibly effected by the vibrator shall overlap the adjacent, just vibrated area. The vibrator shall extend vertically into the previously placed layer of fresh concrete by at least 6 inches at all points. This ensures effective bond between layers. In thin slabs the vibrator(s) should be sloped toward the horizontal to allow operations in a fully embedded position.

Vibration shall not be applied directly to the reinforcement steel, the forms, or other embedded items unless otherwise specified. Vibration shall not be applied to concrete that has hardened to the degree that it does not become plastic when vibrated. If surface vibrators are used, they may contact forms when consolidating thin slabs.

The use of vibrators to transport concrete in the forms or conveying equipment is not permitted.

Surface vibrators may be used to consolidate slabs 8 inches and less in thickness. Slabs more than 8 inches thick shall be consolidated with internal vibration and may be augmented through use of surface

vibrator, such as vibrating screeds, plate or grid vibratory tampers, or vibratory roller screeds. If concrete is to be consolidated using surface vibration methods, the contractor shall detail how this work is to be performed in writing to the engineer for review and approval. This report must be submitted no less than 30 calendar days before placing concrete by this method. It includes equipment selection and specifications.

13. Construction joints

Construction joints shall be made at the locations shown on the drawings unless otherwise specified or approved by the engineer. If construction joints are needed that are not shown on the drawings, they shall be placed in locations approved by the engineer.

Where a feather edge would be produced at a construction joint, as in the top surface of a sloping wall, an insert form shall be used so that the resulting edge thickness on either side of the joint is not less than twice the maximum aggregate diameter used in the concrete mix.

Nonvertical construction joints in structural elements, such as walls and columns, shall be consolidated and screeded to grade unless otherwise specified. Construction joints shall be covered and wet cured for 7 days or until concrete placement resumes unless otherwise specified.

Steel tying and form construction next to concrete in place shall not be started until the concrete has cured at least 12 hours. Before new concrete is deposited on or against concrete that has hardened, the forms shall be retightened. New concrete shall not be placed until the hardened concrete has cured at least 12 hours.

Method 1—The surface of construction joints shall be cleaned of all unsatisfactory concrete, laitance, coatings, stains, or debris by sandblasting or high-pressure air-water cutting, or both. Sandblasting can be used after the concrete has gained sufficient strength to resist excessive cutting, and high-pressure air-water cutting can be used as soon as the concrete has hardened sufficiently to prevent the jet from displacing the coarse aggregates. The surface of the concrete in place shall be cut to expose clean, sound aggregate, but not so deep as to undercut the edges of larger particles of the aggregate. After cutting, the surface shall be thoroughly washed to remove all loose material. If the surface is congested by reinforcing steel, is relatively inaccessible, has cured beyond the ability to cut with air-water blasting, or disturbing the concrete before it is hardened is considered undesirable, cleaning of the joint by air or water jets is not permitted. The sandblasting method is required after the concrete has hardened.

Immediately before new concrete is placed, all construction joints shall be wetted and standing water removed.

Method 2—The surface of construction joints shall be cleaned of all unsatisfactory concrete, laitance, coatings, stains, or debris by washing and scrubbing with a wire brush or wire broom, or by other means approved by the engineer. Immediately before new concrete is placed, all construction joints shall be wetted and standing water removed.

14. Expansion and contraction joints

Expansion and contraction joints shall be made only at locations shown on the drawings. Exposed concrete edges at expansion and contraction joints shall be carefully tooled or chamfered, and the joints shall be free of mortar and concrete. Joint filler shall be fully exposed for its entire length with clean and true edges.

Where open joints or weakened plane "dummy" joints are specified, joints formed in fresh concrete shall be constructed by the insertion and subsequent removal of a wood strip, metal plate, or other suitable template. This will be done so that the corners of the concrete do not chip or break. The edges of the fresh concrete at

the joints shall be finished with an edging tool before the joint strips are removed. Open joints or weakened plane dummy joints may also be sawcut joints conforming to the depth and extent specified.

Preformed expansion joint filler shall be held firmly in the correct position as the concrete is placed.

15. Waterstops

Waterstops shall be held firmly in the correct position as the concrete is placed. Joints in metal waterstops shall be brazed or welded. Joints in rubber or plastic waterstops shall be cemented, welded, or vulcanized as recommended by the manufacturer. Joints shall be watertight and of a strength equivalent to that specified in Material Specification 537. Intersecting waterstop joints shall be prefabricated and supplied by the same manufacturer providing the waterstop.

16. Removal of forms, supports, and protective coverings

Forms, supports, and protective coverings shall be removed as soon as practical after the concrete has gained sufficient strength to support its own weight and superimposed loads. Removal shall be done so that the concrete surface is not damaged and sudden or excessive stresses are not induced. The minimum period from completion of the concrete placement to the removal of the forms shall be based on either strength tests or cumulative times.

Strength tests—The strength of the in-place concrete is determined by testing concrete cylinders specifically cast for this purpose and cured adjacent to the member in accordance with the ASTM C 31 method for determining removal time. Unless otherwise specified, forms supporting the weight of the concrete member may be removed after the concrete strength is 70 percent of that specified for the class of concrete. Forms not supporting the weight of the concrete member or other superimposed loads may be removed after the concrete strength has reached the strength specified in section 25.

Cumulative time—The total accumulated time, not necessarily continuous, that the air adjacent to the concrete is above 50 degrees Fahrenheit and the specified concrete curing has occurred concurrently will be determined. Forms may be removed after the total accumulated time shown:

Accumulated form removal times

Forms		Time ^{1/}
Sides of slabs or beams		12 hours
Undersides of slabs or beams	Clear span	^{2/}
	< 10 ft	4 days
	10 - 20 ft	7 days
	> 20 ft	14 days
Sides of walls or columns	Height above form	^{3/ 4/}
	< 10 ft	12 hours
	< 20 ft	24 hours
	> 20 ft	72 hours

1/ Table values apply to normal concrete. Values for concrete that contains cements or admixtures that significantly retard or accelerate strength gain will be determined by the engineer and based on actual design mix data.

2/ Values apply to members designed to support significant superimposed loads. Values for members designed for only self weight when placed in service shall be 50 percent greater.

3/ Values apply to members not subject to significant horizontal loads. Additional time or rebracing is needed for members subject to significant wind or other horizontal loads.

4/ Subsequent higher lifts may be placed after 12 hours.

17. Finishing formed surfaces

All formed concrete surfaces shall be true and even, and shall be free from overtolerance depressions, holes, projections, bulges, or other defects in the specified surface finish or alignment, unless otherwise specified in section 25. Depressions are measured as the distance from the bottom of a 5-foot-long template or straight edge.

A surface to be backfilled or otherwise concealed when construction is completed shall have the following surface treatment unless otherwise specified:

- Repair defective concrete.
- Fill all form tie holes.
- Correct surface depressions deeper than 1 inch.
- Remove or smooth fins and abrupt projections that exceed 0.75 inch.

A surface to be permanently exposed, where other finishes are not specified, shall have the following treatment:

- Repair defective concrete.
- Fill all form tie holes.
- Remove or smooth all abrupt irregularities greater than 0.25 inch in depth or projection.
- Treat all depressions and irregularities so that they do not exceed 0.5 inch in depth.

Form bolt and tie holes and other holes of similar size and depth shall be repaired and filled as specified in section 20.

18. Finishing unformed surfaces

All exposed surfaces of the concrete shall be accurately screeded to grade and then float finished unless otherwise specified. The float finish shall result in a surface that has no irregularities of more than 0.25 inch when checked with a template or straight edge that is 10 feet long.

All exposed surfaces of concrete shall be accurately struck off to grade after placement and consolidation are completed. Following strikeoff, the surface shall be immediately smoothed by darbying or bull floating before any free water has bled to the surface. The concrete shall then be allowed to rest until the bleed water and water sheen have left the surface and the concrete has stiffened to where it will sustain foot pressure with only about 0.25-inch indentation. At this time all joints and edges that are exposed to view and are not chamfered shall be finished with edging tools. After edging and hand jointing is complete, all exposed surfaces shall be floated with wood or magnesium floats. The floating should work the concrete no more than necessary to remove screed, edger, and jointer marks and to produce a compact surface uniform in texture.

Water shall not be sprinkled or added to the surface of the concrete during the darbying, bull floating, floating, or other finishing operations to facilitate finishing.

19. Curing

Freshly placed concrete shall be cured a minimum of 7 days in accordance with the recommended practices set forth in this section. A curing process shall be started as soon as the concrete has hardened sufficiently to prevent surface damage. Curing concrete, including exposed surfaces of formed concrete and concrete in forms, shall be maintained at a satisfactory moisture content for at least 7 days following

placement. If forms are removed before the end of the 7-day curing period, the interrupted curing process shall be reestablished and maintained until a full 7-day curing period is achieved. A satisfactory moisture condition is:

- Continuous or frequent application of water or use of a saturated cover material, such as canvas, cloth, burlap, earth, or sand.
- Prevention of excessive water loss from the concrete by use of an impermeable coating (curing compound) or covering (plastic, paper).

The application of water or covering shall not erode, mar, or otherwise damage the concrete. Plastic film or paper shall meet the requirements of ASTM C 171. Black covering shall not be used when concreting in hot weather.

Except as otherwise specified in section 25, curing compound may be used for exposed surfaces or formed surfaces after patching and repair are completed. Unless otherwise specified, the curing compound shall be white pigmented and conform to ASTM C 309, Type 2, Class A or B. Clear curing compound (Type 1) or clear with fugitive dye (Type 1-D) may be used only when specified in section 25. Curing compounds shall not be used on a surface that is to receive additional concrete, paint, tile, or other coatings unless the contractor demonstrates that the membrane can be satisfactorily removed or can serve as a base for the later application.

Curing compound shall be thoroughly mixed before applying and be agitated during application. Except as otherwise specified in section 25, the compound shall be applied at a pressure of 75 to 100 pounds per square inch. A continuously agitating pressure sprayer is used for application at a uniform rate of not less than 1 gallon per 175 square feet of surface. Manual hand pump sprayers shall not be used unless otherwise specified. For individual concrete placements or repairs having a surface area of 400 square feet or less, curing compound may be applied with a soft-bristled brush, paint roller, or hand sprayer. The compound shall form a uniform, continuous, adherent film that shall not check, crack, or peel and shall be free from pinholes or other imperfections.

All surfaces covered with curing compound shall be continuously protected from damage to the protective film during the required curing period.

A surface subjected to heavy rainfall or running water within 3 hours after the compound has been applied or that is damaged by subsequent construction operations during the curing period shall be resprayed in the same manner as for the original application.

Water for curing shall be clean and free from any substances that cause discoloration of the concrete.

20. Concrete patching, repair or replacement

Patching—All form bolts, metal ties, and similar forming restraints shall be removed to a depth of 1 inch below the surface of the concrete and their cavities repaired unless otherwise specifically permitted or specified. Small cavities, large air holes, minor honeycombed areas, and other superficial imperfections that require patching to meet the specified finish requirements shall be thoroughly cleaned and filled. Holes left by bolts or straps that pass through the concrete section shall be filled solid with a dense, well-bonded, nonshrink patching material. Dry-pack mortar and replacement concrete shall follow the appropriate procedure detailed in the Repair and Maintenance chapter of the Concrete Manual, Bureau of Reclamation, U.S. Department of the Interior. Proprietary patching material shall be appropriate for the type of repair, used within the manufacturer's recommended limits, and applied according to the manufacturer's recommendations.

Repair or replacement—The contractor shall repair or replace concrete that does not meet the requirements of this specification. Before starting any repair or replacement work, the contractor shall prepare a written plan for the repair or replacement. The primary reference for material and repair methods for the plan shall be the appropriate sections of the Repair and Maintenance chapter of the Concrete Manual, Bureau of Reclamation, U.S. Department of the Interior. The repair plan shall be submitted to the engineer for review at least 10 days before any repair or replacement work. Approval of the plan will be authorized in writing by the contracting officer.

When proprietary patching material is proposed in the plan, the manufacturer's data sheets and written recommendations shall be included in the plan.

Repair material or replacement concrete shall have properties, color, and texture similar to and compatible with the concrete being repaired or replaced. Repair or replacement concrete work shall be performed only when the engineer is present.

Curing of repaired or replaced concrete shall be started immediately after finish work is completed and as specified in section 19 or as specified by the manufacturer of proprietary compounds.

21. Concreting in cold weather

Methods for concreting in cold weather shall be performed when, for more than 3 consecutive days, the following conditions exist:

- The average daily air temperature at the job site is less than 40 degrees Fahrenheit. (The average daily air temperature is the average of the highest and lowest temperatures occurring during the period from midnight to midnight.)
- The air temperature at the job site is not more than 50 degrees Fahrenheit for more than half of any 24-hour period.

Concrete shall be protected against freezing during the first 24 hours after placement whether or not the average weather conditions specified above for cold weather concreting exist. The following provisions also shall apply unless otherwise specified:

- a. When the cement is added to the mix, the temperature of the mixing water shall not exceed 140 degrees Fahrenheit nor shall the temperature of the aggregate exceed 150 F.
- b. The temperature of the concrete at the time of placing shall be within the placement temperature range shown below, unless otherwise specified.

Least dimension of section, inches	Placement temperature, °F
Less than 12	55 – 75
12 to 36	50 – 70
36 to 72	45 – 65
Greater than 72	40 – 60

- c. The minimum temperature of the concrete for the first 72 hours after placement shall not be less than the minimum temperature shown above. Concrete structures shall be immediately protected after concrete placement by covering, housing, insulating, or heating concrete structures sufficiently to maintain the minimum temperature adjacent to the concrete surface. If the minimum temperature requirements are not met and the concrete did not freeze, the protection time will be extended a period equal to twice the number of hours the temperature was below the minimum temperature.

- d. Exhaust flue gases from combustion heaters shall be vented to the outside of the enclosure. The heat from heaters and ducts shall be directed in such a manner as to not overheat or dry the concrete in localized areas or to dry the exposed concrete surface.
- e. At the end of the protection period, the concrete shall be allowed to cool gradually. The maximum decrease at the concrete surface in a 24-hour period shall not exceed 40 degrees Fahrenheit.

22. Concreting in hot weather

Methods for concreting in hot weather shall be in accordance with the requirements set forth below.

For the purpose of this specification, hot weather is defined as any combination of the following conditions that impair the quality of freshly mixed or hardened concrete by accelerating the rate of moisture loss and rate of cement hydration, or otherwise resulting in detrimental results:

- High ambient temperature
- High concrete temperature
- Low relative humidity
- Wind velocity
- Solar radiation

Whenever the above conditions exist or when climatic conditions are such that the temperature of the concrete may reasonably be expected to exceed 90 degrees Fahrenheit at the time of delivery to the worksite or during the placement operations, the following provisions shall apply:

- a. The contractor shall maintain the temperature of the concrete below 90 degrees Fahrenheit during mixing, conveying, and placing.
- b. Exposed concrete surfaces that tend to dry or set too rapidly shall be continuously moistened using fog sprays or other means to maintain adequate moisture during the time between placement and finishing. Water shall not be sprinkled or added directly to the surface of the concrete before finishing.
- c. Finishing of slabs and other exposed surfaces shall be started as soon as the condition of the concrete allows and shall be completed without delay. Water shall not be sprinkled or added to the surface of the concrete during the darbying, bull floating, floating, or other finishing operations to facilitate finishing.
- d. Formed surfaces shall be kept completely and continuously wet from the time the concrete takes initial set to when the forms are removed. After the forms are removed, the concrete surfaces shall be kept completely and continuously wet for the duration of the curing period or until curing compound is applied in accordance to section 21.
- e. Exposed and unformed concrete surfaces, especially flat work placed with large areas of surface, shall be kept completely and continuously wet for the duration of the curing period or until curing compound is applied in accordance to section 19. The concrete shall be protected against thermal shock from rapid cooling (5 °F per hour or more than 40 °F per 24-hour period) of the concrete by application of curing water or temperature changes during the first 24 hours of the curing period.
- f. When any single or combination of conditions may result in very rapid setting or drying of the concrete, extreme conditions exist. For flat work and slab construction, extreme conditions exist when the evaporation rate exceeds 0.2 pound per square foot per hour. The engineer may:
 - (1) Restrict placement to the most favorable time of the day.
 - (2) Restrict the depth of layers to assure coverage of the previous layer while it will still respond readily to vibration.
 - (3) Suspend placement until conditions improve.
 - (4) Restrict the removal of forms, repair, and patching to small areas that can be protected with curing compound immediately.

The evaporation rate for flat work and slab construction may be determined by calculating the evaporation rate from a shallow cake pan having a surface area of at least 1 square foot or by other methods approved by the engineer or designated in section 25.

23. Acceptance of the concrete work

Acceptance of the concrete work will be a cumulative acceptance process based upon progressively meeting the requirements of the specifications and drawings for:

- Fresh concrete
- Concrete strength and durability
- Structure dimensions
- Structure appearance

Fresh concrete—Fresh concrete conforming to the mix proportions and quality requirements of the approved job mix and the handling and placement requirements of previous sections will be satisfactory.

Concrete strength—A strength test is the average of the compressive strengths of two standard cured cylinders prepared and tested in accordance with section 4, unless otherwise specified. The strength of the hardened concrete is satisfactory if the following requirements are met:

- a. If method 1 from section 3 is specified and the concrete work is less than 75 total cubic yards for the class of concrete specified, the compressive strength of the concrete is satisfactory if no individual strength test falls more than 500 pounds per square inch below the specified compressive strength (f'_c) for the respective class of concrete.
- b. If method 1 from section 3 is specified and the concrete work is 75 total cubic yards or more for the class of concrete specified, the compressive strength of the concrete is satisfactory if both of the following requirements are met:
 - (1) No individual strength test falls more than 500 pounds per square inch below the specified compressive strength (f'_c) for the class of concrete specified.
 - (2) The average of any three consecutive strength tests is not less than the specified compressive strength (f'_c) two or more consecutive times for the class of concrete specified.The contractor shall take steps to increase the average of subsequent strength tests when the average of any three consecutive strength tests falls below the specified concrete strength (f'_c).
- c. The engineer determines the structural adequacy and evaluates the durability of the in-place concrete when the concrete strength based on the standard cured concrete cylinders is unsatisfactory. The engineer determines the need for additional quality assurance testing.
- d. The contractor may core the concrete, have the cores tested by a certified testing laboratory at the contractor's expense, and submit test results to the engineer for consideration and evaluation of concrete strength adequacy when the concrete strength based on the standard cured concrete cylinders is unsatisfactory.
- e. Sampling and testing concrete by coring shall conform to section 4. The strength of the concrete based upon concrete cores is satisfactory if both of the following requirements are met:
 - (1) The average compressive strength of the three cores equal or exceed 85 percent of the specified compressive strength (f'_c).
 - (2) The compressive strength of any individual core does not fall below 75 percent of the specified compressive strength (f'_c).
- f. If method 2 from section 3 is specified, the engineer is responsible for the concrete job mix design and the quality concrete that results from the job mix.

The hardened concrete is satisfactory if the required batch tickets or other documentation acceptable to the engineer clearly show that the batch ingredients and weights of each ingredient including all admixtures conforms to the job mix provided by the engineer. Random periodic inspection of the batching operations may be made by the engineer to verify that ingredients and ingredient proportions conform to the batching documentation.

If the concrete ingredients, proportions, or admixtures varies from the job mix provided by the engineer, the concrete may be rejected if, in the judgment of the engineer, the variance will significantly affect the strength or durability of the concrete or will adversely affect the life expectancy or other components of the structure.

Structure dimensions and appearance

The appearance of the concrete shall meet the requirements of sections 17 and 18.

The dimensions of formed members, unless otherwise specified, are satisfactory if they conform to the requirements of the specifications, the locations shown on the drawings, and are within acceptable tolerances:

- a. Variation from plumb for walls and column shall be not more than 0.2 percent of the wall or column height.
- b. Variation from specified elevations for slabs, floors, or other horizontal members shall be not more than 0.2 percent of the length of the member in the direction of grade.
- c. Variations in the cross-sectional dimensions of columns and beams and in the thickness of walls and above-grade slabs shall not be more than minus 0.25 inch or plus 0.5 inch from the shown dimensions.

24. Measurement and payment

For items of work for which specific unit prices are established in the contract, concrete is measured to the neat lines or pay limits shown on the drawings, and the volume of concrete is computed to the nearest 0.1 cubic yard. No deduction in volume is made for chamfers, rounded or beveled edges, or for any void or embedded item that is less than 5 cubic feet in volume. Where concrete is placed against the sides or bottom of an excavation without intervening forms, drainfill, or bedding, the volume of concrete required to fill voids resulting from overexcavation outside the neat lines or pay limits is included in the measurement for payment where such overexcavation is directed by the engineer to remove unsuitable foundation material. However, this payment is only to the extent that the unsuitable condition is not a result of the contractor's improper construction operations, as determined by the engineer.

Method 1—Payment for each item of concrete is made at the contract unit price for that item. The payment for concrete will constitute full compensation for completion of the concrete work, including joint fillers, waterstops, dowels or dowel assemblies, and metal plates, but not including reinforcing steel or other items listed for payment elsewhere in the contract.

Method 2—Payment for each item of concrete is made at the contract unit price for that item. The payment for concrete constitutes full compensation for completion of the concrete work, including joint fillers, waterstops, metal plates, dowels, and other assemblies. It does not include furnishing and placing reinforcing steel or furnishing and handling cement or other items listed for payment elsewhere in the contract.

Cement is measured by dividing the volume of concrete accepted for payment by the yield of the applicable job mix. The yield is determined by the procedure specified in ASTM C 138. If the amount of cement actually used per batch exceeds the amount in the job mix specified by the engineer, the measurement is based on the amount of cement specified by the engineer for the job mix. Unless otherwise

stated in section 25, a bag of cement is considered 94 pounds. Payment for each type of cement will be made at the contract unit price for furnishing and handling that type of cement and such payment will constitute full compensation for furnishing and handling the cement.

All methods—The following provisions apply to all methods of measurement and payment. Compensation for any item of work described in the contract, but not listed in the bid schedule, will be included in the payment for the item of work to which it is made subsidiary. Such items and the items to which they are made subsidiary are identified in section 25 of this specification.

25. Items of work and construction details

Instructions for use Construction Specification 32—Structure Concrete

1. Applicability

Construction Specification 32 is applicable for the installation of low and moderate hazard structures, where the quantity of concrete is generally 75 cubic yards or less per structure, and where the location of the structure will allow economical maintenance or replacement.

2. Material specifications

The following material specifications complement Construction Specification 32:
522—Aggregates for Portland Cement Concrete
531—Portland Cement
532—Mineral Admixtures for Concrete
533—Chemical Admixtures for Concrete
534—Concrete Curing Compound
535—Preformed Expansion Joint Filler
537—Nonmetallic Waterstops
538—Metal Waterstops

When local aggregates do not conform to the requirements of Material Specification 522, but are known to produce concrete of adequate quality, reference to Interim Standard Material Specification is permissible, or requirements may be stated in the construction details in section 24.

3. Included items

Items to be included in contract specifications and drawings follow:

- a. Class of concrete.
- b. Type, size and quantity of joint filler, waterstop, and any other items to be embedded.
- c. Type of cement.
- d. Specify in section 24 if fly ash or ground blast-furnace slag is required or is not allowed in the design mix as a partial substitute for cement.
- e. Nominal size of coarse aggregate; or specifications for aggregate if Material Specification 522 does not apply.
- f. Type of admixtures, if any.
- g. Special slump and air content requirements, if applicable.
- h. Include a statement if volumetric batching and continuous mixing are not permitted.
- i. Special type of finish or coating of finished surfaces.
- j. Note in section 24 any other deviations from the basic specifications.
- k. Describe method of measurement and payment if it differs from the methods listed in section 23.

4. Items of work and construction details

Starting at the top of page 32–7, prepare and outline job specific "Items of Work and Construction Details" (IWCD) in accordance with these instructions. For ease of utilization, the use of recyclable color paper for the IWCD should be considered.

Construction Specification 32—Structure Concrete

1. Scope

The work shall consist of furnishing, forming, placing, finishing, and curing portland cement concrete as required to build the structures described in section 24 of this specification.

2. Material

Aggregates shall conform to the requirements of Material Specification 522, Aggregates for Portland Cement Concrete, unless otherwise specified. The grading of coarse aggregates shall be as specified in section 24.

Portland cement shall conform to the requirements of Material Specification 531, Portland Cement, for the specified type.

Fly ash shall conform to the requirements of Material Specification 532, Mineral Admixtures for Concrete.

Air-entraining admixtures shall conform to the requirements of Material Specification 533, Chemical Admixtures for Concrete. If air-entraining cement is used, any additional air-entraining admixture shall be of the same type as that in the cement.

Water reducing and/or retarding admixtures shall conform to the requirements of Material Specification 533, Chemical Admixtures for Concrete.

Curing compound shall conform to the requirements of Material Specification 534, Concrete Curing Compound.

Preformed expansion joint filler shall conform to the requirements of Material Specification 535, Preformed Expansion Joint Filler.

Waterstops shall conform to the requirements of Material Specifications 537, Nonmetallic Waterstops, and 538, Metal Waterstops, for the specified kinds.

Water used in mixing and curing concrete shall be clean and free from injurious amounts of oil, salt, acid, alkali, organic matter, or other deleterious substances.

3. Class of concrete

Concrete for structure concrete shall be classified as follows:

Class of concrete	Maximum net water content (gal/bag)	Minimum cement content (bags/yd ³)
3000M	6	5.5
4000M	6	6

4. Air content and consistency

Unless otherwise specified, the slump shall be 3 to 5 inches. If air entrainment is specified, the air content, by volume, shall be 4 to 7 percent of the volume of the concrete. When specified, directed, or approved by the engineer, a water-reducing, set-retarding, or other admixture shall be used. High range, water reducing agents (superplasticizers) may be used to increase workability, reduce water content, and control concrete temperature in hot weather. The maximum slump after adding high range water reducing agents shall be 7.5 inches.

5. Design of the concrete mix

The proportions of the aggregates shall be such as to produce a concrete mixture that works readily into the corners and angles of the forms and around reinforcement when consolidated, but does not segregate or exude free water during consolidation.

Fly ash may be used as a partial substitution for portland cement in an amount of no more than 25 percent (by weight) of the cement in the concrete mix, unless otherwise specified.

Before the concrete is placed, the contractor shall furnish the contracting officer, for approval, a statement of the materials and mix proportions (including admixtures, if any) intended for use. The statement shall include evidence satisfactory to the contracting officer that the materials and proportions will produce concrete conforming to this specification. The materials and proportions so stated shall constitute the "job mix." After a job mix has been approved, neither the source, character, or grading of the aggregates nor the type or brand of cement or admixture shall be changed without prior notice to the contracting officer. If such changes are necessary, no concrete containing such new or altered material shall be placed until the contracting officer has approved a revised job mix.

6. Inspection and testing

The engineer shall have free entry to the plant and equipment furnishing concrete under the contract. Proper facilities shall be provided for the engineer to inspect materials, equipment, and processes and to obtain samples of the concrete. All tests and inspections will be conducted so as not to interfere unnecessarily with manufacture and delivery of the concrete.

7. Handling and measurement of material

Materials shall be stockpiled and batched by methods that prevent segregation or contamination of aggregates and ensure accurate proportioning of the ingredients of the mix. Except as otherwise provided in section 8, cement and aggregates shall be measured as follows:

Cement shall be measured by weight or in bags of 94 pounds each. When cement is measured in bags, no fraction of a bag shall be used unless weighed.

Aggregates shall be measured by weight. Mix proportions shall be based on saturated, surface-dry weight. The batch weight of each aggregate shall be the required saturated, surface-dry weight plus the weight of surface moisture it contains.

Water shall be measured, by volume or by weight, to an accuracy within 1 percent of the total quantity of water required for the batch.

Admixtures shall be measured within a limit of accuracy of 3 percent.

8. Mixers and mixing

Concrete shall be uniform and thoroughly mixed when delivered to the work site. Variations in slump of more than 1 inch within a batch are considered evidence of inadequate mixing and shall be corrected by increasing mixing time or other acceptable alternative.

For stationary mixers, the mixing time after all cement and aggregates are in the mixer drum shall be not less than 1.5 minutes. When concrete is mixed in a truck mixer, the number of revolutions of the drum or blades at mixing speed shall be not less than 70 nor more than 100.

Unless otherwise specified, volumetric batching and continuous mixing at the construction site are permitted. To produce concrete meeting the specified proportioning and uniformity requirements, the batching and mixing equipment shall conform to the requirements of ASTM Specification C 685 and shall be demonstrated by tests with the job mix before the concrete is placed. Concrete made by this method shall be produced, inspected, and certified in conformance with sections 6, 7, 8, 13, and 14 of ASTM Specification C 685.

No mixing water in excess of the amount called for by the job mix shall be added to the concrete during mixing or hauling or after arrival at the delivery point.

9. Forms

Forms shall be of wood, plywood, steel, or other approved material and shall be mortar tight. The forms and associated falsework shall be substantial and unyielding and shall be constructed so that the finished concrete will conform to the specified dimensions and contours. Form surfaces shall be smooth and free from holes, dents, sags, or other irregularities. Forms shall be coated with a nonstaining form release agent before being set into place.

Metal ties or anchorages within the forms shall be equipped with cones, she-bolts or other devices that permit their removal to a depth of at least 1 inch without injury to the concrete. Ties designed to break off below the surface of the concrete shall not be used without cones.

All edges that will be exposed to view when the structure is completed shall be chamfered, unless finished with molding tools as specified in Section 18.

10. Preparation of forms and subgrade

Prior to placement of concrete, the forms and subgrade shall be free of chips, sawdust, debris, water, ice, snow, extraneous oil, mortar, or other harmful substances or coatings and the temperature of all surfaces to be in contact with the new concrete shall be not be less than 40 degrees Fahrenheit. Any oil on the reinforcing steel or other surfaces required to be bonded to the concrete shall be removed. Rock surfaces shall be cleaned by air-water cutting, wet sandblasting, or wire brush scrubbing, as necessary, and shall be wetted immediately before placement of concrete. The earth surface shall be firm and damp. Placement of concrete on mud, dried earth, or uncompacted fill or frozen subgrade is not permitted.

Items to be embedded in the concrete shall be positioned accurately and anchored firmly.

Weepholes in walls or slabs shall be formed with nonferrous material.

11. Conveying

Concrete shall be delivered to the site and discharged into the forms within 1-1/2 hours after the introduction of the cement to the aggregates. In hot weather or under conditions contributing to quick stiffening of the concrete, the time between the introduction of the cement to the aggregates and discharge shall not exceed 45 minutes.

The engineer may allow a longer time, provided the setting time of the concrete is increased a corresponding amount by the addition of an approved set-retarding admixture. In any case, concrete shall be conveyed from the mixer to the forms as rapidly as practicable by methods that prevent segregation of the aggregates and assure no loss of mortar occurs.

12. Placing

Concrete shall not be placed until the subgrade, forms, steel reinforcement, and embedded items have been inspected and approved. No concrete shall be placed except in the presence of the engineer. The contractor shall give reasonable notice to the engineer each time concrete is to be placed. Such notice shall provide sufficient time for the engineer to inspect the subgrade, forms, steel reinforcement, and other preparations for compliance with the specifications. Other preparations include, but are not limited to, the concrete mixing plant; delivery equipment system; placing, finishing, and curing equipment and system; schedule of work; workforce; and heating or cooling facilities, if applicable. Deficiencies are to be corrected before concrete is delivered for placing.

The concrete shall be deposited as closely as possible to its final position in the forms. It shall be worked into the corners and angles of the forms and around all reinforcement and embedded items in a manner to prevent segregation of aggregates or excessive laitance. Formed concrete shall be placed in horizontal layers not more than 20 inches thick. Concrete shall not be dropped more than 5 feet vertically unless suitable equipment is used to prevent segregation. When high range water reducing agents are used, the concrete shall not be allowed to drop more than 10 feet. Hoppers and chutes, pipes, or "elephant trunks" shall be used as necessary to prevent segregation and the splashing of mortar on the forms and reinforcing steel above the layer being placed.

Immediately after the concrete is placed in the forms, it shall be consolidated by spading, hand tamping, or vibration as necessary to ensure a smooth surface and dense concrete. Each layer shall be consolidated to ensure monolithic bond with the preceding layer. If the surface of a layer of concrete in place sets to the degree that it will not flow and merge with the succeeding layer when spaded or vibrated, the contractor shall discontinue placing concrete and shall make a construction joint according to the procedure specified in section 13.

If placing is discontinued when an incomplete horizontal layer is in place, the unfinished end of the layer shall be formed by a vertical bulkhead.

13. Construction joints

Construction joints shall be made at the locations shown on the drawings. If construction joints are needed that are not shown on the drawings, they shall be placed in locations approved by the engineer.

Where a feather edge would be produced at a construction joint, as in the top surface of a sloping wall, an insert form shall be used so that the resulting edge thickness on either side of the joint is not less than 6 inches.

In walls and columns, as each lift is completed, the top surface shall be immediately and carefully protected from any condition that might adversely affect the hardening of the concrete.

Steel tying and form construction adjacent to concrete in place shall not be started until the concrete has cured at least 12 hours. Before new concrete is deposited on or against concrete that has hardened, the forms shall be retightened. New concrete shall not be placed until the hardened concrete has cured at least 12 hours.

The surface of construction joints shall be cleaned of all unsatisfactory concrete, laitance, coatings, or debris by washing and scrubbing with a wire brush or wire broom or by other means approved by the engineer. The surface shall be kept moist for at least 1 hour before the new concrete is placed.

14. Expansion and contraction joints

Expansion and contraction joints shall be made only at locations shown on the drawings.

Exposed concrete edges at expansion and contraction joints shall be carefully tooled or chamfered, and the joints shall be free of mortar and concrete. Joint filler shall be left exposed for its full length with clean and true edges.

Preformed expansion joint filler shall be held firmly in the correct position as the concrete is placed.

When open joints are specified, they shall be constructed by the insertion and subsequent removal of a wooden strip, metal plate, or other suitable template in such a manner that the corners of the concrete are not chipped or broken. The edges of open joints shall be finished with an edging tool before the joint strips are removed.

15. Waterstops

Waterstops shall be held firmly in the correct position as the concrete is placed. Joints in metal waterstops shall be soldered, brazed, or welded. Joints in rubber or plastic waterstops shall be cemented, welded, or vulcanized as recommended by the manufacturer.

16. Removal of forms

Forms shall not be removed without the approval of the engineer. Forms shall be removed in such a way as to prevent damage to the concrete. Supports shall be removed in a manner that permits the concrete to take the stresses of its own weight uniformly and gradually.

17. Finishing formed surfaces

Immediately after the forms are removed:

- a. All fins and irregular projections shall be removed from exposed surfaces.
- b. The holes produced on all surfaces by the removal of form ties, cone-bolts, and she-bolts shall be cleaned, wetted, and filled with a dry-pack mortar. The mortar will consist of one part portland cement, three parts sand that will pass a No. 16 sieve, and just sufficient water to produce a consistency such that the filling is at the point of becoming rubbery when the material is solidly packed.

18. Finishing unformed surfaces

All exposed surfaces of the concrete shall be accurately screeded to grade and then float finished, unless specified otherwise.

Excessive floating or troweling of surfaces while the concrete is soft is not permitted.

Adding dry cement or water to the surface of the screeded concrete to expedite finishing is not allowed.

Joints and edges on unformed surfaces that will be exposed to view shall be chamfered or finished with molding tools.

19. Curing

Concrete shall be prevented from drying for a curing period of at least 7 days after it is placed. Exposed surfaces shall be kept continuously moist for the entire period, or until curing compound is applied as specified below. Moisture shall be maintained by sprinkling, flooding, or fog spraying, or by covering with continuously moistened canvas, cloth mats, straw, sand, or other approved material. Wood forms left in place during the curing period shall be kept continuously wet. A formed surface shall be thoroughly wetted immediately after forms are removed and shall be kept wet until patching and repairs are

completed. Water or covering shall be applied in such a way that the concrete surface is not eroded or otherwise damaged.

Concrete, except at construction joints, may be coated with the approved curing compound instead of continued application of moisture, except as otherwise specified in section 24. The compound shall be sprayed on the moist concrete surface as soon as free water has disappeared, but shall not be applied to any surface until patching, repairs, and finishing of that surface are completed. The compound shall be applied at a uniform rate of not less than 1 gallon per 175 square feet of surface and shall form a continuous adherent membrane over the entire surface. Curing compound shall be thoroughly mixed before applying and continuously agitated during application. Curing compound shall not be applied to a surface requiring bond to subsequently placed concrete, such as construction joints, shear plates, reinforcing steel, and other embedded items. If the membrane is damaged during the curing period, the damaged area shall be resprayed at the rate of application specified above. Any surface covered by the membrane shall not be trafficked unless protected from wear.

20. Removal and replacement or repair

When concrete is honeycombed, damaged, or otherwise defective, the contractor shall remove and replace the structure or structural member containing the defective concrete or, where feasible, correct or repair the defective parts. The contracting officer determines the required extent of removal, replacement, or repair. Before starting repair work, the contractor shall obtain the contracting officer's approval of the plan for repairs. The contractor shall perform all repair work in the presence of the engineer.

21. Concreting in cold weather

Concrete shall not be mixed nor placed when the daily minimum atmospheric temperature is less than 40 degrees Fahrenheit unless facilities are provided to prevent the concrete from freezing. The use of accelerators or antifreeze compounds is not allowed.

22. Concreting in hot weather

The contractor shall apply effective means to maintain the temperature of the concrete below 90 degrees Fahrenheit during mixing, conveying, and placing.

23. Measurement and payment

For items of work for which specific unit prices are established in the contract, concrete is measured to the neat lines shown on the drawings and the volume of concrete is computed to the nearest 0.1 cubic yard. Measurement of concrete placed against the sides of an excavation without using intervening forms is made only to the neatness or pay limits shown on the drawings. No deduction in volume is made for chamfers, rounded or beveled edges, or for any void or embedded item that is less than 5 cubic feet in volume.

Payment for each item of structure concrete is made at the contract unit price or the contract lump sum; whichever is applicable for that item. Such payment constitutes full compensation for all labor, material, equipment, transportation, tools, forms, falsework, bracing, and all other items necessary and incidental to the completion of the work except items listed for payment elsewhere in the contract. Compensation for any item of work described in the contract, but not listed in the bid schedule, is included in the payment for the item of work to which it is made subsidiary. Such items and the items to which they are made subsidiary are identified in section 24 of this specification.

24. Items of work and construction details

Instructions for use Construction Specification 33—Shotcrete

1. Applicability

Construction Specification 33 is applicable to the placement of dry mix and wet mix shotcrete.

2. Material specifications

The following material specifications complement Construction Specification 33:

531—Portland Cement

522—Aggregates for Portland Cement Concrete

534—Concrete Curing Compound

3. Included items

Items to be included in contract specifications and drawings follow:

- a. Complete engineering drawings and structural detail drawings as specified in Section 6, National Engineering Handbook, including as a minimum:
 - (1) Plans and cross sections showing the surface dimensions and thickness of all shotcrete slabs, walls, or layers and neat pay lines.
 - (2) Reinforcement details including bar placement diagrams.
 - (3) Finish lines and grades.
 - (4) Joint and edge details.
- b. The condition or orientation of subgrade material or surfaces. Identify wet areas that will require special treatment. Detail the special treatment that will be required (special shotcrete mixtures that may include silica fume and/or accelerators for flash sets, drainage blankets, special sub-surface treatment).
- c. Notes as necessary to indicate special placement or finishing requirements.
- d. Type of cement.
- e. Special-admixtures; i.e., silica fume, fibers, high range water reducers, air entraining, and accelerators. Calcium chloride shall not be used in shotcrete containing steel embedments.
- f. Required compressive strength.
- g. Nozzleman qualifications as stated in section 6 are considered appropriate for most complex jobs with significant amount of concrete. Qualification requirements may be reduced for small, simple jobs as determined by the designer.
- h. Volumetric batching is permitted in section 7 for projects with difficult access, small volumes of shotcrete, or low placement rates. Volume batching where permitted shall be specified in section 19 by aggregate and cement batching by the bag or pre-blended dry cement and aggregate.

4. Methods

Section 18, Measurement and payment

Method 1—Intended for use where shotcrete in-place is to be reasonably uniform in shape and thickness so that measurement of the surface area will be feasible and representative of the amount of shotcrete placed.

Method 2—Intended for use where measurement of shotcrete in-place is not feasible or when payment by material in-place is not feasible or when payment by material used rather than shotcrete in-place is desirable for other reasons.

When specifications are prepared using electronic procedures and all measurement and payment methods but one are deleted for use in a contract specification, delete from the last paragraph, **All Methods The following provisions apply to all methods of measurement and payment.** Left justify the remaining text.

5. Items of work and construction details

Starting at the top of page 33-8, prepare and outline job specific "Items of Work and Construction Details" (IWCD) in accordance with these instructions. For ease of utilization, the use of recyclable color paper for the IWCD should be considered.

Construction Specification 33—Shotcrete

1. Scope

The work shall consist of furnishing, mixing, applying and curing shotcrete. Except as otherwise specified, either a dry mix or wet mix process may be used.

2. Material

Portland cement **shall conform to the requirements of Material Specification 531, Portland Cement, for** the specified type.

Aggregates shall conform to the requirements of Material Specification 522, Aggregates for Portland Cement Concrete, unless otherwise specified. Gradation shall be one of the three options specified by ACI 506R, table 2.1, unless otherwise specified.

Admixtures, if specified, shall meet the requirements indicated. Nonchloride chemical admixtures shall conform to ASTM C 494. Air-entraining admixtures shall conform to ASTM C 260. Fly ash or pozzolanic material shall conform to ASTM C 618. Calcium chloride shall conform to ASTM D 98 and shall be in flake or pellet form.

Water used in mixing or curing shotcrete shall be clean and free from injurious amounts of oil, salt, acid, alkali, organic matter, or other deleterious substances.

Curing compound shall conform to the requirement of Material Specification 534, Concrete Curing Compound.

3. Strength and quality

The compressive strength of shotcrete at the age of 28 days shall be not less than specified in section 19 of this specification.

Shotcrete shall be uniform and dense, free from "drummy" areas that indicate laminations, voids, sand pockets, or disbonded material.

4. Consistency

The proportion of water added to the mixture shall be accurately controlled to produce thorough and uniform hydration of the shotcrete. The consistency of the shotcrete shall be such that the surface of the shotcrete in place shall have a rich, glossy appearance and that the shotcrete shall adhere to the supporting surface without flowing, slumping, or sloughing. For application to vertical or overhanging surfaces, the mix proportions shall be adjusted so that the placed shotcrete will adhere to a minimum thickness of 0.75 inch without sagging or sloughing. For adjustment of consistency, fly ash or pozzolanic material can be added to the mixture in amounts of no more than 20 percent (by weight) of cement in the mixture.

5. Inspection and testing

Procedures for preparing shotcrete test panels and the testing specimens sawed or cored from panels will be performed in accordance with ASTM Method C 1140. The compression test specimens will be cores taken from the test panels or from the structure.

Similar panels not less than 18 inches square and not less than 6 inches thick shall be made periodically as directed by the engineer during the progress of the work.

Cores taken from the test panels shall receive standard curing in lime-saturated water at 73.4 degrees Fahrenheit plus or minus 3.0 degrees Fahrenheit within 24 hours after removal. Cores shall continue to receive the prescribed initial cure treatment until standard curing is commenced.

For each strength test, three cores will be tested in compression. The test result will be the average of the strengths of the three specimens except that if one specimen shows manifest evidence of improper sampling, coring, or testing, it will be discarded and the strengths of the remaining two specimens will be averaged. If more than one specimen representing a test shows such defects, the entire test will be discarded.

The contractor shall furnish the forms and make the required test panels and shall provide such facilities, material, and assistance as may be necessary for curing, handling, and protecting the panels. Test panels shall be cast only when the engineer is present.

6. Nozzle operator qualifications

The nozzle operator shall be able to document a minimum of 3,000 hours of experience as a nozzle operator and shall have completed at least one similar application as a nozzle operator, unless otherwise specified.

The nozzle operator and application crew members shall be required to meet pre-construction testing requirements administered by the engineer on a test panel or an area. The engineer will carefully observe shooting of the test panel or area and note if the nozzle operator examinee:

- a. Cleans the shooting surface with air and water before shooting.
- b. Applies a bonding coat on the shooting surface ahead of the heavier shotcrete applications
- c. Directs shotcrete application around reinforcement in a manner that prevents buildup on the face of the reinforcement and allows the shotcrete to flow and compact tightly around the back of the reinforcement.
- d. If applicable, directs the finisher or nozzle helper to cut out any sags, sand, or rebound pockets.
- e. If applicable and where necessary, directs the finisher or nozzle helper to broom the shotcrete surface before application of additional layers.

7. Measuring material

The proportions of the shotcrete mix shall be controlled on the basis of the weight of each component material, unless otherwise specified in section 19 of this specification, except that water may be measured by volume. Material shall have the following batch tolerances of the mix proportion weights: cement, plus or minus 2 percent; aggregate, plus or minus 4 percent; and admixtures, plus or minus 6 percent. Weighing equipment used shall be accurate to within 0.4 percent of scale capacity.

8. Equipment

The contractor shall furnish all equipment necessary for batching, mixing, and placing the shotcrete. The equipment shall meet the following requirements.

The placing equipment for dry mix shotcrete shall be designed and equipped to receive the dry mix, introduce the mix into a stream of compressed oil free dry air, convey the mix pneumatically through a delivery hose to a nozzle at the point of discharge, inject water under pressure into the suspended stream of dry sand and cement within the nozzle, and spray the resulting shotcrete mix onto the surface of the work at a uniform rate and at a controlled velocity. The placing equipment shall be equipped with accurate gauges to indicate the air pressure and water pressure and with devices capable of accurately controlling the air pressure at any level between 50 pounds per square inch and 80 pounds per square inch, the water pressure at any level between 50 pounds per square inch and 100 pounds per square inch, and the rate of application of water at the nozzle.

The placing equipment for wet mix shotcrete shall be designed and equipped to receive the shotcrete from the mixer, convey it through a delivery hose to a nozzle at the point of discharge, accelerate it in the nozzle by means of compressed oil-free dry air, and spray it onto the surface of the work. It shall be capable of delivering shotcrete to the nozzle uniformly and continuously and discharging it from the nozzle at a uniform rate and at a controlled velocity sufficient for all parts of the work.

Batch and continuous mixing equipment shall include a power-driven mixer capable of thoroughly mixing the material at a rate adequate to ensure uniform feeding of the mixture to the placing equipment and a feeding apparatus capable of supplying the mixture to the placing equipment at an adequate and uniform rate.

9. Mixing

Dry mix shotcrete—The cement and admixtures and other additives (except accelerator) shall be mixed into a predampened homogeneous mass that thoroughly coats the aggregate before being fed through a vibratory screen into the placing equipment. Proper predampening shall be indicated by the ball-in-hand test as follows: When a small amount of mix is tightly squeezed, the resulting ball holds together or cracks slightly, but essentially remains whole. The mix has too little predampening moisture if the ball crumbles into discrete particles when the hand is opened and/or color is light gray. If moisture comes off on the hand, too much predampening moisture is in the mix. The properly predampened dry mix shall be used within 45 minutes after mixing (15 minutes in hot weather conditions where the temperature is over 85 °F). Any material that dries out or cakes after mixing shall be wasted. Rebound material shall not be remixed or reused.

Wet mix shotcrete—Air-entrainment and chemical admixtures may only be used in wet mix concrete. The cement, sand, admixtures (except accelerator), and water shall be thoroughly mixed in the mixer drum sufficiently to produce shotcrete of the required consistency. It must be uniform within each batch and uniform from batch to batch when discharged into the placing equipment. Accelerators, if specified, shall be mixed at the nozzle. Ready-mix concrete shall conform to the requirements of ASTM C 94 unless otherwise specified.

The entire contents of the mixer shall be discharged from the drum before material for a succeeding batch is placed therein. A mix that becomes difficult to pump shall be discarded; otherwise, a batch shall be gunned within 1.5 hours of batching in normal weather and within 45 minutes during hot weather conditions (temperatures over 85 °F). Rebound material shall not be remixed or reused.

10. Forms

Forms shall be structurally adequate and of such design that rebound or accumulated loose sand can freely escape or be readily removed. Shooting strips shall be used at corners, edges, and on the surface where necessary to obtain true lines and proper thickness. Where practicable, ground wires shall be installed as guides to accurately establish the specified contour of the finished surface of shotcrete. Ground wires shall be set and used as guides for templates in forming curved and molded surfaces. When shotcrete is to be placed on a horizontal or sloping surface, headers and ground wires shall be provided to the extent necessary to ensure control of slab thickness. Ground wires shall be tightened and kept taut, secure, and true to line and plane during placement of shotcrete and shall be removed when placement is completed.

Header boards are required where the drawings indicate a square edge and at required joints. Form surfaces shall be thoroughly cleaned and a form release agent applied before shotcrete is placed.

11. Preparation of surfaces to receive shotcrete

All surfaces to receive or support shotcrete shall be carefully prepared and conditioned. All such prepared surfaces shall be inspected and approved by the engineer before the application of shotcrete.

Earth surfaces to which shotcrete is to be applied shall be firmly compacted and neatly trimmed to line and grade.

Asphaltic concrete surfaces shall be thoroughly cleaned of any growths, earth, or any other material that would affect bond or be detrimental to the shotcrete.

Concrete, mortar, or rock surfaces shall be thoroughly cleaned by water blasting or sand blasting to remove all dirt, laitance, weak or unbonded mortar, loose material, grease, or other deleterious substances.

Surfaces on which the shotcrete is to be placed shall be sufficiently rough to ensure the adherence of the shotcrete. Offsets that would cause an abrupt and substantial change in thickness of the shotcrete shall be removed or tapered.

All surfaces shall be maintained in a moistened condition for 3 hours before application of shotcrete. Shotcrete shall not be applied to mud, dried earth, uncompacted fill, rebound material, or surfaces on which free water exists unless otherwise specified in section 19. All ice, snow, and frost shall be removed, and the temperature of all surfaces to be in contact with the new shotcrete shall be no colder than 40 degrees Fahrenheit.

12. Placing

The contractor shall have all equipment and material required for curing available at the site and ready for use before placement of shotcrete begins. No shotcrete shall be placed except in the presence of the engineer or authorized representative. The contractor shall give reasonable notice to the engineer each time shotcrete placement is scheduled. Such notice shall be far enough in advance to give the engineer adequate time to inspect the surfaces to which the shotcrete is to be applied, the forms, steel reinforcement, and other preparations for compliance with the specifications before the start of placement operations.

During placement of shotcrete, the air pressure shall be adjusted as required to control rebound and density of shotcrete. For a given application, once the optimum operating pressures have been established, they shall be maintained constantly throughout the application. For dry mix shotcrete, the air pressure at the material outlet or air-inlet on the gun shall be not less than 40 pounds per square inch plus 5 pounds per square inch for each 50 feet of length of the discharge hose greater than 100 feet and 5 pounds per square inch for each 25 feet the nozzle is above the gun (shotcrete delivery equipment). The water pressure at the nozzle shall be not less than 15 pounds per square inch greater than the air pressure at the material outlet or air-inlet on the gun.

For most applications the placing nozzle shall be held between 2 and 6 feet from and approximately normal to the surface of the work. At a longer distance the nozzle velocity may need to be increased so that the impact velocity suits the requirements of the application. Corners shall be filled first.

Shotcrete shall be applied in a single thickness or to a layer thickness no greater than that which will cause sagging, sloughing, or dropout. Sags and sloughs shall be cut out and regunned. Replacement shall be accomplished before the previously placed shotcrete has completely set. When shotcrete is placed on a vertical surface, application shall be started at the bottom and be completed at the top.

In any case when the placing of shotcrete is interrupted for more than 1 hour, the edge of the layer shall be sloped off at an angle of about 45 degrees to the surface being shot, and the sloped part shall be covered with a double layer of 6-ounce burlap and kept continuously moist until the application of shotcrete is resumed. Before applying new material, the sloped part shall be thoroughly cleaned and wetted by means of an air and water blast or an equally effective method approved by the engineer.

Material that rebounds and accumulates on forms, subgrade surfaces, or reinforcing steel ahead of the shotcrete being placed shall be removed and discarded.

13. Finishing

Rebound material shall be carefully swept off the finished shotcrete surface and discarded before it becomes too hard for removal. After the shotcrete has been placed to the depth required, the surface shall be checked with a straightedge or template and any low spots shall be brought up to grade by placing additional shotcrete. The finished surface of the shotcrete shall be left as a natural gun finish unless screeding or further finishing, or both, are specified in section 19 of this specification.

When specified, screeding shall be accomplished as follows:

- Place shotcrete a fraction beyond the guide strips, ground wires, or forms.
- Allow the surface of the shotcrete to stiffen to the point it will not pull or crack under screeding or troweling.
- Trim, slice, or scrape excess material to true line and grade and remove the placing guides.

A natural rod finish shall consist of the removal, by floating, of the impressions left after the guide strips or ground wires have been removed. A *natural broom finish* shall be that finish resulting from brooming the natural rod finish. A *float finish* shall be that finish resulting from floating the natural rod finish with a wood or rubber float.

14. Curing

Shotcrete shall be prevented from drying for a curing period of at least 7 days after it is placed. The exposed surface shall be kept continuously moist for the entire period or until curing compound is applied as specified below. Moisture shall be maintained by sprinkling, flooding, or fog spraying, or by covering with continuously moistened canvas, cloth mats, straw, sand, or other approved material. Wood forms left in place during the curing period shall be kept wet. Formed surfaces shall be thoroughly wetted immediately after forms are removed and shall be kept wet until patching and repairs are completed. Water or covering shall be applied in such a way that the shotcrete surface is not eroded or otherwise damaged.

Water for curing shall be clean and free from any substances that cause discoloration of the shotcrete where the finished surface will be exposed to view.

Except as otherwise specified in section 17d of this specification and except for surfaces to which additional shotcrete is to be applied, shotcrete may be coated with curing compound as an alternative to the continued application of moisture.

The compound shall be sprayed on the moist shotcrete surface as soon as rebound has been removed and any required repairs are completed, or as soon as water curing is discontinued.

The curing compound shall be thoroughly mixed immediately before applied and continuously agitated during application. It shall be applied at a uniform rate of not less than 1 gallon per 100 square feet of surface for natural gun finishes. Curing compound shall be applied in two applications, one in each direction. If a natural rod, broom, or float finish is specified, the curing compound application rate shall be at least 1 gallon per 150 square feet. Curing compound shall not check, crack, or peel, and shall be free from pinholes or other imperfections.

Curing compound shall not be applied to a subgrade surface or other surfaces requiring bond with subsequently placed shotcrete, such as construction joints, reinforcing steel, and other embedded items.

A surface subjected to heavy rainfall or running water within 3 hours after the compound has been applied or a surface damaged by subsequent construction operations during the curing period shall be resprayed in the same manner as for the original applications. A surface covered by the membrane shall not be trafficked unless protected from damage and/or wear.

15. Replacement or repair

When shotcrete lacks uniformity; exhibits segregation, honeycombing, or laminations; or contains dry patches, slugs, voids, or sand pockets, the contractor shall remove and replace the defective shotcrete. The engineer's concurrence in the extent of removal and replacement is required.

Before starting significant removal and replacement work, the contractor shall obtain the engineer's approval of the plan for making the repair. Such approval shall not be considered a waiver of the contracting officer's or owner's right to require complete removal of defective work if the completed repair does not produce shotcrete of the required quality and appearance.

Repair work shall be performed only when the engineer is present.

Repair shall be made with shotcrete conforming to this specification. When removal of defective shotcrete is required, reinforcement damaged or destroyed shall be replaced before replacement of the shotcrete. At the edges of removed sections, the sound shotcrete shall be carefully trimmed to the extent required to expose sufficient reinforcement for effecting competent splices. The sound shotcrete at the edges of removed sections shall be trimmed to a slope of about 45 degrees with the surface of the work and shall be thoroughly moistened before placement of the new shotcrete.

Any parts of the work having thickness less than that specified may be repaired by the placement of additional layers of shotcrete if such repair is expressly approved by the engineer.

The surface to which additional shotcrete is to be applied shall be prepared as required by section 11 of this specification.

Curing as specified in section 14 of this specification shall be applied to repaired areas immediately after the repairs are completed.

16. Placing in cold weather

When the atmospheric temperature may be expected to drop below 40 degrees Fahrenheit at the time shotcrete is placed, or at any time during the curing period, the following provisions shall also apply:

- a. Shotcrete placement shall be permitted when the air temperature is at least 40 degrees Fahrenheit and rising. Placement shall be discontinued if the temperature falls to 40 degrees Fahrenheit and is expected to continue to fall.
- b. The temperature of the shotcrete at time of placing shall not be less than 50 degrees Fahrenheit nor more than 90 degrees Fahrenheit. The temperature of neither aggregates nor mixing water shall be more than 100 degrees Fahrenheit just before mixing with the cement.
- c. When the daily minimum temperature is less than 40 degrees Fahrenheit, shotcrete shall be insulated or housed and heated after placement. The temperature of the shotcrete and air adjacent to the shotcrete shall be maintained at not less than 50 degrees Fahrenheit nor more than 90 degrees Fahrenheit for the duration of the curing period.
- d. Methods of insulating, housing, and heating the structure shall be in accordance with Standard Specification for Cold Weather Concreting, ACI Standard 306.1.
- e. The use of accelerators or antifreeze compounds is not allowed unless otherwise specified.

- f. When dry heat is used to protect shotcrete, means of maintaining an ambient humidity of at least 40 percent shall be provided unless the shotcrete has been coated with curing compound as specified in section 14 of this specification or is covered tightly with an approved impervious material.

17. Placing in hot weather

The following provisions shall apply when climatic factors, such as high air temperature, reduced relative humidity, and increased wind velocities, are present or conditions are such that the temperature of placed shotcrete exceeds 90 degrees Fahrenheit at or during the first 24 hours after placement:

- a. The contractor shall maintain the temperature of the shotcrete below 90 degrees Fahrenheit during mixing, conveying, and placing using the methods given in items b, c, and d.
- b. An exposed shotcrete surface that tends to dry or set too rapidly shall be continuously moistened by means of a fog spray or otherwise protected from drying immediately after placement.
- c. Shotcrete surfaces exposed to the air shall be covered as soon as the shotcrete has hardened sufficiently and shall be kept continuously wet for at least the first 24 hours of the curing period and for the entire curing period unless curing compound is applied as specified in subsection d.
- d. If moist curing is discontinued before the end of the curing period, white pigmented curing compound shall be applied immediately following the procedures specified in section 14 of this specification.

18. Measurement and payment

Method 1—For items of work for which specific unit prices are established in the contract, the dimensions of the exposed surface of the shotcrete is measured to the neatness shown on the drawings and the surface area is computed to the nearest square foot. Payment is made at the contract unit price for shotcrete. Such payment constitutes full compensation for completion of the work including making and handling test panels, but not including reinforcing steel or other items listed for payment elsewhere in the contract.

Measurement and payment for furnishing and placing reinforcing steel are made as specified in Construction Specification 34.

Method 2—For items of work for which specific unit prices are established in the contract, cement and aggregates used in shotcrete and in authorized test panels are measured by the batch weights of the material charged into the mixer. No deduction is made for normal rebound; however, payment is not made for material wasted because the in-place shotcrete does not conform to the specifications. Payment is made at the contract unit prices for cement and aggregates for shotcrete. Such payment constitutes full compensation for completion of the work including making and handling test panels, but not including reinforcing steel or other items listed for payment elsewhere in the contract.

Measurement and payment for furnishing and placing reinforcing steel are made as specified in Construction Specification 34.

All Methods—The following provisions apply to all methods of measurement and payment. Compensation for any item of work described in the contract, but not listed in the bid schedule, is included in the payment for the item of work to which it is made subsidiary. Such items and the items to which they are made subsidiary are identified in section 19 of this specification.

19. Items of work and construction details

Instructions for use

Construction Specification 34—Steel Reinforcement

1. Applicability

Construction Specification 34 is applicable to the placement of steel bar reinforcement and steel welded wire fabric reinforcement for reinforced concrete or pneumatically applied mortar.

2. Material specifications

Material Specification 539, Steel Reinforcement (for concrete) complements Construction Specification 34.

3. Included items

Items to be included in contract specifications and drawings follow:

- a. Complete placing drawings prepared by the designer or instructions for the contractor to prepare placement drawings with steel schedules from the engineering drawings.
- b. Steel schedule and bar list with bending diagram if needed to facilitate the placement drawings. These items are generally needed for all except simple structures.
- c. Type and grade of steel if the contractor's choice from the list in Material Specification 539 must be restricted.
- d. Bar splice requirements are normally covered by the ACI Codes and should be referenced. Unique limitations or exceptions need be included to provide clarity.
- e. Standard methods would include the following to be used to specify bar splice lengths. One of two methods can be used in specifying lap lengths at bar splices. The required information varies depending upon the method used.

Method 1—Show splice locations along with lengths of bars in a schedule that is adequate to meet the design requirements and criteria.

Method 2—Include the following:

- (1) Locations where splices are permitted or not
 - (2) Type of splices at locations permitted: contact, noncontact, or butt
 - (3) Splice layout at locations permitted: staggered or coincident and alternating or repeated in section 10.
 - (4) Splice class for each respective location and mat
 - (5) Concrete design compressive strength, f'_c
 - (6) Bar stress condition: tension or compression
 - (7) Designation of top bars and others
 - (8) Steel reinforcement design yield strength
- f. Method(s) of measurement and payment, if the standard specification includes more than one method.

4. Methods

Section 5, Splicing bar reinforcement

Method 1—Intended for use when construction drawings for reinforced concrete structures show bar placement details and steel schedules listing bar dimensions and bar shape. Splice locations and bar laps have been determined during design and fully detailed on the drawings. This method applies when national standard detail drawings are used.

Method 2—Intended for use when construction drawings do not contain complete bar placement diagrams and bar schedules. This method should be considered when quality control and other responsibilities are placed on the contractor.

Complete bar placement—Drawings and schedules should normally be included in all construction drawings. However, in such cases when engineering drawings are prepared by a project sponsor or an A-E firm and complete bar placement drawings and schedules are not provided, they may be prepared by the steel fabricator based on engineering drawings as shown in ACI 315.

Section 9, Measurement and payment

Method 1—Intended for use when all reinforcement is measured by weight.

Method 2—Intended for use when bar reinforcement is measured by weight and welded wire fabric reinforcement is measured by area.

When all methods but one are deleted for use in a contract specification, delete from the last paragraph ***All Methods The following provisions apply to all methods of measurement and payment.*** Left justify the remaining text.

5. Items of work and construction details

Starting at the top of page 34-4, prepare and outline job specific "Items of Work and Construction Details" (IWCD) in accordance with these instructions. For ease of utilization, the use of recyclable color paper for the IWCD should be considered.

Construction Specification 34—Steel Reinforcement

1. Scope

The work shall consist of furnishing and placing steel reinforcement for reinforced concrete or pneumatically applied mortar.

2. Material

Steel reinforcement shall conform to the requirements of Material Specification 539, Steel Reinforcement (for concrete). Before reinforcement is placed, the surface of the bars and fabric and any metal supports shall be cleaned to remove any loose, flaky rust, mill scale, oil, grease, or other undesirable coatings or foreign substances. Epoxy-coated steel reinforcement shall be free of surface damage. After placement, the reinforcement shall be maintained in a clean and serviceable condition until it is completely embedded within the concrete.

3. Bar schedule, lists and diagrams

Any supplemental bar schedules, bar lists or bar-bending diagrams required in section 10 of this specification to accomplish the fabrication and placement of steel reinforcement shall be provided by the contractor. Before reinforcement is placed, the contractor shall furnish four copies of any such lists or diagrams to the contracting officer for approval. Acceptance of the reinforcement is not based on approval of these lists or diagrams, but on inspection of the steel reinforcement after it has been placed, tied, and supported and is ready to receive concrete.

4. Bending

Reinforcement shall be cut and bent in compliance with the requirements of the American Concrete Institute Standard 315. Bars shall not be bent or straightened in a manner that will injure or weaken the material. Bars with kinks, cracks, or improper bends will be rejected.

5. Splicing bar reinforcement

Method 1—Splices of reinforcement shall be made only at locations shown on the drawings and provided by the steel schedule. Placement of bars at the lap splice locations shown, when not in contact, shall not be farther apart than one-fifth the shown lap length and in any case no greater than 6 inches.

Method 2—Splices of reinforcement shall be limited to those locations shown on the drawings. Splice lengths shall be determined before fabrication and meet the requirements of ACI Standard 318, Building Code Requirements for Reinforced Concrete, based upon design information in section 10 of this specification. Bar placement drawings and schedules shall be provided for approval before fabrication. The drawings shall show all splice locations, layouts, and lap dimensions.

6. Splicing welded wire fabric

Unless otherwise specified, welded wire fabric shall be spliced in the following manner:

End-to-end—Adjacent sections shall be spliced end-to-end (longitudinal lap) by overlapping a minimum of one full mesh plus 2 inches plus the length of the two end overhangs. The splice length is measured from the end of the longitudinal wires in one piece of fabric to the end of the longitudinal wire in the lapped piece of fabric.

Side-to-side—Adjacent sections shall be spliced side to side (transverse lap) a minimum of one full mesh plus 2 inches. The splice length shall be measured from the centerline of the first longitudinal wire in one piece of fabric to the centerline of the first longitudinal wire in the lapped piece of fabric.

7. Placing

Reinforcement shall be accurately placed and secured in position to prevent its displacement during the placement of concrete. Tack welding of bars is not permitted. Metal chairs, metal hangers, metal spacers, and concrete chairs may be used to support the reinforcement. Metal hangers, spacers, and ties shall be placed in such a manner that they are not exposed in the finished concrete surface. The legs of metal chairs or side form spacers that may be exposed on any face of slabs, walls, beams, or other concrete surfaces shall have a protective coating or finish. The coating or finish can be hot dip galvanizing, epoxy coating, plastic coating, or stainless steel. Metal chairs and spacers not fully covered by a protective coating or finish shall have a minimum cover of 0.75 inch of concrete over the unprotected metal part. The exception is that those with plastic coatings may have a minimum cover of 0.5 inch of concrete over the unprotected metal part. Precast concrete chairs shall be manufactured of the same class of concrete as specified for the structure and shall have the tie wires securely anchored in the chair or a V-shaped groove at least 0.75 inch in depth molded into the upper surface to receive the steel bar at the point of support. Precast concrete chairs shall be clean and moist at the time concrete is placed.

High density or structural plastic rebar accessories designed to ensure maximum concrete bond may be substituted for metal or concrete accessories in spacer applications as approved by the contracting officer. Exposure of plastic rebar accessories at the finished concrete surface shall be kept to a minimum. Plastic rebar accessories, when used, shall be staggered along adjacent parallel bars and shall be placed at intervals no closer than 12 inches. Plastic rebar accessories shall not be used in concrete sections 6 inches or less in thickness.

Reinforcement shall not be placed until the prepared site has been inspected and approved. After placement of the reinforcement, concrete shall not be placed until the reinforcement has been inspected and approved by the contracting officer's technical representative (COTR).

8. Storage

Steel reinforcement stored at the work site shall be placed on platforms, skids, or other supports. This is done so that contact with the ground is avoided and the material is protected from mechanical damage and/or corrosion.

9. Measurement and payment

Method 1—For items of work for which specific unit prices are established in the contract, the weight of steel reinforcement placed in the concrete in accordance with the drawings is determined to the nearest pound by computation from the placing drawings. Measurement of hooks and bends is based on the requirements of ACI Standard 315. Computation of weights of reinforcement is based on the unit weights established in tables 34–1 and 34–2 of this specification. Computation of weights for welded wire fabric not shown in table 34–2 shall be based on ACI Standard 315. The area of welded wire fabric reinforcement placed in the concrete in accordance with the drawings is determined to the nearest square foot by computation from the placing drawings with no allowance for required laps. The weight of steel reinforcing in extra splices or extra-length splices approved for the convenience of the contractor or the weight of supports and ties is not included in the measurement for payment.

Payment for furnishing and placing reinforcing steel is made at the contract unit price. Such payment constitutes full compensation for all labor, material, equipment, and all other items necessary and incidental to the completion of the work including preparing and furnishing bar schedules, lists, or diagrams; furnishing and attaching ties and supports; and furnishing, transporting, storing, cutting, bending, cleaning, and securing all reinforcements.

Method 2—For items of work for which specific unit prices are established in the contract, the weight of bar reinforcement placed in the concrete in accordance with the drawings is determined to the nearest pound by computation from the placing drawings. Measurement of hooks and bends is based on the requirements of ACI Standard 315. Computation of weights of bar reinforcement is based on the unit weights established in table 34–1 of this specification. The weight of steel reinforcing in extra splices or extra length splices approved for the convenience of the contractor or the weight of supports and ties is not included in the measurement for payment.

The area of welded wire fabric reinforcement placed in the concrete in accordance with the drawings is determined to the nearest square foot by computation from the placing drawings with no allowance for required laps.

Payment for furnishing and placing bar reinforcing steel is made at the contract unit price for bar reinforcement. Payment for furnishing and placing welded wire fabric reinforcing steel is made at the contract unit price for welded wire fabric reinforcement. Such payment constitutes full compensation for all labor, material, equipment, and all other items necessary and incidental to the completion of the work including preparing and furnishing bar schedules, lists, or diagrams; furnishing and attaching ties and supports; and furnishing, transporting, cutting, bending, cleaning, and securing all reinforcement.

All Methods—The following provisions apply to all methods of measurement and payment. Compensation for any item of work described in the contract, but not listed in the bid schedule, is included in the payment for the item of work to which it is made subsidiary. Such items to which they are made subsidiary are identified in section 10 of this specification.

10. Items of work and construction details

Table 34–1 Standard reinforcing bars

-- Bar size designations --		Weight (lb/ft)
English	Metric	
3	10	0.376
4	13	0.668
5	16	1.043
6	19	1.502
7	22	2.044
8	25	2.670
9	29	3.400
10	32	4.303
11	36	5.313
14	43	7.650
18	57	13.600

1/ The bar diameter (inches) equals the bar size number divided by eight. For example, the diameter of a #4 bar is $4 \div 8 = 0.5$ inch.

2/ The metric bar size has been rounded to a whole number that represents the approximate diameter of the bar in millimeters.

Table 34–2 Rectangular welded wire fabric

----- Style designation ^{1/} -----		Weight (lb/100 ft ²)
by steel wire gauge	by W-number	
6 x 6 – 10 x 10	6 x 6 – W1.4 x W1.4	21
6 x 6 – 8 x 8	6 x 6 – W2.1 x W2.1	30
6 x 6 – 6 x 6	6 x 6 – W2.9 x W2.9	42
6 x 6 – 4 x 4	6 x 6 – W4.0 x W4.0	58
4 x 4 – 10 x 10	4 x 4 – W1.4 x W1.4	31
4 x 4 – 8 x 8	4 x 4 – W2.1 x W2.1	44
4 x 4 – 6 x 6	4 x 4 – W2.9 x W2.9	62
4 x 4 – 4 x 4	4 x 4 – W4.0 x W4.0	85
4 x 12 – 8 x 12	4 x 12 – W2.1 x W0.9 ^{2/}	25
4 x 12 – 7 x 11	4 x 12 – W2.5 x W1.1 ^{2/}	31

1/ Style designation is defined in ACI Standard 315 of the American Concrete Institute.

2/ Welded smooth wire fabric with wires smaller than size W1.4 is manufactured from galvanized wire.

Instructions for use

Construction Specification 35—Concrete Repair

1. Applicability

Construction Specification 35 is applicable to the usual types of concrete repair entailed in NRCS operations. Supplementary specifications are required for works of a special nature, such as:

- a. Placing concrete repair under water.
- b. Concrete repair exposed to sea or salt water.
- c. Concrete repair exposed to alkali soils or alkaline water.
- d. Special surface finishes.

2. Material specifications

The following specifications complement Construction Specification 35:

- 522—Aggregates for Portland Cement Concrete
- 531—Portland Cement
- 532—Mineral Admixtures for Concrete (fly ash)
- 533—Chemical Admixtures for Concrete (water-reducing, set-retarding admixtures)
- 532—Mineral Admixtures for Concrete (air-entraining admixtures)
- 534—Concrete Curing compounds

3. Included items

Items to be included in contract specifications and drawings

- a. Complete engineering and structural detail drawings of the repair.
- b. Notation of the type and quality of concrete, including:
 - (1) Strength of concrete repair material if other than 4,000 pounds per square inch.
 - (2) Type of cement.
 - (3) Types of admixtures, if any.
 - (4) Nominal size of coarse aggregate; or specification for aggregate if Material Specification 522 does not apply.

- (5) Authorization for a design mix that includes pozzolan as a partial substitute for cement.
 - (6) Deviations from the air content, if any.
 - (7) If replacement concrete is permitted, specify slump of the nonplasticized concrete mixture.
- c. Notation of which strength test procedure is to be used when ASTM C 684 is used.
 - d. If volumetric batching and continuous mixing is not permitted, include statement to that effect.
 - e. Deviations, if any, from specifications requiring:
 - (1) Placement of concrete repair in a single continuous pour.
 - (2) Consolidation of concrete repair material with vibrators.
 - f. Finish requirements for unformed surfaces if other than float finish is designated.

4. Methods

Section 17, Measurement and Payment

Method 1—Intended for use when the actual approved volume of the repair is calculated to determine payment.

Method 2—Intended for use when proprietary repair methods are used and the major components come in premeasured and prepackaged units. The size of a unit should be described in section 18.

Method 3—Intended for use when the actual approved surface area of the repair is calculated to determine payment.

When specifications are prepared using electronic procedures and all methods but one are deleted for use in a contract specification, delete ***All Methods*** ***The following provisions apply to all methods of measurement and payment.*** Left justify the remaining text.

5. Items of work and construction details

Starting at the top of page 35-10, prepare and outline job specific "Items of Work and Construction Details" (IWCD) in accordance with these instructions. For ease of utilization, the use of recyclable color paper for the IWCD should be considered.

Construction Specification 35—Concrete Repair

1. Scope

The work shall consist of removal of unsuitable concrete; surface and face preparation; forming; and furnishing, placing, finishing, and curing concrete repair material as required to repair structures designated in section 18 of this specification.

2. Material

Aggregates shall conform to the requirements of Material Specification 522, Aggregates for Portland Cement Concrete, unless otherwise specified. The grading of coarse aggregates shall be as specified in section 18, shown on the drawings, or as specified by the manufacturer of a proprietary repair material.

Portland cement shall conform to the requirements of Material Specification 531, Portland Cement, for the specified type. Only one brand of any type of cement shall be used in any single repair as defined in section 18.

Water used in mixing and curing of the concrete repair shall be clean and free from injurious amounts of oil, salt, acid, alkali, organic matter, or other deleterious substances.

Fly ash shall conform to the requirements of Material Specification 532, Mineral Admixtures for Concrete.

Air-entraining admixtures shall conform to the requirements of Material Specification 533, Chemical Admixtures for Concrete. If air-entraining cement is used, any additional air-entraining admixture shall be the same type as that in the cement.

Chemical admixtures for water-reducing, retarding, or water-reducing and retarding shall conform to the requirements of Material Specification 533, Chemical Admixtures for Concrete.

Curing compound shall conform to the requirements of Material Specification 534, Concrete Curing Compound.

Shotcrete, Construction Specification 33.

Proprietary concrete repair material shall be subject to review and approval of the engineer before use. The material shall meet all specified salient features for repair material and not react detrimentally with the existing concrete or associated member of the structure being repaired.

Replacement concrete repair material shall be a material that consists essentially of a binding medium of portland cement and water that will meet all the specified salient features for repair material and not react detrimentally with the existing concrete or associated members of the structure being repaired. This may be, but is not limited to, a conventional concrete mix with or without admixtures, shotcrete, preplaced aggregate concrete, or grout.

3. Preparation of areas to be repaired

All loose, cracked or otherwise unsuitable or defective concrete shall be removed from the existing structure as shown on the drawings or specified in section 18. The final extent of removal shall be determined by the engineer after inspection of prepared surfaces.

Feathered edges at the surface are not permitted. The surface edge of the repaired area shall be cut with a saw, drilled, or chipped to leave a sharp edge with a minimum of a 0.75-inch depth face perpendicular to the face of the wall.

The top side of the repair hole shall be shaped to a uniform, fairly straight face that is sloped upward on a 1-inch rise for each 3 inches of depth of cut toward the face from which the repair material will be placed. The repair hole shall be conical in shape with the large end at the surface from which repair material will be placed.

The bottom and vertical or near vertical sides of the hole shall be cut sharply and approximately perpendicular to the face of the wall. All interior corners shall be rounded to a minimum radius of 1 inch.

Where reinforcement is encountered, the concrete directly in contact with the sides of the reinforcement shall be removed to provide at least 1-inch clear distance between the reinforcement and the in-place concrete.

Before the concrete repair material is placed, all oil and grease shall be steam or solvent cleaned from all reinforcement and surfaces to which the repair material is required to bond. If solvent cleaning is used, solvents and solvent residue shall not impair the repair material or its bonding strengths.

After removal of all oil and grease, the reinforcement shall be cleaned to remove any loose, flaky rust, mill scale, and other coatings or foreign substances that would impair bonding of the repair material to the reinforcement. The prepared faces of the repair hole shall be cleaned by high pressure water jets or compressed air jetting with water to remove all loose particles and dust. The repair hole shall be free of chips, sawdust, debris, free water, ice, snow, or other harmful substances or coatings.

4. Disposal

Unless otherwise specified, all concrete and other debris resulting from the repair works shall be removed from the site and disposed of at location(s) of the contractor's selection. The contractor is responsible for complying with all local, State, and Federal regulations pertaining to the disposal of such waste.

5. Selection of concrete repair material

Only one brand of proprietary concrete repair material shall be used in any single repair operation unless compatibility between brands can be proven with actual test or performance data.

A conventional concrete mix to be used as a replacement concrete repair material shall be ready-mix concrete that meets all the specified salient features for repair material and conforms to ASTM C 94. Option A from section 5 of ASTM C 94 shall apply.

The contractor is responsible for the selection and correct application of the concrete repair material. At least 14 days before installation, the contractor shall provide the engineer for approval all technical data for the repair material. The technical data shall include the design mix and test results to verify satisfactory conformance to the salient feature requirements. If a proprietary material is used, the manufacturer's recommended preparation, use, and installation specifications shall also be submitted 14 days before installation. Concrete repair material shall not be placed before approval.

Concrete repair material shall have the following salient features:

- a. Be a cementitious material that after hardening will remain stable in wet and moist environments and will not dissolve in water.
- b. A 28-day compressive strength of 4,000 pounds per square inch or greater when tested according to ASTM C 39, unless otherwise specified.

- c. Bond strength of the repair material shall be tested in accordance with ASTM C 882 procedures for type V material and shall have the minimum strength of 1,100 pounds per square inch at 28 days unless otherwise specified.
- d. Shall be suitable for application at the minimum temperature of 55 degrees Fahrenheit.
- e. Shall not contain chlorides, added gypsum, added lime, or high alumina cements. Shall be noncombustible both before and after cure.
- f. Color shall be concrete gray unless otherwise specified.
- g. Shall not produce a vapor barrier material and shall be thermally compatible with concrete.
- h. Shall have a freeze-thaw resistance equal to or greater than 4,000 pounds per square inch, air-entrained concrete designed for severe exposure conditions according to ACI Standard Practice 211.1, unless otherwise specified.
- i. Shall exhibit no shrinkage at 28 days and no more than 0.4 percent expansion at 3, 14, or 28 days after placement when tested according to the procedures in Corps of Engineers Specification for Non-shrink Grout, CRD-C 621.

Additional site specific requirements for materials are defined in section 18.

6. Handling and measurement of material

For all types of repair material, the cementitious components shall be kept dry and protected from contamination until incorporated in the mix. Broken containers or bags of premeasured and premixed components will not be accepted.

Handling and measurement of conventional concrete mix repair material shall conform to ASTM C 94.

Handling and measurement of prepackaged proprietary material shall follow the manufacturer's recommendations and requirements. Handling and measurement of components that are not prepackaged or premeasured shall be in accordance with the following requirements and the manufacturer's requirements. A copy of the manufacturer's written requirements will be provided to the engineer 14 days before installation. The handling and measurement requirements are:

- Aggregates shall be stored or stockpiled in such a manner that separation of coarse and fine particles of each size is avoided and that various sizes do not become intermixed before proportioning. Methods of handling and transporting aggregates shall be such as to avoid contamination, excessive breakage, segregation or degradation, or intermingling of various sizes.
- Scales for weighing aggregates and repair material components shall be beam type, electronic, or springless dial type. They shall be accurate within 0.4 percent under operating conditions. All exposed fulcrums, clevises, and similar working parts of scales shall be kept clean and properly maintained.
- The quantities by weight of repair material components and aggregates in each batch of material, as indicated by the scales, shall be within the following percentage of the required batch weights:
 - Aggregates ± 2 percent
 - Other components ± 1 percent

Measuring tanks for mixing water or liquid shall be of adequate capacity to furnish the maximum amount of mixing water or liquid required per approved batch. Measuring tanks shall provide the means for readily and accurately measuring the amount of water or liquid required. Accuracy of water measurement shall be plus or minus 1 percent.

7. Forms

Forming material shall be wood, plywood, steel, or other approved material and shall be mortar tight. The forms and associated falsework shall be substantial and unyielding and shall be constructed so that the finished repair conforms to the specified dimensions and contours. Form surfaces shall be smooth and free from holes, dents, sags, or other irregularities.

Before the forms are set into place, the surface of the form shall be lined with plastic sheeting or coated with a nonstaining form release agent compatible with the repair material being used. This prevents bonding of the repair material to the forms. If the forms are lined with plastic, the plastic shall be stretched taut to remove all wrinkles and folds and maintain a smooth condition during the placement and curing of the repair material.

Metal ties or anchorage within the forms shall be equipped with cones, she-bolts, or other devices that permit their removal to a minimum depth of 1 inch without injury to the concrete or repair material. Ties designed to break off below the surface of the concrete shall not be used without cones.

All visible edges and corners included in the repair location shall be shaped the same as adjacent or similar edges or corners of the structure being repaired.

Forms shall be constructed to facilitate consolidation and complete filling of the repair void, and, when all surfaces are formed, to facilitate applying pressure to the repair material immediately after placement.

8. Mixing, conveying, and placing

Proprietary repair material shall be mixed and conveyed to the forms according to manufacturer's written recommendations. Material that cannot be placed within the manufacturer's time requirements shall not be placed in the forms and shall be discarded offsite at locations selected by the contractor.

Concrete repair material shall not be placed until the subgrade, forms, and steel reinforcement have been inspected and approved by the engineer.

The contractor shall have all equipment and material required for curing available at the site ready for use before placement of repair material begins.

No concrete repair material shall be placed except in the presence of the engineer. The contractor shall give reasonable notice to the engineer each time concrete repair material is scheduled for placement. Such notice shall be adequate to allow the engineer sufficient time to review and approve the subgrade, forms, steel reinforcement, and other preparations for compliance with the specifications. Other preparations include, but are not limited to, the mixing and delivery equipment and system, placing and finishing equipment and system, schedule of work, workforce, and heating and cooling facilities as applicable. All deficiencies are to be corrected before concrete repair material is mixed for placement.

The concrete repair material shall be deposited as closely as possible to its final position in the forms and shall be worked into the corners and angles of the forms and around all reinforcement and embedded items in a manner to prevent segregation of aggregates or excessive laitance. The depositing of repair material shall be regulated so that the material can be consolidated with a minimum of lateral movement.

Unless otherwise approved, concrete repair material shall not be dropped from a height greater than recommended by the manufacturer or 5 feet, whichever is less.

Unless otherwise specified, all concrete repair material required for each repair location shall be placed in one continuous operation. Successive layers or batches shall be placed at a rate sufficient to prevent setting of material between successive layers.

At the time of placement of repair material, the existing concrete surface shall be damp and without free water unless otherwise specified or required by the manufacturer of the proprietary repair material being used.

9. Consolidating

Concrete repair material shall be consolidated to ensure positive contact of repair material with all repair surfaces and reinforcing steel, to remove entrapped air pockets and voids, and to maximize the density of the repair material.

Vibration shall not be applied directly to the reinforcing steel or other embedded items, the forms, or to concrete repair material that has hardened to the degree that it is no longer plastic. The use of vibrators to transport concrete repair material in the forms or conveying equipment is not allowed.

Proprietary repair material shall be consolidated in accordance with the manufacturer's recommendations.

Unless otherwise specified in section 18, conventional concrete mix repair material shall be consolidated in the following manner:

- Conventional concrete mix repair material shall be consolidated with internal type mechanical vibrators capable of transmitting vibration to the concrete at frequencies not less than 8,000 impulses per minute. Vibration shall be supplemented by spading, rodding, or hand tamping as necessary to ensure smooth and dense concrete along form surfaces, in corners, and around embedded items.
- The location, manner, and duration of the application of the vibrators shall be such as to secure maximum consolidation of the concrete repair material without causing segregation of the mortar and coarse aggregate and without causing water or cement paste to flush to the surface. Vibration shall compact the concrete repair material and bring it into intimate contact with the forms and embedded items while removing voids and pockets of entrapped air.

The contractor shall provide sufficient vibrators to properly consolidate the concrete repair material immediately after it is placed. Vibration shall be applied to the freshly deposited concrete repair material by slowly inserting and removing the vibrator at points uniformly spaced and not farther apart than twice the radius of action (i.e., the distance that the concrete repair material is visibly effected by the vibration). The area visibly effected by the vibrator shall overlap the adjacent, just vibrated area. The vibrator shall extend vertically into the previously placed layer of fresh concrete repair material at all points. This ensures an effective bond between layers. In thin slabs the vibrator(s) should be sloped toward the horizontal to allow operations in a fully embedded position.

- The internal vibration of thin slabs (less than 9 inches) may be augmented using surface vibrators when approved by the engineer. Consolidation of the concrete repair material from the top surface down, along with a leveling effect to assist the finishing operation, may be provided by vibrating screeds, plate or grid vibratory tampers, or vibrating roller screeds. The contractor's plan, including equipment selection and specifications, shall be submitted to the contracting officer for approval at least 5 days before concrete repair material placement using surface vibrating methods.

10. Removal of forms

Unless otherwise approved, forms shall not be removed sooner than the minimum time recommended by the manufacturer of the repair material or 48 hours, whichever is greater.

Forms shall be removed only when the engineer is present. Forms shall be removed in a manner to prevent damage to the concrete repair material. Supports shall be removed in a manner that permits the repair material to take the stresses caused by its own weight, uniformly and gradually.

11. Finishing formed surfaces

All repaired surfaces shall be true and even, and shall be free of open or rough spaces, depressions, or projections. Immediately after the removal of forms:

- All bulges, fins, form marks, or other irregularities that in the judgment of the engineer will adversely affect the appearance or function of the structure shall be removed. All form bolts and ties shall be removed to a minimum depth of 1 inch below the surface of the repair. The cavities produced by form ties and all other holes of similar size and depth shall be thoroughly cleaned. After the interior surface has been kept continuously wet for at least 3 hours, the cavities shall be carefully repaired with a compatible patching mortar or packed with a dry patching mortar mixed not richer than one part cement and three parts sand. Dry patching mortar shall be mixed in advance and allowed to stand without addition of water until it has reached the stiffest consistency that will permit placing. Manipulation of the mortar with a trowel during this period shall be performed as required to ensure the proper consistency.

Holes resulting from form bolts or straps that pass through the wall shall be entirely filled with mortar to form a dense, well-bonded unit. The mortar shall be tamped into place with a rod slightly smaller than the hole being filled. The hardened mortar shall be sound and free from shrinkage cracks.

All repaired areas shall be cured as specified in section 13.

12. Finishing unformed surfaces

All exposed surfaces of the concrete repair material shall be accurately screeded to grade and finished to match adjacent surfaces, unless otherwise specified. Water shall not be sprinkled or in any manner added to the surface of conventional concrete mix repair material during finishing operations.

Proprietary repair material shall be finished in accordance with the manufacturer's recommendations.

Joints and edges on unformed surfaces shall be shaped the same as adjacent or similar edges or corners of the structure being repaired.

13. Curing

The repair material shall be protected against premature surface drying, rainfall, and freezing for at least 72 hours. For proprietary repair material, the manufacturer's recommendations for curing shall be followed. Replacement concrete repair material shall be protected from drying and freezing for 7 days after placement.

If curing compound is used, it shall be nonsolvent type and shall conform to ASTM C 309, Type 1-D, Class B, nonpigmented with a fugitive dye, unless otherwise specified. Curing compounds shall not be used if specifically prohibited by the proprietary repair material user guides.

14. Removal or repair

When the repaired area is honeycombed, damaged, or otherwise defective, the contractor shall remove and replace the defective repair. The engineer determines the required extent of removal, replacement, and/or repair. Removal and repair activities shall be performed only when the engineer is present.

15. Concrete repair in cold weather

For proprietary repair material, the manufacturer's recommendation together with the requirements below will be followed.

For conventional concrete mix repair material, the requirements below shall be followed.

Concrete repairing in cold weather shall be performed in accordance with ACI 306, Cold Weather Concreting, of which some specific interpretations are set forth below.

Cold weather concrete repairing shall apply when the 3-day average daily outdoor temperature at the job site is less than 40 degrees Fahrenheit. When cold weather conditions exist on the job site, the following additional provisions shall apply:

- a. The temperature of the concrete repair material at the time of placing shall not be less than 55 degrees Fahrenheit or more than 90 degrees Fahrenheit. The temperature of the mixing water shall not exceed 140 degrees Fahrenheit when the cement is added nor shall aggregate temperature exceed 150 degrees Fahrenheit.
- b. Concrete structures shall be immediately protected after placement of the concrete repair material. The temperature of the concrete repair material at the concrete surface shall be maintained at not less than 55 degrees Fahrenheit nor more than 90 degrees Fahrenheit during the 7-day protection period.
- c. Proper methods of covering, insulating, housing, or heating concrete structures shall be implemented.
- d. Exhaust flue gases from combustion heaters shall be vented to the outside of the heating enclosure.
- e. Following the completion of the protection period, the concrete repair material shall be allowed to cool gradually. The concrete repair material surface shall not have a temperature decrease of more than 40 degrees Fahrenheit in a 24-hour period.
- f. Concrete repair material placed during cold weather not meeting the cold weather definition above shall be protected by proper methods for a minimum of 24 hours after placement.

16. Concrete repair in hot weather

For proprietary repair material, the manufacturer's recommendation together with the requirements below shall be followed.

For replacement concrete repair material, the requirements below shall be followed.

For the purpose of this specification, hot weather is defined as any combination of the following conditions that may impair the quality of the freshly mixed and/or hardened concrete repair material by accelerating the rate of moisture loss and rate of cement hydration, or any other action that could contribute to detrimental results. These conditions are:

- High ambient temperature
- High concrete temperature
- Low relative humidity
- Wind velocity
- Solar radiation

Whenever these conditions exist or when climatic conditions are such that the temperature of the concrete repair material may reasonably be expected to exceed 90 degrees Fahrenheit at the time of delivery to the work site or during the placement operations, the following provisions shall apply:

- a. The contractor shall maintain the temperature of the concrete repair material below 90 degrees Fahrenheit during mixing, conveying, and placing.
- b. The exposed concrete repair material surface that tends to dry or set too rapidly shall be continuously moistened using fog sprays or other suitable means to maintain adequate moisture during the period between placement and finishing, and following finishing. Water shall not be sprinkled or added directly to the surface of the concrete repair before or during finishing.
- c. Finishing of slabs and other exposed or nonformed surfaces shall be started as soon as the condition of the concrete repair material allows and shall be completed without delay.
- d. The formed surface shall be kept completely and continuously moist for the duration of the curing period or until the application of the curing compound is completed.
- e. Concrete repair material surface, especially flat-work placed with large surface areas, shall be covered with wet burlap or other similar material as soon as the concrete repair material has sufficiently hardened and shall be kept continuously moist for at least 24 hours for the initial curing period. This protective method shall be continued for the required curing period or until the application of curing compound is completed.
- f. Moist curing may be discontinued before the end of the curing period if white, or other color selected in section 18, pigmented curing compound is applied immediately.
- g. Under extreme conditions of high ambient temperature, high concrete temperature, low relative humidity, wind velocity, and exposure to solar radiation, the engineer may:
 - (1) Restrict placement to the most favorable time of day.
 - (2) Restrict the depth of layers to assure coverage of the previous layer while it will still respond readily to vibration
 - (3) Suspend placement until conditions improve.
 - (4) Require removal of forms, repair, patching, and reapplication of wet curing by small areas at a time.

17. Measurement and payment

Method 1—For items of work for which specific unit prices are established in the contract, concrete repair volume is determined by computing the volume to the nearest 0.1 cubic foot between the neatness shown on the drawings and the approved pay limit.

Method 2—For items of work for which specific unit prices are established in the contract, concrete repair volume is determined by counting the number of premeasured, prepackaged units properly used to perform the approved repair. A premeasured, prepackaged unit is defined as a composite of all components and additives required to be mixed together before the repair material can be properly placed.

When only a part of a unit is needed to complete the filling of a repair void, it is counted as one unit. Units required to fill voids outside the approved pay limits are not counted for payment. Units mixed, but not placed in a repair void because of the contractor's improper construction operation or management are not counted.

Method 3—For items of work for which specific unit prices are established in the contract, concrete repair area is determined by measuring the surface treated and computing the area to the nearest 0.1 square foot.

All methods—The following applies to all methods of measurement and payment:

Payment for concrete repair is made at the contract unit price for the item. The payment for repair constitutes full compensation for all labor, material, equipment, transportation, tools, forms, falsework, bracing, and all other items necessary and incidental to the completion of the repair work.

Repair material required to fill voids outside the neatness or pay limits not directed or approved by the engineer and resulting from excessive removal by the contractor, damages caused by the contractor's activities, or improper construction operations as determined by the contracting officer is not measured nor paid for under this item.

Compensation for any item of work described in the contract, but not listed in the bid schedule is included in the payment for the item of work to which it is made subsidiary. Such items and the items to which they are made subsidiary are identified in section 18 of this specification.

18. Items of work and construction details

Instructions for use Construction Specifications 36—Roller Compacted Concrete

1. Applicability

Construction Specification 36 is applicable to the types of roller compacted concrete (RCC) construction entailed in NRCS operations where high material quality is not negotiable. This specification is oriented toward smaller RCC projects, such as overtopping spillways, where suitable aggregates are commercially available. Additional considerations may be required if this specification is to be used for major RCC dam projects. Areas of added and/or expanded consideration include: development of aggregate sources, mix performance, responsibility for mix design, shear strength, foundation and lift joint treatment, facing systems, seepage control, crack control, instrumentation, quality control, and test section.

2. Construction specifications

Construction Specification 63, Treatment of Rock Surfaces, shall be included with Construction Specification 36 when RCC will be installed on a rock foundation. It is recommended that Construction Specification 94, Contractor Quality Control, be used in conjunction with Construction Specification 36.

3. Material specifications

The following material specifications complement Construction Specification 36:

Aggregates—524, Aggregates for Roller Compacted Concrete

Cement—531, Portland Cement

Fly ash—532, Mineral Admixtures for Concrete

Blast-furnace slag—532, Mineral Admixtures for Concrete

Water reducing and/or retarding admixtures—533, Chemical Admixtures for Concrete

Curing compound—534, Concrete Curing Compound

4. Included Items

Items to be included in contract specifications and drawings follow:

- a. Complete engineering and structural detail drawings of the structure. (See Section 6, National Engineering Handbook.)
- b. Deviation, if any, from the requirement that the aggregate fines have a plasticity index less than four, as specified in Material Specification 524, Aggregates for Roller Compacted Concrete, Section 3, Gradation.
- c. Special provisions for acceptance of aggregate, if any, as mentioned in Material Specification 524, Aggregates for Roller Compacted Concrete, Section 5, Acceptance.
- d. Special provisions for specific mix requirements, if any, as mentioned in Material Specification 524, Aggregates for Roller Compacted Concrete, Section 5, Acceptance.
- e. Deviation, if any, from the class of pozzolan, as specified in Section 2, Material.
- f. Deviations, if any, from the requirements for aggregates, as specified in Section 2, Material.
- g. Deviations, if any, from the requirements for quantity and timing of use of cement and pozzolan specified to be stored onsite, as specified in Section 2, Material, *Material handling and processing*.
- h. The location of disposal area(s) for segregated or contaminated aggregates, as mentioned in Section 2, Material, *Material handling and processing*.
- i. Deviations, if any, from requirements for the quantity of aggregates specified to be stockpiled and maintained at the mixing plant location, as specified in Section 2, Material, *Material handling and processing*.

- j. Deviation, if any, from the requirement to provide trial mix production submittals, in writing for approval, to the engineer no later than 30 days prior to trial mix production, as specified in Section 3, Submittals, *Trial mix production submittals*.
- k. Deviation, if any, from the requirement to submit a final written plan for RCC production methods, materials, plant, equipment, and personnel 7 days prior to beginning RCC production, as specified in Section 3, Test Section, *Submittals*.
- l. Deviation, if any, from the requirement to provide RCC production submittals, in writing for approval, to the engineer no later than 24 hours after the records are produced, as specified in Section 3, Submittals, *RCC production submittals*.
- m. The minimum compressive strength for the RCC job mix, as mentioned in Section 5, RCC Mix Design.
- n. Deviations, if any, from the lab test requirements in Section 5, RCC Mix Design, *Trial mix design parameters*.
- o. Restrictions, if any, on allowing the contractor to propose the location of the test section, as mentioned in Section 6, Test Section.
- p. Deviation, if any, from the requirement that the contractor remove and dispose of the test section, as mentioned in Section 6, Test Section.
- q. Additional techniques, materials, and equipment, if any, to be demonstrated in the test section, as mentioned in Section 6, Test Section.
- r. Deviations, if any, from the tolerances on vertical surfaces in the test section, as specified in Section 6, Test Section.
- s. Deviations, if any, from the required number of cores to be extracted from the test section, as specified in Section 6, Test Section, *Compressive strength tests*.
- t. The location of disposal area(s) for waste RCC, including RCC produced from the beginning of startup until a uniform mix is consistently discharged from the mixer, as mentioned in Section 8, Mixing.
- u. The maximum RCC temperature at the time of placement, as mentioned in Section 10, Weather, *Hot weather placement*.
- v. The moisture content, depth, and degree of compaction required to prepare the foundation, as mentioned in Section 11, Foundation Preparation, *Earthen foundations*.
- w. Deviations, if any, from the required number and frequency of moisture and wet density tests to be performed on compacted RCC, as specified in Section 13, Compaction.
- x. Deviations, if any, from the required frequency of compressive strength tests and coring, as specified in Section 14, Record Testing.
- y. The joint treatment method for each joint condition, as mentioned in Section 15, Lift Joints.
- z. Restrictions, if any, on allowing the use of curing compound, as mentioned in Section 16, Curing and protection, or any deviations from the type of curing compound specified in Section 2, Material.
- aa. Deviations, if any, from the requirements for the finish and appearance of formed vertical surfaces in Section 17, Vertical Surfaces.
- ab. The requirements for the finish and appearance of unformed vertical surfaces, as mentioned in Section 17, Vertical Surfaces.
- ac. Deviations, if any, from the requirement to patch cavities or specific requirements related to patching cavities as mentioned in Section 19, RCC Repair, Replacement, and Patching.
- ad. The location of disposal area(s) for loose RCC material that falls into the basin or accumulates at the toe of the structure, as mentioned in Section 20, Cleanup of Spillage.
- ae. Deviation, if any, from the requirement that no deduction in volume is made for embedded items, as mentioned in Section 21, Measurement and Payment.

- af. Deviations, if any, from the limits of measurement as specified in Section 21, Measurement and Payment.
- ag. Deviation, if any, from including the volume of RCC in the test section in the total volume for payment under the main RCC bid item, as specified in Section 21, Measurement and Payment.
- ah. A separate bid item, if applicable, for treating rock surfaces under Construction Specification 63, Treatment of Rock Surfaces.
- ai. A separate bid item, if applicable, for the test section as specified in Section 6, Test Section.
- aj. Coordination between Construction Specification 94, Contractor Quality Control, if used, and Construction Specification 36 to provide for the specification of, and payment for, all work related to contractor quality control without conflict or overlap.

5. Methods

Section 15, Lift Joints

Typically, the same joint treatment method is specified for both intermediate and cold joints on a given project. However, on larger, more complex structures, the designer may specify different levels of treatment for these two joint conditions. For applications where the shear strength of lift joints is critical, such as large RCC dams, consider adding to the Items of Work and Construction Details the requirement that intermediate and cold joint lift surfaces be pressure washed to expose the aggregate immediately prior to placing any required treatment material and RCC on the lift surface.

Treatment Method I—Intended for use with fresh joints; or with all three joint conditions where joint bond and seepage control are not critical.

Treatment Method II—Intended for use with intermediate and cold joints where joint bond is critical.

Treatment Method III—Intended for use with intermediate and cold joints where joint bond and seepage control are critical.

Treatment Methods II and III may be specified for use with intermediate and/or cold joints, when joint bond and seepage control are not critical, as an incentive for the contractor to avoid intermediate and/or cold joints.

6. Items of work and construction details

Starting at the top of page 36-21, prepare and outline job specific “Items of Work and Construction Details” (IWCD) in accordance with these instructions. Include reference to subsidiary items as mentioned in Section 21, Measurement and Payment.

Construction Specification 36—Roller Compacted Concrete

1. Scope

The work shall consist of furnishing all materials, tools, equipment, and mixing plant; and performing all labor for the mixing, transporting, forming, placing, compacting, and curing of roller compacted concrete (RCC) as required to install the structure(s) as shown on the drawings and designated in section 22 of this specification and the test section designated in the same section.

2. Material

Portland cement shall conform to the requirements of Material Specification 531, Portland cement. Type III or Portland cement shall not be used.

Pozzolan shall conform to the requirements of Material Specification 532, Mineral Admixtures for Concrete. Fly ash shall be class F unless otherwise specified. The source of pozzolan shall consistently supply material with similar chemical and physical properties.

Combined aggregates shall conform to the requirements of Material Specification 524, Aggregates for Roller Compacted Concrete, unless otherwise specified.

Water incorporated into the mix or used for curing RCC shall be clean and free from injurious amounts of oil, salt, acid, alkali, organic matter, turbidity, or other deleterious substances. Water shall conform to the requirements of ASTM C 94 except that wash water shall not be used for mixing RCC.

Water-reducing, set-retarding admixture shall conform to ASTM C 494, type D.

Curing compound shall conform to the requirements of Material Specification 534, Concrete Curing Compound. Curing compound shall be furnished in containers that have not been previously opened and that have the original manufacturer's labels attached.

Bonding mortar shall consist of cement, sand, water, and a water-reducing, set-retarding admixture to retard the set and control the consistency of the mortar. The cement, water, and admixture shall be as specified. Sand shall comply with ASTM C 33 for fine aggregate. The mortar shall be mixed in the proportions 1 part cement to 2.5 parts sand, by weight. Water content shall be sufficient to provide a spreadable consistency. In combination with the admixture, the maximum water-to-cementitious materials ratio shall be 0.45. The mortar slump shall be 7 to 9 inches when tested in accordance with ASTM C 143. The admixture shall be included at the manufacturer's recommended dosage so that the initial set time is retarded at least 3 hours when the ambient air temperature is 95 degrees Fahrenheit.

Material testing—The contractor shall test materials or provide certified test results to ensure all materials conform to the specified requirements. All nonconforming materials shall be promptly removed from the job site, including those that have been incorporated into the work.

Aggregate sampling shall be in accordance with ASTM D 75.

Aggregate samples shall be taken from stockpiles, belt feeders from bins, the mix plant feed conveyor belt(s), the mixer feed conveyor belt, or from the pug mill discharge while only aggregate is discharged from the pugmill.

When obtaining aggregate samples from stockpiles, samples shall be obtained from various parts of the stockpiles, but never from the perimeter of the lower third of the pile.

The contractor shall provide access for material sampling and performance of quality assurance testing activities at material storage sites.

Sampling—The contractor shall provide suitable platforms, tools, equipment, and labor necessary for obtaining representative samples of materials to be used for the contractor's quality control testing and for the Government's quality assurance testing. Samples may be taken from stockpiles, aggregate bins and feed belts, entrance to the mixer, mixer discharge, gob hopper discharge, points in transit, or the placement area.

Material handling and processing—Transportation of cement and pozzolan to the batching plant shall be accomplished in weather-tight trucks, conveyors, or other means that will completely and thoroughly protect the cementitious materials from exposure to moisture and contaminants.

The temperature of cement and pozzolan when delivered to the job site shall not exceed 160 degrees Fahrenheit. The temperature of the cement and pozzolan shall be determined by direct insertion of a thermometer into the material in the delivery truck. The temperature of air to transport cement into storage containers or silos shall not exceed 180 degrees Fahrenheit. It may be assumed that the temperature of the air in the transfer pipe is the same as the temperature on the outside surface of the transport pipe. The temperature of the air shall be determined by measuring the temperature on the outside of the transport pipe with a surface thermometer.

Immediately upon receipt at the job site, cement and pozzolan shall be stored in dry, weather-tight, ventilated structures. All storage facilities shall permit easy access for inspection and identification. Sufficient cement and pozzolan shall be stored onsite at all times to complete a minimum of 24 hours of placement at the planned average production rate, unless otherwise specified. Cement and pozzolan that have been stored at the site for the longest period shall be used first, unless otherwise specified.

Aggregates shall be transported to the site in two or more components that will be combined in the mix plant to meet the overall aggregate gradation. Aggregate components shall be of a gradation that will minimize segregation prior to introduction into the mixer. Aggregates shall be stored in stockpile(s) in the designated contractor use area. Aggregate components shall be stockpiled separately. Aggregates shall be handled and stockpiled in a manner to prevent intermixing between dissimilar aggregates and to prevent contamination of the aggregate. Coarse and fine aggregates shall remain separated until they are introduced into the mixing plant. For plants that mix in discrete batches, the coarse and fine aggregates shall be fed separately into the batch hopper. For mix plants that mix continuously, the coarse and fine aggregates shall remain separated until they are dropped onto the belt that delivers the aggregates to the mixing compartment. The contractor shall develop and utilize methods that reliably and consistently withdraw and transport the aggregates from the stockpile without contamination or segregation. Segregated or contaminated aggregates shall not be used in production of the RCC and shall be disposed of in locations specified in section 22.

A 2-week supply of aggregates, based on the average planned weekly production rate, shall be stockpiled at the mixing plant location or other approved location, prior to RCC production unless otherwise specified.

Sufficient water shall be available for mixing and curing to complete a minimum of 24 hours of placement at the average planned production rate.

3. Submittals

Manufacturer's certifications and test reports shall in no way relieve the contractor of the responsibility for furnishing materials that meet the specified requirements. Manufacturer's certifications and test reports shall be produced and dated within the 6 months preceding the delivery of the submittal. The test

method used shall be noted on all test reports. Any deviation from standard test methods shall be detailed in the test report and the reason for the deviation shall be given.

Trial mix production submittals—The submittals listed below shall be provided, in writing for approval no later than 30 days before trial mix production, unless otherwise specified. Trial mix production shall not proceed before approval of these submittals.

- a. The name and qualifications of the laboratory that will perform the mix design.
- b. The source(s) from which the cementitious materials will be obtained along with a certified mill test report for each type of cement, pozzolan, and/or blended cement that will be used to produce RCC. The certified mill test report shall verify that the cement, pozzolan, or blended cement conforms to the applicable material specification.
- c. The source from which the aggregate will be obtained and certified test results showing that all aggregates conform to the specification.
- d. The source from which the water will be obtained and the certified test results showing that water to be used in the mix conforms to ASTM C 94.
- e. The source of the admixture along with certified test results showing that the admixture conforms to the specification.

RCC pre-production submittals—The submittals listed below shall be provided, in writing for approval, to the engineer. The submittal for the job mix and bonding mortar shall be furnished 30 days before delivery of any RCC or bonding mortar component materials to the site. The submittal for the plant and equipment, personnel, and test section plan shall be provided no later than 30 days before delivery of the plant or equipment to the site. RCC materials or equipment shall not be delivered to the site before approval of these submittals.

Job mix

- a. A certified statement of materials, mix proportions (reported for saturated surface dry aggregate), theoretical air-free density (TAFD), moisture/density curves (wet density only), Vebe time, air content, unit weight of mix in air pot just prior to testing air content, and all compressive strength test results for each of the three mixes required in the development of the RCC job mix.
- b. Gradation of each of the aggregate component and combined aggregates used in each mix developed in the mix design program.
- c. The compacted bulk density and voids in each of the aggregate components and combined aggregates used in each mix developed in the mix design program.
- d. A statement of materials and mix proportions used in each mix developed in the mix design program.
- e. A statement of materials and mix proportions proposed to be used in manufacturing the RCC job mix.

Bonding mortar

- a. A statement of materials and mix proportions to be used in manufacturing the bonding mortar.

Plant and equipment

- a. The planned RCC component material production, transportation, and storage and temperature control procedures. Anticipated peak production capacity, normal production capacity, and onsite storage volumes shall be included in the plan.
- b. Mixing plant manufacturer's data and operating instructions and the plant layout to include a schematic drawing of the plant and materials storage with a narrative description providing its peak capacity, normal anticipated production rate, and results of the most recent uniformity tests

conducted within the previous 12 months. The proposed location of the mixing plant relative to the placement site(s) shall be provided.

- c. A narrative description and a layout of the equipment and methods to be used for delivering and depositing RCC at the placement site(s).
- d. The type and expected number of pieces of equipment required for all placing, spreading, and compaction of the RCC.
- e. The plan for obtaining the specified vertical surfaces.
- f. The method and procedure for curing of the in-place RCC, including the type of curing compound if used.
- g. The method and procedure that will be implemented to provide protection of RCC from temperature extremes, including the type of external heating equipment and insulating materials to be used.

Personnel

- a. The names and qualifications of the supervisor and plant operator who will direct the batching, mixing, and placing of RCC.

Test section plan

- a. The contractor's proposed location for the test section and equipment, materials, personnel, and methods to construct the test section as specified. The submittal shall include plans for the pre- and post-test section briefings.

Test section submittals—Within 24-hours of completing the tests or test section, the following information shall be transmitted to the engineer in writing.

- a. Results of moisture and density tests used to compute the apparent maximum density (AMD). Include the results of all density tests made of RCC in the test section.
- b. Lift maps of the test section.
- c. Results of compressive strength tests.
- d. Air content and unit weight of RCC.
- e. Production plan that includes RCC production methods, materials, plant, equipment, and personnel as modified based on the results from the performance of the test section that have been documented to produce RCC that meets the requirements of the specification.

Unless otherwise specified, 7 days prior to beginning RCC production, submit a final written plan for RCC production methods, materials, plant, equipment, and personnel that will produce RCC that meets the requirements of this specification.

RCC production submittals—The following submittals shall be provided in writing within 24 hours after delivery tickets, records, or test results are produced, unless otherwise specified.

- a. Delivery tickets for cement and pozzolan shall include the source, date manufactured or produced, type or class, contractor's name, project name, and a certification that the material meets the specification requirements.
- b. Delivery tickets for aggregates shall include the source, material description, date, and certification that the material meets the specification requirements.
- c. Delivery tickets for bonding mortar shall include name and location of batch plant, ticket number, load and truck number, date, destination, class of cementitious materials, mix proportions, quantity of bonding mortar, time mixer drum charged with cement, and recording of revolution counter (transit-mixed concrete). If bonding mortar is produced on site, the above required information shall be provided as applicable.

- d. Records of climatic conditions shall be collected on a daily basis and reported on a weekly basis.
- e. Mix plant production records and summary of daily material use and RCC produced shall be submitted before the start of the next production shift. Production records shall include a comparison of actual materials used to the approved job mix.
- f. Results of RCC moisture and wet density tests.
- g. Results of uniformity tests.
- h. Results of compressive strength tests.
- i. Results of RCC temperature tests.
- j. Lift maps shall be submitted before the start of the next production shift.

4. Personnel

There shall be a supervisor who is responsible for all aspects of the RCC operation and a plant operator who is solely responsible for batching and mixing. The supervisor and the plant operator shall have responsible experience on at least one previous RCC job in the same position for which they are being considered for the current job.

There shall be at least one person whose sole responsibility is the oversight of the RCC curing activities.

5. RCC mix design

The contractor shall be responsible for the mix design and selection of all materials to be used in the design mix. The materials and proportions so stated, when approved, shall constitute the job mix. The job mix(s) shall be prepared to meet the quality, consistency, and strength of the RCC specified.

The contractor shall conduct the mix design program at a materials testing laboratory staffed by American Concrete Institute (ACI) Certified Grade II Concrete Laboratory Testing Technicians.

Trial mix design parameters—The aggregate gradation shall be as specified. The bulk density and voids in each of the aggregate components and the combined aggregate shall be determined according to ASTM C 29.

The density, relative density, and absorption shall be determined according to ASTM C 127 for coarse aggregate and ASTM C 128 for fine aggregate.

The air content of each mix shall be determined according to ASTM C 231. The volume and tare weight of the air pot shall be determined according to ASTM C 138. After consolidating the RCC in the air pot and just prior to testing to determine the air content, the weight of the RCC and pot shall be determined according to ASTM C 138. The density of the RCC that is consolidated in the pot at the time of testing shall be computed.

The minimum compressive strength for the RCC job mix shall be as specified in section 22 of this specification.

Unless otherwise specified in section 22:

- A minimum of three separate mixes shall be developed in the laboratory.
- Pozzolan(s) shall comprise at least 20 percent (by volume), but shall not exceed 50 percent (by volume) of the cementitious materials.
- The remainder of the cementitious materials shall be comprised of Portland cement.
- A compaction curve (wet density only) shall be developed for each mix to determine the water content that corresponds to the maximum wet density of each mix. Compaction tests shall be performed in accordance with ASTM D 1557, adapted as follows:

- o The mold specified for Method C shall be used.
- o All mix components shall be included.
- o When the maximum size aggregate in the mix is larger than 3/4 inch, place the material in three layers into the mold and compact each layer with 94 blows of the hammer.
- A Vebe test shall be performed on each trial mix design to determine the Vebe consistency time in seconds and the wet density in pounds per cubic foot. The Vebe test shall be performed according to ASTM C 1170. The Vebe consistency time shall range from a minimum of 15 seconds to a maximum of 30 seconds.

Theoretical air free density—The theoretical air free density (TAFD) shall be computed for each of the three laboratory mixes in the mix design program. The TAFD is the maximum wet density that can be attained for a specific mix assuming there is no air (entrapped or entrained) in the mix. The TAFD shall be computed by dividing the sum of the individual weights of the mix components by the sum of the individual absolute volumes of the mix components. The absolute volume is the volume of the solid matter in the particles, exclusive of the volume of voids between the particles. The absolute volume of each mix component is determined as per ACI 211. The saturated surface dry weight and density of the aggregate shall be used when computing the TAFD.

Laboratory compressive strength—Fifteen compressive strength cylinders from each RCC mixture shall be prepared in accordance with ASTM C 1176 or C 1435 and weighed to determine the density of the RCC within each cylinder. Any cylinder that weighs less than 98 percent of the weight of the heaviest cylinder shall be discarded and another cylinder prepared and weighed until all 15 cylinders have a weight that is at least 98 percent of that of the heaviest cylinder. The water content of each mixture, from which cylinders are made, shall be within 0.5 percent of the water content that corresponds to the maximum wet density determined in accordance with ASTM D 1557. Three cylinders from each RCC mixture shall be tested at 7, 14, 28, 90, and 180 days for compressive strength in accordance with ASTM C 39.

The average of the two closest 28-day strength values shall represent the 28-day compressive strength of the mix. The 28-day compressive strength of at least one of the mix designs shall be 75 percent to 100 percent of the specified strength. The 28-day compressive strength of at least one of the mix designs shall be 100 percent to 125 percent of the specified strength. The 28-day compressive strength of the remaining mix design shall approximate the specified strength.

The cementitious materials content that will be used for the job mix will be based on the results of the 28-day compressive strengths of the three laboratory mix designs. The 28-day compressive strengths of each of the three laboratory mix designs will be plotted to form a curve showing the relationship of the cementitious materials content to the 28-day compressive strength of the laboratory mix designs. A cementitious material content shall be selected from this curve corresponding to the 28-day compressive strength specified in section 22. The proposed job mix shall be proportioned to contain the selected cementitious materials content and shall be submitted for approval.

After the job mix has been approved, neither the source, character, or grading of the aggregates; nor the source mill, type, brand, or quantity of the cement; nor the source, type, or quantity of the pozzolan; nor the type, brand, or quantity of the chemical admixture(s) used shall be changed without approval. Changes to the approved job mix will require submittal and approval of a new job mix that complies with the requirements of this specification.

6. Test section

Prior to RCC production the contractor shall construct a test section as part of the RCC placement operations. RCC production is defined as the mixing of RCC to be incorporated into the work and the

placing and compacting of RCC, to the specified density, within the specified lines and grades of the structure(s). Unless otherwise specified in section 22, the test section shall be installed at an approved location proposed by the contractor. If the contractor constructs the test section in a location that will be incorporated into the RCC structure, it shall be located in a noncritical part of the structure, and it shall be removed if it fails to meet the requirements of this specification. If the contractor constructs the test section in a location that will not be incorporated into the structure, the contractor shall remove and dispose of the test section upon completion of the testing requirements unless otherwise specified.

All RCC that is incorporated into the structure and placed prior to determining the AMD shall be compacted to a density that is at least 96 percent of the TAFD. All RCC incorporated into the structure after the AMD is determined shall be compacted to specification requirements.

The test section shall be used to demonstrate all techniques, materials, plant and equipment, and personnel to be used for RCC construction and quality control. Additional techniques, materials, equipment, and personnel shall be demonstrated in the test section as specified in section 22. Information gained will be used to evaluate the practical effectiveness of all techniques, materials, plant and equipment, and personnel to make minor adjustments to the mix and to determine the AMD of the approved job mix. The contractor shall allow for numerous stops and starts to facilitate the testing that is required to determine the AMD.

The test section shall be of sufficient size to allow the complete RCC placement and compaction operation to be conducted with the equipment operating at normal operating speeds.

When the test section is placed on soil, a minimum of two 12-inch lifts shall be placed, and tests for determining the AMD shall be conducted on the uppermost lift.

A section shall be constructed to determine the adequacy of the procedures implemented to construct vertical surfaces. Any surface that is not horizontal is, within this specification, considered to be a vertical surface. Unless otherwise specified in section 22, the tolerance of vertical surfaces shall conform to the requirements of section 18. The finish and appearance of formed and unformed vertical surfaces shall comply with the requirements specified in section 17.

The contractor and engineer shall conduct the pre-test section briefing to review the field status related to the preparedness, capability, and readiness of the contractor to construct the test section according to the approved plan. After test section construction and before RCC production, the contractor and engineer shall conduct the post-test section briefing to discuss adjustments to the techniques, materials, plant, equipment, and personnel that will be used in RCC production. The contractor shall submit in writing a final plan for RCC production methods, materials, plant, equipment, and personnel that will produce RCC that meets the requirements of this specification. Unless otherwise specified, the plan shall be submitted no later than 7 days prior to beginning RCC production. Written approval of the plan shall be required prior to beginning RCC production.

Apparent maximum density—AMD is the maximum RCC density of the approved job mix that can be attained by compacting the RCC with the production roller defined in section 13 of this specification. The AMD shall be greater than or equal to 98 percent of the TAFD. The AMD of the RCC shall be determined from the test section.

To determine the AMD, the RCC lift shall be compacted by successive passes of the production roller over the entire lift surface. (Note: The act of rolling forward past a point and then rolling in reverse past the same point is considered two passes.) Between passes of the production roller, in-place wet density tests (ASTM C 1040) shall be made at a depth of 12 inches. Density tests shall be initiated after the second pass of the production roller. A minimum of two density tests shall be performed at a depth of

12 inches and at approved locations. Successive passes of the production roller, followed by density tests at the 12-inch depth, shall be made until the density of the lift no longer increases. Once it has been determined that the density measurement at the 12-inch depth is no longer increasing, density tests shall be taken in two locations at depths of 2, 4, 6, 8, 10, and 12 inches. If the maximum and minimum density values obtained in one test hole vary more than 2 percent of the maximum value obtained at that test hole, the contractor shall modify operations until this variation is no more than 2 percent.

When the density of the lift no longer increases and the density measurements taken at the specified depths vary no more than 2 percent, the density shall be measured at the 10-inch depth at six approved locations. If more than one of these density measurements results in values less than 96 percent of the TAFD, the contractor shall modify operations and repeat the process for determining the AMD. The AMD shall be the average of the in-place density test values that are greater than or equal to 96 percent of the TAFD of the job mix. If the AMD is less than 98 percent of the TAFD of the job mix, the contractor shall modify operations to attain an AMD that is at least 98 percent of the TAFD.

If a new job mix is approved during production of RCC, a new TAFD will be computed and a new AMD will be determined as previously specified.

Air content and density - The air content of the mix shall be determined according to ASTM C 231. The volume and tare weight of the air pot shall be determined according to ASTM C 138. After consolidating the RCC in the air pot and just prior to testing to determine the air content, the weight of the RCC and pot shall be determined according to ASTM C 138. The density of the RCC that is consolidated in the pot at the time of testing shall be computed.

Compressive strength tests—Fifteen compressive strength cylinders shall be prepared from the mix in accordance with ASTM C 1176 or C 1435 and weighed to determine the density of the RCC within each cylinder. Any cylinder that weighs less than 98 percent of the weight of the heaviest cylinder shall be discarded and another cylinder prepared and weighed until all 15 cylinders have a weight that is at least 98 percent of that of the heaviest cylinder. Three cylinders shall be tested at 7, 14, 28, 90, and 180 days, respectively, for compressive strength in accordance with ASTM C 39.

Unless otherwise specified in section 22 of this specification, the contractor shall extract 10 intact vertical core samples, in accordance with ASTM C 42, from a portion of the test section that has been placed to the specified density and cured in accordance with this specification. Core specimens shall be taken 13 days after the RCC is placed. The contractor shall test two samples at 14, 28, 56, 90, and 180 days, respectively, for compressive strength in accordance with ASTM C 42. Cores shall have a minimum length equal to one lift thickness and a nominal diameter of 6 inches.

7. Mix plant

The plant shall either be a batch-type pugmill or a continuous-flow pugmill. The pugmill shall be a twin shaft paddle-type mixer and shall have adequate capacity to produce a uniform RCC mix at a rate that will conform to the production schedule. The plant shall have a minimum capacity of 100 tons per hour.

The plant shall have demonstrated satisfactory reliable performance on similar mixes on other RCC projects with little or no down time because of mixer breakdown or other production-related problems, excluding normal maintenance. Satisfactory reliable performance of the proposed plant shall be documented by mixer uniformity tests from recent production work showing that the plant produced a mix of similar proportions that met the requirements for production rate and uniformity set forth in this specification.

The results of uniformity tests that are conducted after the plant is set up and calibrated may be substituted for documentation of reliable past plant performance. RCC produced during uniformity tests required herein shall not be incorporated into the test section or any permanent structure.

The contractor shall perform trial runs of the mixing and proportioning equipment, including uniformity tests if required.

Accuracy. Facilities shall be provided for the accurate measurement and control of each of the materials entering the RCC mix. Delivery of materials as they are discharged from the mixer and from any gob hoppers shall be within the tolerances shown in table 36-1.

Table 36-1 Tolerances in proportioning the various ingredients

Material	Tolerance
Pozzolan, mass	± 2 %
Cement, mass	± 2 %
Aggregate, mass	± 3 %
Water, mass or volume	± 2 %
Chemical admixture, mass or volume	± 3 %

Component monitoring systems. The systems that meter individual mix components shall be interlocked with the plant control and shall warn the operator and shut down the plant if any component is not feeding into the mixing chamber.

Aggregate bins. A separate bin shall be provided for each gradation of aggregate supplied for the RCC job mix. The bins and associated conveyors shall be capable of discharging and conveying the aggregates at a uniform rate without clogging, under all conditions.

Portland cement and pozzolan silos. All onsite storage facilities and connection hoses shall be properly labeled with readily visible signage. The storage silo(s) shall be weather tight to prevent moisture and contaminants from accessing the portland cement and pozzolan. Blended cement/pozzolan products mixed by the cement manufacturer are permitted. Silos shall be capable of dispensing at a uniform rate without clogging or bridging of the materials.

Portland cement, pozzolan, and aggregate feed. For a continuous-flow pugmill, the portland cement, pozzolan, and aggregates shall be uniformly, continuously, and simultaneously fed into the mixing mechanism at the appropriate ratios. Each bin opening shall be provided with a gate that can be maintained at the necessary opening size to consistently provide the correct feed rate. The bins shall be of sufficient size to assure a uniform flow of aggregate at a constant rate. Portland cement and pozzolan shall be fed continuously by a feed device that is adjustable to ensure a uniform flow of cement and pozzolan at a constant rate for proportions established by the approved job mix. Feed device(s) shall be capable of gradual adjustment while in operation.

Water dispenser. A suitable water facility shall be provided that is capable of metering and dispensing the mix water within the specified tolerances. The mechanism for delivering water to the mixers shall be free from leakage. The meter shall measure the weight of water being added in pounds per unit time for continuous-flow pugmills, and weight per batch for batch-type pugmills. The valve shall be capable of gradual adjustment during the mixing process to compensate for varying moisture contents in the aggregates.

Admixture dispenser. The liquid admixture dispensing system shall be capable of metering and dispensing within the specified tolerances. The dispenser shall be designed and installed in such a manner that will permit convenient checking of its accuracy and will assure uniform distribution of the liquid admixture with water to the materials entering the mixer. The system shall be leak-free and designed and installed to prevent backflow or siphoning.

Mixing mechanism. The mixing mechanism shall be capable of combining the materials into a uniform mixture and discharging this mixture without segregation. The mixing mechanism shall produce a mix that meets the uniformity requirements listed in table 36–2.

Uniformity tests. When a continuous-flow pugmill is used, the three samples for obtaining uniformity tests shall be taken from RCC produced near the beginning, the middle, and the end of a production run lasting a minimum of 1 minute. When a batch-type pugmill is used, the samples shall be taken from RCC produced from three separate batches. Each batch shall be similar in size, be produced by charging the mixer in a similar manner, be mixed at the same mixing speed and mix retention time as the other two batches, and be representative of a normal production run.

Table 36–2 Requirements for uniformity

Test	Allowable max. difference ^{1/}	ASTM standard
Water content of full mix (% by weight) (Select one of the ASTM standard tests listed)	10%	C 566 D 2216 D 3017 D 4643 D 4959
Coarse aggregate content (% by weight)	10%	C 685 (annex)
Density (lb/ft ³) of full mix	2%	C 1170, C 1176, C 1435
Compressive strength at 14 days (lb/in ²)	15%	C 39 ^{2/}

^{1/} The allowable maximum difference = 100 multiplied by the (maximum value – minimum value) divided by the average of three tests.

^{2/} Cylinders shall be made in accordance with ASTM Standard C 1176 or C 1435.

Mix record. The mix plant shall be capable of continually producing an RCC mix record. The record shall show the weight of portland cement, pozzolan, water, aggregate, and weight or volume of chemical admixture that is processed through the plant during a specific time interval. The time interval shall not exceed 30 minutes. The aggregate shall be reported in terms of saturated surface dry weight processed through the plant during a specific time interval. The RCC mix record shall be produced at all times when the plant is producing a mix. The aggregate moisture shall be tested daily whenever RCC is being produced. The mix plant record shall include the aggregate moisture content tests upon which the batch proportions are based.

A summary shift record shall be provided. The record shall include the total quantity of each constituent in the mix, total quantity of RCC produced, and a comparison of the quantity of each constituent mixed per cubic yard to that of the job mix.

Noise pollution. The plant shall be operated to comply with all applicable regulations pertaining to noise pollution.

Pollution control. The plant shall be operated to comply with all applicable regulations pertaining to air and water quality.

8. Mixing

The plant shall be operated according to the manufacturer's recommendations. The mixing mechanism shall be maintained in satisfactory operating condition and shall be cleaned after each production run. All supply bins and silos shall be kept sufficiently full to ensure a uniform and constant flow of all materials.

All RCC produced from the beginning of startup shall be disposed of at the location(s) specified in section 22 of this specification until a uniform mix of the required proportions is consistently being discharged from the mixer.

After a batch-type pugmill has been calibrated and has produced the job mix with the specified uniformity, the mix retention time shall not be reduced.

Uniformity—RCC uniformity shall be monitored by continuous visual inspection by the plant operator and by periodic visual inspection by contractor quality control personnel. The mix shall be visually inspected for uniformity by contractor quality control personnel at the beginning of each production run and at least once each hour during the production run. If it becomes apparent that the mixer is not producing a uniform mix of the proportions specified, RCC production shall be promptly discontinued until the problem(s) that caused the uniformity problem are discovered and corrected.

If a uniformity problem is suspected, the contractor shall conduct the tests listed in table 36-2, determine the maximum difference and compare to the allowable maximum difference, and take appropriate corrective measure(s).

Adjustments shall be made to the mixing plant as necessary to obtain the required uniformity and consistency of the RCC mix when uniformity test results indicate that the requirements for uniformity are not being met. The production and placement of RCC may proceed without waiting for the compressive strength results if the results of the other three tests listed in table 36-2 are within the allowable maximum difference and the issues that caused a uniformity problem are resolved.

9. Conveying

The RCC mix shall be conveyed from mixer to placement area as rapidly as practicable by methods that prevent segregation, contamination, and loss of water. The total length of time from the end of mixing until the RCC has been placed, spread, and compacted shall not exceed 45 minutes.

The contractor shall provide baffles to limit free fall of mixed RCC to a maximum of 5 feet at the discharge end of conveyors, within hoppers, and at other locations where the potential for segregation may occur. Chutes that tend to cause segregation, such as an inclined chute, will not be permitted.

Communications—Telephone, radio, or other voice communication shall be provided between all interim storage hoppers, the batch plant control, and the placement locations. The contractor shall provide the Government inspector the same form of communication.

Temporary storage containers—Gob hoppers shall be used for storage wherever the mixed RCC is temporarily accumulated prior to being loaded into hauling equipment and when direct conveyor systems do not otherwise provide continuous delivery to the final placement location. Gob hoppers shall be configured to allow free flow of RCC without segregation or choking.

Conveyor belts—The conveyor system design and layout shall provide for adequate capacity, speed, reach, and pivot points to convey RCC to all placement areas.

Conveyor belts shall be designed, erected, operated, and maintained in a manner that meets production requirements and does not segregate materials. RCC shall not be exposed on any belt for a period exceed-

ing 5 minutes without being protected from the drying elements of wind and sun. RCC shall not be exposed on any belt during rainfall unless it is protected from the rain.

Hauling equipment—Equipment shall be maintained in good operating condition and shall not be permitted onto the RCC surface when vehicle fluids are leaking or when there is a potential for contamination to the RCC.

RCC may be hauled using trucks, front-end loaders, or scrapers. Hauling equipment that rut, score, mar, or indent the RCC surface shall not be operated directly on previously compacted RCC surfaces. Hauling equipment shall not track mud or other contaminants onto previously placed RCC and shall not be operated directly on uncompacted RCC. All hauling vehicles shall be operated in a manner that prevents tight turns, sudden stops, or other actions that cause damage or displacement to previously compacted RCC. The contractor shall implement necessary measures to prevent contamination or damage of the previously compacted RCC.

10. Weather

Adverse weather—In adverse weather (heavy rain, severe cold, heavy snow, and hot temperature) where the conditions specified herein for RCC construction cannot be maintained, an interruption in placing operations shall be required.

Weather station—The contractor shall install and maintain a weather station onsite at all times during performance of the test section and the production and placement of RCC. The weather station shall be located at an approved location near the RCC structure. The weather station shall record wind speed, ambient temperature, humidity, and the rate and cumulative volume of rainfall. A record of climatic conditions at the designated location including wind speed, ambient temperature, humidity, and rainfall rate and volume shall be recorded daily.

Wet weather placement—RCC shall be protected from rainfall induced erosion and shall not be placed during rainfall events at a rate equal to or greater than 0.1 inch in 20 minutes. Placement during a light mist may continue when covered belt conveyors rather than hauling vehicles are used to convey the mix. Placement of RCC will not be permitted when rainwater accumulates on compacted RCC surfaces.

Cold weather placement—RCC shall not be placed when the ambient air temperature drops below 35 degrees Fahrenheit or the temperature of the RCC mix is less than 40 degrees Fahrenheit.

Hot weather placement—The maximum temperature of the RCC at time of placement shall be as specified in section 22. After placing, but prior to compaction, the temperature of the mix shall be determined according to ASTM C 1064. When the RCC temperature is within two degrees of the specified limit it shall be measured every hour. Introduction of chilled water and/or ice, shading and/or cooling of the aggregates, or other measures may be required in the production of RCC to maintain the RCC temperature within the specified requirements. If the RCC temperature exceeds the maximum specified temperature, RCC placement shall be suspended until cooler weather or additional measures to reduce the RCC temperature results in a reduction of the placement temperature of the RCC to or below the specified maximum temperature.

11. Foundation preparation

Prior to the start of RCC placement, the foundation shall be excavated or filled to the specified lines and grades as shown on the drawings. The foundation shall be free of standing water and any organic or loose materials. All surfaces where RCC installation is specified shall be damp and have a surface temperature not less than 35 degrees Fahrenheit at time of placement. Placement of RCC on mud, dried earth, uncompacted fill, standing water, or frozen subgrade is not permitted.

Earthen foundations—Earthen foundation surfaces shall be prepared by adjusting the moisture content and compacting the foundation. The moisture content, depth, and degree of compaction required shall be as specified in section 22. If the earthen foundation is allowed to dry after compaction, it shall be moistened prior to placing RCC. The foundation surface shall be firm and damp.

Rock foundations—Rock foundations shall be cleaned and prepared as specified in Construction Specification 63, Treatment of Rock Surfaces. The slope of the finished foundation surface shall not be steeper than one horizontal to one vertical. Rock surfaces shall be damp at the time of RCC placement.

12. Placing and spreading

The placement of RCC into the structure shall be performed in a virtually continuous non-stop operation.

All equipment used on the RCC fill shall be maintained in good operating condition at all times. Equipment shall not drip or spill oil or other contaminants onto the RCC. Any equipment that contaminates the RCC mixture shall be promptly removed from contact with the RCC and repaired or replaced. Any contaminated RCC mixture shall be removed and replaced.

Placing and spreading shall be performed with equipment that does not mar or contaminate the surface of the compacted RCC. Track-type equipment shall not operate directly on compacted RCC unless the tracks are equipped with rubber pads. Equipment used to deposit, spread, or compact shall not turn on previously compacted RCC.

Layout of the placement area—The RCC shall be spread in level lifts across the entire area of the structure. The direction of RCC placement shall be parallel to the long axis of the structure so that the number of lanes and the number of edge joints are minimized. Transverse joints of adjacent lanes shall be offset by no less than 20 feet - horizontally.

Placing—RCC mix, bonding mortar, Portland cement, neat cement grout, or concrete shall not be placed on previously placed layers that have not been compacted to the specified density.

Roller compacted concrete mix shall be deposited as near to its final location as possible. When haul vehicle delivery is used, depositing shall be accomplished with a dump-spread action while the placing vehicle is moving. Belt placement shall discharge with a spreading action that does not segregate the material. RCC shall not be deposited directly against formwork or other vertical surfaces. Piles that form when placing RCC shall not contact forms or vertical surfaces. Neither the discharge height nor the pile height of RCC shall exceed 5 feet.

Spreading—Spreading of the RCC shall be completed within 10 minutes following depositing. RCC shall be spread into an uncompacted, uniform lift thickness that can be compacted to produce a lift of the specified thickness and density. In areas requiring special compaction, it may be necessary to deposit, spread, and compact the RCC in several layers to produce a lift of the specified thickness and density.

Equipment shall not operate directly on any surface that has been cleaned and prepared to receive a subsequent lift of RCC.

Spreading of RCC material shall be performed with a track-type bulldozer in a manner that will not cause damage to previously compacted RCC.

With RCC placement at or near its final location, spreading will typically be limited to leveling the RCC into uniform lifts. In isolated or confined placement locations, the RCC may be deposited and spread up to a maximum distance of 50 feet provided segregation does not occur, specified spreading time is not exceeded and the time specified between mixing and a completion of compaction is not exceeded. The

contractor shall conduct placing and spreading operations in a manner that will prevent segregation of RCC.

If segregation of RCC occurs during the spreading operation, it shall be corrected by immediately reworking the RCC. Reworking shall be performed using techniques that do not damage previously compacted RCC. This may require removing the RCC from the lift surface to accomplish reworking, then transporting the mix back onto the surface after mix uniformity has been achieved. If reworking the RCC does not produce a uniform mix, the segregated RCC shall be wasted and replaced.

If a uniformity problem is suspected, uniformity tests shall be performed from material taken from the placement area following spreading of the material and/or other points in the RCC production process as required to identify the source of the problem. Three individual samples of the material shall be taken at the sample location at intervals of 5 minutes or more. Uniformity tests shall be conducted in accordance with table 36-2. The maximum difference between the resulting values shall be compared to the allowable maximum difference and appropriate corrective measure(s) shall be employed.

13. Compaction

The entire surface area of each RCC lift shall be compacted to the specified density, as determined from the apparent maximum density (AMD) specified in section 6, with adequate compaction overlap to assure complete compaction of the RCC.

The in-place wet density of the compacted RCC measured at a depth of 10 inches shall not be less than 98 percent of the AMD.

Uniformity of density shall be achieved within each lift. The difference between density measurements at any two depths that are a minimum of 6 inches apart shall not exceed 2 percent of the greater of the two values.

The wet density of the compacted RCC shall be tested in accordance with ASTM C 1040. The moisture content of the compacted RCC shall be tested in accordance with ASTM D 3017. Unless otherwise specified in section 22, a minimum of three moisture and density tests will be performed on each lift of RCC with no less than one density measurement and moisture measurement for each 100 cubic yards of RCC compacted.

Production compaction shall be performed with production rollers as defined in this section. RCC compacted with production rollers shall be compacted in single lifts that are 12 inches thick (plus/minus one inch) after the specified density has been achieved.

Production rollers shall consist of single or double drum, large, self-propelled vibratory rollers. The roller(s) shall transmit a centrifugal force to the surface through a smooth steel drum(s) by means of revolving weights, eccentric shafts, or other equivalent methods. Production rollers shall impart a centrifugal force of at least 450 pounds per inch of drum width at the operating frequency during compaction. Production rollers shall operate at a vibrating frequency of at least 1,500 vibrations per minute and have a drum diameter of 4 to 6 feet and a drum width of 5 to 8 feet. The amplitude of vibration of the roller shall be between 0.03 and 0.07 inch. The roller shall not travel at greater than 2 feet per second during the compaction operation.

Production rollers shall be used in open areas where they can compact RCC to the specified density within the specified time and without damage to the structure, forms, foundation, or appurtenances.

Rollers shall be only operated in the vibratory mode while actively compacting the RCC. After the RCC has been deposited and spread, rollers may be operated in static mode to smooth and/or firm up the

surface, but shall operate in the vibratory mode to compact the RCC to the specified density. Compaction shall be completed with the roller operated in the static mode, as necessary, to achieve the specified density near the surface of the lift.

The contractor shall select the combination of frequency of vibration, amplitude of vibration, and speed of operation that result in the specified density at the fastest production rate while meeting all other requirements.

Placement and compaction of RCC shall be completed without damaging the structure, other structures, forms, foundation, or other embedded appurtenances. Any appurtenance damaged by the compaction process will be repaired or removed and replaced at the contractor's expense.

Special compaction techniques shall be performed using special compaction rollers and power tampers in areas where production rollers cannot maneuver or will cause damage to the structure, forms, foundation, or appurtenances. RCC shall be deposited, spread, and compacted in 4 or 6 inch thick layers as required to obtain uniform specified density throughout the 12-inch lift with limited compaction to avoid drying the surface.

The individual layers that compose one lift shall be deposited, spread, and compacted within 1 hour from the time the first layer within that lift is placed.

Special compaction rollers shall be vibratory rollers that are capable of operating in confined areas and adjacent to forms, foundation, or appurtenances without damage to the RCC structure or appurtenances. Special compaction rollers shall produce a centrifugal force of at least 150 pounds per linear inch of drum width for each drum of a double drum unit and 300 pounds per linear inch of drum width for a single drum unit. Special compaction rollers shall be operated at a speed less than 2 feet per second during the compaction operation.

Power tampers shall develop a force per blow of at least 3,500 pounds per square foot. The maximum layer thickness to be compacted by power tampers shall be 6 +/- inches after the specified density has been achieved.

The contractor shall maintain at least one special compaction roller and two tampers in operating condition at the site during RCC placement.

Manually directed vibratory plate compactors may be used to shape, smooth, and level the surface, but shall not be used as a substitute for vibratory rollers and power tampers.

14. Record testing

Unless otherwise specified in section 22, one set of RCC cylinders for compressive strength tests shall be obtained for each 1,000 cubic yards of RCC placed to be used for compressive strength testing.

Each set shall consist of 15 compressive strength cylinders prepared in accordance with ASTM C 1176 or C 1435 and weighed to determine the density of the RCC within each cylinder. Any cylinder that weighs less than 98 percent of the weight of the heaviest cylinder shall be discarded and another cylinder prepared and weighed until all 15 cylinders have a weight that is at least 98 percent of that of the heaviest cylinder. Three cylinders shall be tested for compressive strength in accordance with ASTM C 39 at 7, 14, 28, 90, and 180 days, respectively, after the specimens are molded.

Unless otherwise specified in section 22 of this specification, the contractor shall extract two sets of vertical core RCC samples in accordance with ASTM C 42. Each set shall be sampled from RCC that has been placed in the structure a no less than 1 week apart. Each set shall contain eight intact cores taken from the structure at approved locations. Cores shall have a minimum length equal to one lift thickness

and a nominal diameter of 6 inches. Core specimens shall be obtained no earlier than 20 days after placement. The contractor shall test two samples at 28, 56, 90, and 180 days, respectively, after placement for compressive strength in accordance with ASTM C 42.

15. Lift joints

The term joint, as used in this specification, applies to all surfaces that will eventually be covered by RCC mix, bonding mortar, Portland cement, neat cement grout, or conventional concrete.

The joint treatment method shall be as specified in section 22.

Joint condition—Three potential joint conditions will exist during construction: fresh joint, intermediate joint, and cold joint. The condition of a joint shall be defined on the basis of joint maturity or time of exposure. Joint maturity is defined as the product of the average RCC surface temperature (AST) in degrees Fahrenheit and the time of exposure (TE) in hours. Joint maturity is expressed in degree-hours (deg F-hr) and is calculated as:

$$\text{Joint maturity in deg F-hr} = (\text{AST}) \times (\text{TE}).$$

The TE shall be the period, expressed to the nearest quarter hour, beginning when the compaction of RCC is completed and ending when covered by the subsequent placement of RCC.

Whenever the joint condition is defined on the basis of joint maturity, the AST shall be determined hourly during the exposure period by measuring the RCC surface temperature at various locations with a surface thermometer. The temperature shall be measured in degrees Fahrenheit and the temperature readings averaged to determine the AST.

A **fresh joint** is defined as a joint having maturity of 400 deg F-hr or less. In lieu of determining the joint maturity, a fresh joint may be defined as a joint with a TE of 4 hours or less.

An **intermediate joint** is defined as a joint having a maturity greater than 400 deg F-hr, but less than or equal to 1,600 deg F-hr. In lieu of determining the joint maturity, an intermediate joint may be defined as a joint with a TE of more than 4 hours, but less than 16 hours.

A **cold joint** is defined as a joint having a maturity of over 1,600 deg F-hr. In lieu of determining the joint maturity, a cold joint may be defined as a joint with a TE of 16 hours or more.

Joint treatment—All joint surfaces shall be kept continuously moist, clean, and uncontaminated until placement of succeeding RCC lifts. Water that ponds on a finished surface shall be removed prior to placing RCC.

The surface of previously placed RCC shall be free of soil, dust, or other contaminants prior to being covered with joint treatment material or another layer or lift of RCC. Cleaning of previously placed RCC lifts shall be accomplished by pressurized water and/or air or other methods provided that the surface of the in-place layer is not damaged by the cleaning operation.

The contractor shall have a pressure washer and a blowpipe onsite capable of delivering a combined air-water mixture, with the ability to adjust the pressure, volume, and proportion of air and water.

Edge joints that are exposed for more than 30 minutes shall be trimmed back no less than 9 inches to an RCC surface, that has been compacted to the specified density and beveled at a slope of one horizontal to one vertical. Immediately before placing RCC against a trimmed surface, the joint condition shall be determined and the specified joint treatment shall be applied.

Any surface to be covered with RCC, a bonding material or conventional concrete that is damaged to the extent that over 25 percent of the exposed coarse aggregate is undercut shall be treated as a cold joint. Coarse aggregate with less than half of its surface area remaining embedded and bonded to the RCC is considered undercut.

All RCC materials removed by cleaning, brooming, smoothing, beveling, or trimming layers shall be collected and removed from the structure.

Treatment Method I. Remove any loose materials and contaminants from the lift joint surface. The lift joint surface shall be cleaned using moderate-pressure air immediately before spreading the next RCC lift. Maintain the surface in a moistened condition.

Treatment Method II. Perform Treatment Method I. Before the placement of RCC on the joint surface, uniformly distribute a layer of dry Portland cement over the surface. The Portland cement shall be applied at a rate of 0.5 to 1 pound per square foot of surface. The amount of water applied to the lift surface before, during, or after distributing the cement shall be of sufficient quantity to dampen all of the cement. The ratio of water to cement shall be limited to that which will produce a tacky paste. Water applied after the cement is distributed shall be applied in a fine mist to prevent the displacement of cement. The cement shall be applied immediately ahead of placing the next layer or lift of RCC. The cement shall not be exposed on the surface more than 10 minutes before being covered with RCC. Portland cement paste that does not meet these requirements shall be removed from the structure and disposed of, and the treatment method shall be repeated.

Treatment Method III. Perform Treatment Method I. Before the placement of RCC, the joint surface shall be covered with a layer of the bonding mortar specified in section 2. The thickness of the bonding mortar shall be 0.25 to 0.5 inch. The bonding mortar shall be covered with the next layer or lift of RCC while the mortar is still fluid. In no case shall the bonding mortar remain uncovered for more than 30 minutes. Bonding mortar shall be placed in a manner that will avoid segregation. Bonding mortar that does not meet these requirements shall be removed from the structure and disposed of, and the treatment method shall be repeated.

16. Curing and protection

Curing—Curing of RCC shall begin immediately after compaction. All exposed and completed RCC surfaces shall be cured for a minimum of 14 days at or above 40 degrees Fahrenheit following placement. All repairs including that required to fill holes associated with form anchorages and coring shall be cured for a minimum of 7 days at or above 40 degrees Fahrenheit following repair.

If the RCC is wet cured, the RCC shall be maintained in a continuously damp condition for the entire curing period. The continuous application of water supplemented by the use of a saturated cover material or an impermeable covering shall be required to obtain the continuously damp condition. The application of water or cover material shall not erode, mar, or otherwise damage the RCC. Plastic or paper covering shall meet the requirements of ASTM C 171. Only white or reflective coverings shall be used during hot weather as defined by ACI 305.

In lieu of wet curing, RCC that will not be covered with subsequent joint treatment, RCC, or conventional concrete may be treated with a curing compound as specified in section 2, unless otherwise specified in section 22. Areas to be cured with curing compound shall be kept continuously moist until curing compound is applied. Curing compound shall be thoroughly mixed before applying and be agitated during application. A continuously agitating pressure sprayer shall be used to apply the curing compound at a uniform rate of not less than double the curing compound manufacturer's recommended rate for conventional concrete curing. Manual hand pump sprayers shall not be used. A brush or paint roller shall be used in areas that are near unmasked surfaces that will be covered with subsequent joint treatment, RCC,

or conventional concrete. The curing compound shall form a uniform, continuous, adherent film that shall not check, crack, or peel and shall be free from pinholes or other imperfections. Multiple applications of curing compound may be necessary to achieve the specified coverage. When multiple applications are required, the second application shall be applied at a 90 degree angle to the first application. During the curing period, curing compound shall be reapplied 7 days after the initial application. In areas where the curing compound is damaged, it shall be reapplied immediately.

Curing compound shall not be applied to areas that are to be repaired or patched. Areas to be repaired or patched shall be kept continuously moist until the repair is made. Curing compound or wet curing shall then be implemented to conform to curing requirements specified herein. Any curing compound applied to areas that are to be repaired or patched shall be removed prior to applying the repair material.

Regardless of the curing method used, curing activities shall not be discontinued or interrupted until the RCC has remained at or above 40 degrees Fahrenheit for a total of 14 days. This will require extending the curing period by the number of days that the RCC temperature drops below 40 degrees Fahrenheit during the curing period.

Protection—The temperature of RCC shall be maintained at or above 35 degrees Fahrenheit from the time the RCC is placed until 7 days after the curing period. When ambient temperatures are expected to be below 32 degrees Fahrenheit, measures shall be implemented to protect the RCC from freezing. The protection shall remain in place until ambient temperatures remain continuously above 35 degrees Fahrenheit for 24 hours. Protective measures shall not hinder the specified curing of the RCC.

RCC shall be protected from damage by precipitation, vehicular traffic, or other causes.

17. Vertical surfaces

Unless otherwise specified in section 22, all formed RCC vertical surfaces that are subject to exposure shall be finished to ensure a minimum of 80 percent of the surface area is free from honeycomb or other voids and is uniform in appearance.

Forming is not required for vertical RCC surfaces that are not subject to permanent exposure.

The finish and appearance of unformed vertical surfaces shall comply with the requirements specified in section 22.

18. Tolerances

Any variation in the face or surface of the finished RCC shall be within the tolerances stated herein.

The structure(s) shall be constructed to the lines and grades depicted on the drawings.

The thickness of compacted lifts of RCC shall be 12 inches plus or minus 1 inch.

The allowable tolerance of all exposed formed surfaces shall be plus or minus 0.1 foot from specified line. Abrupt changes shall not exceed 0.05 foot in any exposed formed surface.

Limit gradual overbuild of exposed unformed RCC faces to 0.5 foot. Under build will not be allowed.

Do not exceed 0.1 foot in 10 feet variation in an unformed, exposed RCC face as measured in a straight line along the length and height of the face, or 0.5 foot over the entire length of the structure. Abrupt changes shall be less than 0.1 foot.

The elevation of any horizontal RCC surface shall be plus or minus 0.1 foot of the specified grade except that the elevation of a finished top of dam or spillway crest shall be no more than 0.1 foot above the specified elevation.

19. Repair of RCC

Repair or replacement—The contractor shall repair or replace RCC that does not meet the requirements of this specification. Before starting any repair or replacement work, the contractor shall prepare a written plan for the repair or replacement. The primary reference for material and repair methods for the plan shall be the appropriate sections of the American Concrete Institute's *Manual of Concrete Inspection*. The repair plan shall be submitted for review and approval at least 10 days before any repair or replacement work.

Patching—All form bolts, metal ties, and similar forming restraints shall be removed to a depth of 1 inch below the surface of the RCC and their cavities repaired unless otherwise specifically permitted or specified in section 22. Small cavities large air holes, minor honeycombed areas, holes created from test coring, and other superficial imperfections that require patching to meet the specified finish requirement shall be thoroughly cleaned and filled. Holes left by bolts or straps that passes through the RCC shall be filled solid with a dense, well-bonded nonshrink patching material. Dry-pack mortar and replacement concrete shall follow the appropriate procedure detailed in the Repair and Maintenance chapter of the Concrete Manual, Bureau of Reclamation, U.S. Department of the Interior. Proprietary patching material shall be appropriate for the type of repair used within the manufacturer's recommended limits and applied according to the manufacturer's recommendations.

When proprietary patching material is proposed in the plan, the manufacturer's data sheets and written recommendations shall be included in the plan.

Repair material or replacement concrete shall have properties, color, and texture similar to and compatible with the concrete being repaired or replaced.

Curing of repaired or replaced concrete shall be started immediately after finish work is completed as specified in section 16 or as specified by the manufacturer of proprietary compounds.

20. Cleanup of spillage

All loose gravel and uncompacted RCC material shall be removed from the structure for disposal in approved location(s) or as specified in section 22 and shall not be recycled into the RCC mix.

21. Measurement and payment

For items of work for which specific unit prices are established in the contract, the volume of RCC is measured and computed to the nearest cubic yard by the method of average cross-sectional end areas. Unless otherwise specified in section 22, no deduction in volume is made for embedded items, such as, but not limited to conduits, inlet structures, outlet structures, embankment drains, sand diaphragm and outlet, and their appurtenances.

The volume of RCC shall be determined by measuring from the surface of the foundation when approved for RCC placement to the specified neatlines of the completed RCC structures, unless otherwise specified in section 22.

If the test section is not incorporated into the RCC structure, the volume of RCC placed into the construction of the test section will be added to the volume computation of the completed RCC structure to determine the total volume of RCC for payment. If the test section is incorporated into the RCC structure, no addition volume of RCC shall be included for payment.

When the test section is paid for under a separate bid item, the test section will not be measured for

payment. Payment will be made at the contract lump sum price for the test section and will constitute full compensation for the completion of the test section including any removal and disposal as applicable.

Payment for the RCC, for which a specific unit price is established in the contract, will be computed to the nearest cubic yard. Payment shall constitute full compensation for furnishing all labor, materials (except cementitious materials), equipment, tools transportation, and all other items necessary and incidental to the construction and removal of the test section and construction of the RCC structure, including joint treatment, trimming and removal, repair, replacement, patching, curing, protection, site clean up, and disposal of spillage and waste materials. Payment for treatment of rock foundation surfaces, if any, shall not be included in the payment for RCC. Payment will not be made for RCC material that is wasted or rejected for failure to comply with this specification.

Payment for each cementitious component of the RCC, for which a separate bid item is included in the contract, shall include the quantity incorporated into the RCC structure and test section. This quantity shall be computed based on statement of delivery tickets. Payment will not be made for any cementitious materials not incorporated into the structure(s) or test section.

Payment for the cementitious materials for which specific unit prices are established in the contract will be to the nearest 0.1 ton of cementitious materials.

Compensation for any item of work described in the contract, but not listed in the bid schedule will be included in the payment for the item of work to which it is made subsidiary. Such items and the items to which they are made subsidiary are identified in section 22.

22. Items of work and construction details

Instructions for use Construction Specification 41—Reinforced Concrete Pressure Pipe Conduits

1. Applicability

Construction Specification 41 is applicable to the construction of principal spillway conduits appurtenant to earth dams using bedded or cradled reinforced concrete pressure pipe. It may also be applied to the construction of any type of reinforced concrete pipe conduit that crosses under or through an earth dam or other deep earthfill.

2. Material specifications

The following material specifications complement Construction Specification 41:

535—Preformed Expansion Joint Filler

536—Sealing Compound for Joints in Concrete and Concrete Pipe

541—Reinforced Concrete Pressure Pipe

Construction Specification 31, Portland Cement Concrete for Bedding and Cradles, complements Construction Specification 41.

3. Included items

Items to be included in contract specifications and drawings follow:

- a. Line and grade of the conduit. Include statement in items of work that pipe shall be laid so that there is no reversal of grade between joints unless shown on drawings.
- b. Details of the pipe bedding or cradle, including joint details.
- c. Excavation and backfill requirements, if applicable.
- d. Pay limits or actual limits for excavation.
- e. Details of wall fittings and other special pipe fittings.
- f. Special requirements for foundation preparation.
- g. Type of pipe.
- h. Size of pipe.

- i. Strength of pipe in terms of three-edge bearing load and internal pressure.
- j. Statement on acceptability for project use of pipe or pipe specimens tested in three-edge bearing test within the limits specified in Material Specification 541.
- k. Maximum allowable offset in alignment of interior pipe surface at joints, if tolerance is limited by cavitation hazard.
- l. Method of pressure test selected. See item 4, Section 4, Pressure testing. Identify any variance from ASTM C 924 for air test criteria.
- m. Minimum joint length and minimum limiting angle of the joints according to definitions in Material Specification 541. Industry recommendation is to limit joint deflections to 1.5 inches.
- n. Type and class of expansion joint filler.
- o. Class of concrete for bedding or cradle and support blocks.
- p. Statement that metal strips covering the joints as specified in section 4 are not required, if applicable. (If the conduit rests on bedrock so no appreciable movement takes place at the joints, metal cover strips generally are not needed.)

4. Methods

Section 3, Laying the pipe

Method 1—The preferred method of stating the instructions for connecting pipe sections.

Method 2—Intended for use when special problems are anticipated or when the pipe to be furnished requires special methods of connection.

Section 4, Pressure testing

Method 1—Considered adequate for principal spillway conduits that operate under pressure intermittently at normal frequencies.

Method 2—May be required for principal spillway conduits that operate under pressure for extended periods or at frequent intervals.

Method 3—May be required where water is at a premium or unavailable; otherwise is not recommended because of potential size limitations and safety concerns.

Method 4—May be required for conduits that operate under pressure when large pipe diameters or other project restraints make method 2 or 3, or both, difficult, expensive or unsafe to test.

Section 6, Measurement and payment

Method 1—Must be used when it is desired to base payment on the measurement of the laid length of the conduit.

Method 2—Must be used when it is desired to base payment on the summation of the nominal laying lengths of the pipe sections used.

Sections 3, 4, and 6

When specifications are prepared using electronic procedures and all methods but one are deleted for use in a contract specification, delete from the last paragraph ***All Methods The following provisions apply to all methods of measurement and payment.*** Left justify the remaining text.

5. Items of work and construction details

Starting at the top of page 41–4, prepare and outline job specific "Items of Work and Construction Details" (IWCD) in accordance with these instructions. For ease of utilization, the use of recyclable color paper for the IWCD should be considered.

Construction Specification 41—Reinforced Concrete Pressure Pipe Conduits

1. Scope

The work shall consist of furnishing and installing reinforced concrete pressure pipe conduits, fittings, and accessories as shown on the drawings and/or specified herein.

2. Material

Reinforced concrete pressure pipe, fittings, and accessories shall conform to the requirements of Material Specification 541, Reinforced Concrete Pressure Pipe.

Portland cement concrete for bedding and cradles shall conform to the requirements of Construction Specification 31 for the specified class of concrete.

Joint sealing compound shall conform to the requirements of Material Specification 536, Sealing Compound for Joints in Concrete and Concrete Pipe.

Preformed expansion joint filler shall conform to the requirements of Material Specification 535, Preformed Expansion Joint Filler.

Filter fabric shall conform to Material Specification 592, Geotextile.

Portland cement concrete for bedding and cradles shall conform to Construction Specification 31.

3. Laying the pipe

The pipe shall be set to the specified line and grade and temporarily supported on precast concrete blocks or wedges. Concrete blocks and wedges used to temporarily support the pipe during placement of concrete bedding or cradle, or both, shall be a class of concrete equal to or stronger than the concrete used to construct the bedding or cradle. Bell and spigot pipe shall be laid with the bells or grooves facing upstream unless otherwise specified in section 7 or shown on the drawings. When precast pipe risers and other similar precast pipe structures are installed before pipe installation, pipe may be installed in the downstream direction with the belled end upstream. Adequate bell clearance in the subgrade/bedding shall be provided.

Just before each joint is connected, the connecting surface of the bell and spigot or spigots and sleeve shall be thoroughly cleaned and dried. Also, the rubber gasket and the inside surface of the bell or sleeve shall be lubricated with a light film of soft vegetable soap compound (flax soap). The rubber gasket shall be stretched uniformly as it is placed in the spigot groove to ensure a uniform volume of rubber around the circumference of the pipe.

Method 1—The joint shall be connected by means of a pulling or jacking force so applied to the pipe that the spigot enters squarely into the bell.

Method 2—The joint shall be connected in accordance with the manufacturer's instructions.

Use with either method—When the spigot has been seated to within 0.5 inch of its final position, the position of the gasket in the joint shall be checked around the entire circumference of the pipe by means of a metal feeler gauge. In any case where the gasket is found to be displaced, the joint shall be disengaged and properly reconnected. After the position of the gasket has been checked, the spigot shall be completely pulled into the bell and the section of pipe shall be adjusted to line and grade.

4. Filling joints

Before the placement of the bedding or cradle, the exterior annular space between the ends of the pipe sections shall be cleaned and completely filled with joint sealing compound. Before the compound is applied, the surface against which it is to be placed shall be cleaned of all dust, lubricant, and other substances that would interfere with a bond between the compound and the pipe. If recommended by the manufacturer of the compound, the concrete surface shall be coated with a primer in accordance with the manufacturer's recommendations. Primers shall be applied to the concrete surface only and shall not come in contact with the gasket or gasket sealing surface. Unless the compound or primer is specifically recommended for use on moist concrete, the surface shall be dry when the compound or primer is applied.

The joint sealing compound shall be allowed to cure until it is sufficiently firm to prevent the entry of concrete or earth into the joint. Unless otherwise specified in section 7 of this specification, before placing bedding or earth backfill (excluding concrete) containing particles larger than 0.25 inch in maximum dimension within 6 inches of the joint sealing compound, the compound shall be covered with a strip of 16-gauge to 24-gauge metal at least 2 inches wider than the space between the ends of the pipe sections. Instead of metal strips, the joints shall be covered by a minimum of 2-foot-wide, 4-ply thick filter fabric. Filter fabric shall be wrapped completely around the joint and overlapped a minimum of 12 inches at the top of the pipe. Lap shall be securely fastened to ensure filter fabric fits snugly during backfill operations. Filter fabric is centered on the joint. It shall conform to Material Specification 592, table 2, Nonwoven, class II.

5. Pressure testing

Method 1—Pressure testing of the completed conduit is not required.

Method 2—Before placing any concrete or earthfill around the conduit or filling the pipe joints, the conduit shall be tested for leaks in the following manner:

The ends of the conduits shall be plugged and a standpipe with a minimum diameter of 2 inches shall be attached to the upstream plug. The conduit shall be braced at each end to prevent slippage. The conduit and the standpipe shall be filled with water. The water level in the standpipe shall be maintained at least 10 feet above the invert of the upstream end of the conduit for at least 2 hours. Any leaks shall be repaired, and the conduit shall be tested again as described. The procedure shall be repeated until the conduit is watertight.

The pipe joints shall show no leakage. Damp spots developing on the surface of the pipe are not considered as leakage.

Method 3—Before placing any concrete or earthfill around the conduit or filling the pipe joints, the conduit shall be air tested in accordance with ASTM C 924. The conduit shall be braced on each end to prevent slippage. All end plugs used for the air test shall be capable of resisting the internal pressure and must be securely braced.

All testing equipment to be used shall be furnished by the contractor and shall be inspected and approved by the engineer. The pressure gauges used shall be graduated to read in increments of 0.1 pounds per square inch and calibrated to provide accuracy within 10 percent plus or minus of the standard gauge. The contractor has the option of prewetting the conduit or line before testing. Any conduit that fails to pass this test must be repaired by a method satisfactory to the engineer. After the repairs are made, the conduit shall be retested until it passes the test requirements.

Method 4—Before placing concrete or earth backfill around the conduit joint to be tested or filling the pipe joints, the joint shall be tested in accordance to ASTM C 1103, Standard Practice for Joint Acceptance Testing of Installed Precast Concrete Sewer Line. The test pressure shall be as specified in section 7 of this specification. Any joints showing leaks shall be relaid or repaired, and the joint shall be retested. The procedure shall be repeated until the joint passes the test.

6. Measurement and payment

Method 1—For items of work for which specific unit prices are established in the contract, the quantity of each size, type, and class of pipe is determined to the nearest 0.1 foot by measurement of the laid length of pipe along the invert centerline of the conduit. Payment for each size, type, and class of reinforced concrete pressure pipe is made at the contract unit price for that size, type, and class of pipe. Such payment constitutes full compensation for furnishing, transporting, and installing the pipe complete in place. This includes accessories, such as wall fittings, joint gaskets, coupling bands, sleeves, or collars, and all other items necessary and incidental to the completion of the work except the special fittings and appurtenances listed separately in the bid schedule. Payment for each special fitting and appurtenance is made at the contract price for that type and size of fitting or appurtenance.

Method 2—For items of work for which specific unit prices are established in the contract, the quantity of each size, type, and class of pipe is determined as the sum of the nominal laying lengths of the pipe sections used. Payment for each size, type, and class of reinforced concrete pressure pipe is made at the contract unit price for that size, type, and class of pipe. Such payment constitutes full compensation for furnishing, transporting, and installing the pipe complete in place. This includes accessories, such as wall fittings, joint gaskets, coupling bands, sleeves or collars, and all other items necessary and incidental to the completion of the work except the special fittings and appurtenances listed separately in the bid schedule. Payment for each special fitting and appurtenance is made at the contract price for that type and size of fitting and appurtenance.

All Methods—The following provisions apply to all methods of measurement and payment. Compensation for any item of work described in the contract, but not listed in the bid schedule, is included in the payment for the item of work to which it is made subsidiary. Such items and the items to which they are made subsidiary are identified in section 7 of this specification.

7. Items of work and construction details

Instructions for use

Construction Specification 42—Concrete Pipe Conduits and Drains

1. Applicability

Construction Specification 42 is applicable to all concrete pipe conduits except principal spillway conduits for earth dams or conduits under deep fills. It may be applied to culverts, pipe collector systems in structure drains, irrigation pipelines, or parts of land drainage systems.

2. Material specifications

The following material specifications complement Construction Specification 42:

- 535—Preformed Expansion Joint Filler
- 536—Sealing Compound for Joints in Concrete and Concrete Pipe
- 541—Reinforced Concrete Pressure Pipe
- 542—Concrete Culvert Pipe
- 543—Nonreinforced Concrete Pipe (concrete irrigation pipe, drainage pipe, and drain tile)

Portland cement concrete for bedding and cradles shall conform to Construction Specification 31, Concrete for Major Structures, or Construction Specification 32, Structure Concrete.

3. Included items

Items to be included in contract specifications and drawings follow:

- a. Line and grade of the conduit. Include statement in section 11 that pipe shall be laid so that there is no reversal of grade between joints unless shown on the drawings.
- b. Details of concrete bedding or cradle, including class of concrete, joint details, and type of expansion joint filler.
- c. Details of earth, sand, or gravel bedding, including description and grading limits of the bedding material.
- d. Excavation and backfill requirements, if applicable.

- e. Pay limits or actual limits for excavation and backfill, if required.
- f. Special requirements for foundation preparation.
- g. Kind of pipe or tile by name and class. (See appropriate reference specifications.)
- h. Size of pipe or tile.
- i. Type of cement for pipe or tile if a certain type is necessary because of soil, water, or other environmental conditions.
- j. Strength of pipe, if not covered by reference specifications, in terms of three-edge-bearing load and internal pressure as appropriate.
- k. Type of joint and details of banded joints or other special joints.
- l. Details of wall fittings and other special fittings and appurtenances.
- m. Test pressure, if applicable.
- n. Method of measurement and payment if the standard specification includes more than one method.

4. Methods

Section 5a, Rubber gasket joint, pressure pipe

Method 1—The preferred method of stating the instructions for connecting pipe sections.

Method 2—Intended for use when special problems are anticipated or when the pipe to be furnished requires special methods of connection.

Section 9, Pressure testing

The methods are self-explanatory. The choice of method must be consistent with the function of the conduit and the required operating pressure.

Section 10, Measurement and payment

Method 1—Must be used when it is desired to base payment on the measurement of the laid length of the conduit.

Method 2—Must be used when it is desired to base payment on the summation of the nominal laying lengths of the pipe sections used.

Sections 5a, 9, and 10

When specifications are prepared using electronic procedures and all methods but one are deleted for use in a contract specification, delete from the last paragraph **All Methods The following provisions apply to all methods of measurements and payment.** Left justify the remaining text.

5. Items of work and construction details

Starting at the top of page 42-6, prepare and outline job specific "Items of Work and Construction Details" (IWCD) in accordance with these instructions. For ease of utilization, the use of recyclable color paper for the IWCD should be considered.

Construction Specification 42—Concrete Pipe Conduits and Drains

1. Scope

The work shall consist of furnishing and installing concrete pipe or concrete drain tile and the necessary fittings as shown on the drawings.

2. Material

Reinforced concrete pressure pipe shall conform to the requirements of Material Specification 541, Reinforced Concrete Pressure Pipe, for the type and strength specified.

Concrete culvert pipe shall conform to the requirements of Material Specification 542, Concrete Culvert Pipe, for the kind of pipe specified.

Concrete irrigation pipe, drainage pipe, and drain tile shall conform to the requirements of Material Specification 543, Nonreinforced Concrete Pipe, for the kind of pipe or tile specified.

Pipefittings shall conform to the requirements of the applicable pipe specifications.

Sealing compound for filling rubber gasket joints shall conform to the requirements of Material Specification 536, Sealing Compound for Joints in Concrete and Concrete Pipe.

Hot-pour joint sealer shall conform to the requirements of Material Specification 536, Sealing Compound for Joints in Concrete and Concrete Pipe.

Cold-applied sealing compound shall conform to the requirements of Material Specification 536, Sealing Compound for Joints in Concrete and Concrete Pipe.

Preformed sealing compound shall conform to the requirements of Material Specification 536, Sealing Compound for Joints in Concrete and Concrete Pipe.

Joint packing shall be commercial grade oakum.

Preformed expansion joint filler shall conform to the requirements of Material Specification 535, Preformed Expansion Joint Filler.

Portland cement concrete for bedding and cradles shall conform to Construction Specification 31, Concrete for Major Structures, or Construction Specification 32, Structure Concrete.

3. Laying and bedding

Pipe and tile shall be laid to the line and grade shown on the drawings. Unless otherwise specified, belled pipe shall be laid with the bells or grooves facing upstream. When precast pipe risers and other similar precast pipe structures are installed before pipe installation, pipe may be installed in the downstream direction with the belled end upstream. Adequate bell clearance in the subgrade/bedding shall be provided.

Concrete cradles or bedding—Pipe to be cradled or bedded on concrete shall be set to the specified line and grade and temporarily supported on precast concrete blocks or wedges until the cradle or bedding concrete is placed. Concrete blocks or wedges used to temporarily support the pipe during placement of bedding or cradle shall be of a class of concrete equal to or stronger than that to be used in the bedding or cradle.

Earth, sand, or gravel bedding—The pipe shall be uniformly bedded throughout its entire length to the depth and in the manner specified on the drawings. The pipe shall be loaded sufficiently during backfilling around the sides to prevent displacement.

Perforated pipe shall be laid with the perforations down and oriented symmetrically about a vertical centerline. Perforations shall be clear of any obstructions when the pipe is laid.

Elliptical pipe and pipe with elliptical or quadrant reinforcement shall be laid so that the vertical axis, as indicated by markings on the pipe, is in a vertical position.

4. Joints

Pipe joints shall conform to the details shown on the drawings and to the requirements of sections 5 and 6 of this specification applicable to the type of joint specified. Except where unsealed joints are indicated, pipe joints shall be sound and watertight at the pressure specified.

5. Jointing bell and spigot pipe

Rubber gasket joint, pressure pipe

Just before the joint is connected, the connecting surfaces of the spigot and the bell or coupling band, sleeve, or collar shall be thoroughly cleaned and dried. Also, the rubber gasket and the inside surface of bell or coupling band, sleeve, or collar shall be lubricated with a light film of soft vegetable soap compound (flax soap). The rubber gasket shall be stretched uniformly as it is placed in the spigot groove to ensure a uniform volume of rubber around the circumference of the pipe.

Method 1—The joint shall be connected by means of a pulling or jacking force so applied to the pipe that the spigot enters squarely into the bell.

Method 2—The joint shall be connected in accordance with the manufacturer's recommendations.

Use with either method—When the spigot has been seated to within 0.5 inch of its final position, the position of the gasket in the joint shall be checked around the entire circumference of the pipe using a metal feeler gauge. In any case where the gasket is found to be displaced, the joint shall be disengaged and properly reconnected. After the proper position of the gasket has been confirmed, the spigot shall be completely pulled into the bell and the section of the pipe shall be adjusted to line and grade.

Rubber gasket joints, sewer, and culvert pipe or irrigation pipe

The pipe shall be joined in accordance with the gasket manufacturer's recommendations except as otherwise specified.

Mastic sealed joints

At the time of assembly, the inside surface of the bell and the outside surface of the spigot shall be clean, dry, and primed as recommended by the manufacturer of the sealing compound. A closely twisted gasket of joint packing of the diameter required to support the spigot at the proper grade and to make the joint concentric shall be made in one piece of sufficient length to pass around the pipe and lap at the top. The gasket shall be laid in the bell throughout the lower third of the circumference. The end of the spigot shall be laid in the bell throughout the lower third of the circumference. The end of the spigot shall be laid on the gasket, and the spigot shall be fully inserted into the bell so that the pipe sections are closely fitted and aligned. The gasket then shall be lapped at the top of the pipe and thoroughly packed into the annular space between the bell and the spigot.

Hot-pour joint sealer—The sealing compound shall be heated to within the temperature range recommended by the manufacturer and shall not be overheated or subjected to prolonged heating. After the joint is assembled with the pipe in its final location, a suitable joint runner shall be placed around the

joint with an opening left at the top. Molten sealing compound shall be poured into the joint as rapidly as possible without entrapping air until the annular space between bell and spigot is completely filled. After the compound has set, the runner may be removed. Alternate joints may be poured before the pipe is lowered into the trench. In this case the joint shall be poured with the pipe in a vertical position without the use of the runner. The compound shall have thoroughly set before the pipe is placed in the trench, and the pipe is handled so as to cause no deformation of the joint during placement.

Cold-applied sealing compound—The annular space between bell and spigot shall be completely filled with the sealing compound. The compound shall be mixed on the job in accordance with the manufacturer's recommendations and in relatively small quantities so that setting will not be appreciable before application.

Preformed sealing compound—Joint packing is not required except as recommended by the manufacturer of the sealing compound. Preformed strips or bands of the sealing compound shall be applied to the bell and spigot before assembly of the joint in accordance with the manufacturer's recommendations. Any compound extruded from the interior side of the joint during assembly shall be trimmed even with the interior surface of the pipe.

Cement mortar sealed joints

Cement mortar for joints shall consist of one part by weight of portland cement and two parts by weight of fine sand with enough water added to produce a workable consistency. At the time of assembly, the inside surface of the bell and the outside surface of the spigot shall be clean and moist.

With packing—A closely twisted gasket of joint packing of the diameter required to support the spigot at the proper grade and to make the joint concentric shall be made in one piece of sufficient length to pass around the pipe and lap at the top. The gasket shall be saturated with neat cement grout, laid in the bell throughout the lower third of the circumference, and covered with mortar. The end of the spigot shall be fully inserted into the bell so that the pipe sections are closely fitted and aligned. A small amount of mortar shall be placed in the annular space throughout the upper two-thirds of the circumference. The gasket then shall be lapped at the top of the pipe and thoroughly packed into the annular space between the bell and the spigot. The remainder of the annular space then shall be filled completely with mortar and beveled off at an angle of about 45 degrees with the outside of the bell. If the mortar is not sufficiently stiff to prevent appreciable slump before setting, the outside of the joint thus made shall be wrapped with cheesecloth. After the mortar has set slightly, the joint shall be wiped inside the pipe. If the pipe is too small for a person to work inside, wiping may be done by dragging an approved swab through the pipe as the work progresses.

Without packing—The lower part of the bell shall be filled with stiff mortar of sufficient thickness to make the inner surface of the abutting sections flush. The spigot end of the pipe to be joined shall be fully inserted into the bell so that the sections are closely fitted and aligned. The remaining annular space between the bell and spigot shall then be filled with mortar and the mortar neatly beveled off at an angle of about 45 degrees with the outside of the bell. After the mortar has set slightly, the joint shall be wiped inside the pipe. If the pipe too small for a person to work inside, wiping may be done by dragging an approved swab through the pipe as the work progresses.

Unsealed joints

When unsealed joints are specified, they shall conform to the details shown on the drawings.

6. Joining tongue and groove pipe

Cement mortar sealed joint

Mortar shall be as specified for bell and spigot joints. The tongue end of the section being placed shall be covered with mortar and firmly pressed into the groove of the laid section so that the tongue fits

snugly and truly in the groove and that mortar is squeezed out on both the interior and exterior of the joint. Care shall be taken that no mortar falls from the groove end during the abutting operation. Immediately after the pipe sections have been abutted, exposed external surface mortar shall be pressed into the joint and any excess mortar removed. After this is done, the interior surface of the joint shall be carefully pointed and brushed smooth and all surplus mortar removed.

Mastic sealed joints

Strips or bands of preformed sealing compound shall be applied to the tongue and groove before assembly of the joint in accordance with the manufacturer's recommendations. Any compound extruded from the interior side of the joint during assembly shall be trimmed even with the interior surface of the pipe.

Rubber gasket joints

The pipe shall be joined in accordance with the gasket manufacturer's recommendations except as otherwise specified.

Unsealed joints

When unsealed joints are specified, they shall conform to the details shown on the drawings.

7. Banding

When external mortar bands are specified, they shall conform to the details shown on the drawings.

8. Curing mortar joints and bands

The external surface of mortar joints shall be covered with moist earth, sand, canvas, burlap, or other approved material and shall be kept moist for 10 days or until the pipe is backfilled. Earth backfilling operations shall not begin until 24 hours after joints are finished.

Water shall not be turned into the conduit within 24 hours after the joints are finished. Hydrostatic pressure shall not be applied to the conduit before 14 days after the joints are finished.

9. Pressure testing

Method 1—Pressure testing of the completed conduit is not required.

Method 2—Before the concrete or earth backfill is placed around the conduit, the conduit shall be tested for leaks in the following manner:

The ends of the conduits shall be plugged and a standpipe with a minimum diameter of 2 inches shall be attached to the upstream plug. The conduit shall be braced at each end to prevent slippage. The conduit and the standpipe shall be filled with water. The water level in the standpipe shall be maintained a minimum of 10 feet above the invert of the upstream end of the conduit for a period of not less than 2 hours. Any leaks shall be repaired and the conduit shall be retested as described. The procedure shall be repeated until the conduit is watertight.

Method 3—Before the concrete or earth backfill is placed around the conduit, the conduit shall be tested at the specified test pressure for a period of at least 2 hours. Any leaks shall be repaired, and the conduit shall be retested. The procedure shall be repeated until the conduit is watertight.

Method 4—Before the concrete or earth backfill is placed around the conduit joint to be tested, the joint shall be tested in accordance to ASTM C 1103, Standard Practice for Joint Acceptance Testing of Installed Precast Concrete Pipe Sewer Lines. Any joints showing leaks shall be relaid or repaired, and the joint shall be retested. The procedure shall be repeated until the joint passes the test.

For methods 2, 3, and 4, the pipe joints shall show no leakage. Damp spots developing on the surface of the pipe are not considered leaks.

10. Measurement and payment

Method 1—For items of work for which specific unit prices are established in the contract, the quantity of each kind, size, and class of pipe or tile is determined to the nearest 0.1 foot by measurement of the laid length along the invert centerline of the conduit. Payment for each kind, size, and class of pipe or tile is made at the contract unit price for that kind, size, and class. Such payment constitutes full compensation for furnishing, transporting, and installing the pipe or tile complete in place.

Method 2—For items of work for which specific unit prices are established in the contract, the quantity of each kind, size, and class of pipe or tile is determined as the sum of the nominal laying lengths of the sections used. Payment for each kind, size, and class of pipe or tile is determined as the sum of the nominal laying lengths of the sections used. Payment for each kind, size, and class of pipe or tile is made at the contract unit price for that kind, size, and class. Such payment constitutes full compensation for furnishing, transporting, and installing the pipe or tile complete in place.

All methods—The following provisions apply to all methods of measurement and payment. Compensation for any item of work described in the contract, but not listed in the bid schedule, is included in the payment for the item of work to which it is made subsidiary. Such items and the items to which they are made subsidiary are identified in section 11 of this specification.

11. Items of work and construction details

Instructions for use Construction Specification 43—Clay Pipe

1. Applicability

Construction Specification 43 is applicable to all types of clay pipe conduits. Application to pipe collector systems in structure drains or to parts of land drainage systems is applicable.

2. Material specifications

The following material specifications complement Construction Specification 43:
536—Sealing Compound for Joints in Concrete and Concrete Pipe
544—Clay Pipe and Drain Tile

3. Included items

Items to be included in contract specifications and drawings follow:

- a. Line and grade of the conduit. Include statement in items of work that pipe shall be installed in a manner that no reversal of grade between joints occurs unless shown on the drawings.
- b. Details of the bedding including description and grading limits of the bedding material.
- c. Excavation and backfill requirements, if applicable.
- d. Pay limits or actual limits for excavation and backfill, if required. When excavation requirements need to be performed to comply with safety requirements, state clearly if those volumes are included or not in the pay limits.
- e. Kind and class of pipe or tile.
- f. Size(s) of pipe or tile.
- g. Type of joint and details of special joints.
- h. Details of wall fittings and other special fittings and appurtenances.
- i. Pressure testing requirements, if applicable.

- j. Method of measurement and payment if the standard specification includes more than one method.

4. Methods

Section 6, Measurement and payment

Method 1—Must be used when it is desired to base payment on the measurement of the laid length of the conduit.

Method 2—Must be used when it is desired to base payment on the summation of the nominal laying lengths of the pipe conduit.

When specifications are prepared using electronic procedures and all measurement and payment methods but one are deleted for use in a contract specification, delete from the last paragraph, ***All Methods The following provisions apply to all methods of measurement and payment.*** Left justify the remaining text.

5. Items of work and construction details

Starting at the top of page 43–4, prepare and outline job specific "Items of Work and Construction Details" (IWCD) in accordance with these instructions. For ease of utilization, the use of recyclable color paper for the IWCD should be considered.

Construction Specification 43—Clay Pipe

1. Scope

The work consists of furnishing and installing clay pipe and/or clay drain tile and the necessary fittings as shown on the drawings.

2. Material

Pipe, drain tile, and fittings shall conform to the requirements of Material Specification 544, Clay Pipe and Drain Tile, for the kind of pipe or tile specified.

Sealing compound for filling rubber gasket joints shall conform to the requirements of Material Specification 536, Sealing Compound for Joints in Concrete and Concrete Pipe.

Compression joints using resilient material shall conform to the requirements of ASTM C 425.

Nonpour joint sealer shall conform to the requirements of Material Specification 536, Sealing Compound for Joints in Concrete and Concrete Pipe.

Cold-applied sealing compound shall conform to the requirements of Material Specification 536, Sealing Compound for Joints in Concrete and Concrete Pipe.

Joint packing shall be commercial grade oakum.

3. Laying and bedding

Pipe and tile shall be installed to the line and grade shown on the drawings. Each pipe section shall be installed with the bell end upstream.

The pipe shall be firmly and uniformly bedded throughout its entire length to the depth and in the manner specified on the drawings. The pipe shall be loaded sufficiently during backfilling around the sides to prevent uplift of the pipe and the development of voids between the pipe and bedding.

Perforated pipe and tile shall be laid with the perforations down and oriented symmetrically about the vertical centerline. Perforations shall be clear of any obstructions when the pipe is installed.

4. Joints

Pipe joints shall conform to the details shown on the drawings except where unsealed joints are indicated. The joints shall be sound and watertight at the pressures specified.

Rubber gasket joints shall be assembled in accordance with the gasket manufacturer's recommendations except as otherwise specified.

Compression joints using resilient material shall be assembled in accordance with the manufacturer's recommendations.

Mastic sealed joints—At the time of pipe assembly, the inside surface of the bell and the outside surface of the spigot shall be clean, dry, and primed as recommended by the manufacturer of the sealing compound. A closely twisted gasket of joint packing, of the diameter required to support the spigot at the proper grade and to make the joint concentric, shall be made in one piece of sufficient length to pass around the pipe and lap at the top of the pipe and be thoroughly packed into the annular space between the bell and the spigot.

Hot-pour joint sealer—The sealing compound shall be heated to within the temperature range recommended by the manufacturer and shall not be overheated or subjected to prolonged heating. After the joint is assembled, with the pipe in its final location, a suitable joint runner shall be placed around the joint with an opening left at the pipe top. Molten sealing compound shall be poured into the joint as rapidly as possible without entrapping air until the annular space between bell and spigot is completely filled. After the compound has set, the runner may be removed. Alternate joints may be poured before the pipe is lowered into the trench. When this installation procedure is used, the joint shall be poured with the pipe in a vertical position without the use of a runner. The compound shall have thoroughly set before the pipe is placed in the trench, and the pipe shall be handled so as to cause no deformation of the joint during placement.

Cold-applied sealing compound—The annular space between bell and spigot shall be completely filled with the sealing compound. The compound shall be mixed on the job in accordance with the manufacturer's recommendations and in relatively small quantities so that setting is not appreciable before application.

Preformed sealing compound—Joint packing is not required except as recommended by the manufacturer of the sealing compound. Preformed strips or bands of the sealing compound shall be applied to the bell and spigot before assembly of the joint in accordance with the manufacturer's recommendations. Any compound extruded from the interior side of the joint during assembly shall be trimmed even with the interior surface of the pipe.

Cement mortar sealed joints—Cement mortar for joints shall consist of one part, by weight, of portland cement and two parts, by weight, of fine sand with adequate water added to produce a workable consistency. At the time of assembly, the inside surface of the bell and the outside surface of the spigot shall be clean and moist.

With packing. A closely twisted gasket of joint packing, of the diameter required to support the spigot at the proper grade and to make the joint concentric, shall be made in one piece of sufficient length to pass around the pipe and lap at the pipe top. The gasket shall be saturated with neat cement grout, laid in the bell throughout the lower third of the circumference, and covered with mortar. The end of the spigot shall be fully inserted into the bell so that the pipe sections are closely fitted and aligned. A small amount of mortar shall be placed in the annular space throughout the upper two-thirds of the circumference. The gasket then shall be lapped at the top of the pipe and thoroughly packed into the annular space between the bell and the spigot. The remainder of the annular space shall then be filled completely with mortar and beveled off at an angle of about 45 degrees with the outside of the bell. If the mortar is not sufficiently stiff to prevent appreciable slump before setting, the outside of the joint thus made shall be wrapped with cheesecloth. After the mortar has set slightly, the joint shall be wiped inside the pipe. If pipe is too small for a person to work inside, wiping may be accomplished by dragging an approved swab through the pipe as the work progresses.

Without packing. The lower part of the bell shall be filled with stiff mortar of sufficient thickness to make the inner surface of the abutting sections flush. The spigot end of the pipe to be jointed shall be fully inserted into the bell so that the sections are closely fitted and aligned. The remaining annular space between the bell and spigot shall be then filled with mortar and the mortar neatly beveled-off at an angle of about 45 degrees with the outside of the bell. After the mortar has set slightly, the joint shall be wiped inside the pipe. If pipe is too small for a person to work inside, wiping may be accomplished by dragging an approved swab through the pipe as the work progresses.

Unsealed joints—When unsealed joints are specified, they shall conform to the details shown on the drawings.

5. Curing mortar joints

The external surface of mortar joints shall be covered with moist earth, sand, canvas, burlap, or other approved material and shall be kept moist for 10 days or until the pipe is backfilled.

Water shall not be turned into the conduit within 24 hours after the joints are finished.

6. Measurement and payment

Method 1—For items of work for which specific unit prices are established in the contract, the quantity of each kind, size, and class of pipe or tile is determined to the nearest foot by measurement of the laid length along the invert centerline of the conduit. Payment for each kind, size, and class of pipe or tile is made at the contract unit price for that kind, size, and class. Such payment constitutes full compensation for furnishing, transporting, and installing the pipe or tile complete in place.

Method 2—For items of work for which specific unit prices are established in the contract, the quantity of each kind, size, and class of pipe or tile is determined as the sum of the nominal laying lengths of the sections satisfactorily installed. Payment for each kind, size, and class of pipe or tile is made at the contract unit price for that kind, size, and class. Such payment constitutes full compensation for furnishing, transporting, and installing the pipe or tile complete in place.

All methods—The following provisions apply to all methods of measurement and payment. Compensation for any item of work described in the contract, but not listed in the bid schedule, is included in the payment for the item of work to which it is made subsidiary. Such items and the items to which they are made subsidiary are identified in section 7 of this specification.

7. Items of work and construction details

Instructions for use Construction Specification 44—Corrugated Polyethylene Tubing

1. Applicability

Construction Specification 44 is applicable for use for land drainage and drains for embankments, foundations, structures, and other conduit systems.

2. Material specifications

Material specification 548, Corrugated Polyethylene Tubing, complements Construction Specification 44:

3. Included items

Items to be included in construction specifications and drawings follow

- a. Line and grade of tubing. Include in Section 9, Items of work and construction details, any applicable limitations or restrictions on the grade of the tubing, such as reverse grades are not acceptable.
- b. Details of the trench bottom.
- c. Details of the bedding including description and grading limits of the bedding material.
- d. Describe in section 9 the range of overexcavation that will be permitted without corrective measures.
- e. Diameter(s) of the tubing and interior finish (corrugated or smooth wall).
- f. Describe any special filter envelope for tubing, if required.
- g. Type of joint and details for any special joints.
- h. Details of special fittings and appurtenances.
- i. Details for connections with other appurtenances or existing structures, or both.
- j. Details and specifications for nylon sock, when required.

4. Measurement and payment

Method 1—Includes all excavation and earth backfill to install the pipe.

Method 2—Intended for use when separate payment items are identified for earthwork.

When a nylon sock or other special filter material is an installation requirement, mention the item in section 9 of this specification as an included item for measurement and payment if it is not a separate item in the bid schedule.

When specifications are prepared using electronic procedures and all methods but one are deleted for use in the contract specification, delete from the last paragraph, **All Methods The following provisions apply to all methods of measurement and payment.** Left justify the remaining text.

Note: At the present time, ASTM does not have a standard for double wall or ribbed pipe or the tubing covered by AASHTO M252 and M294.

5. Items of work and construction details

Starting at the top of page 44–3, prepare and outline job specific "Items of Work and Construction Details" (IWCD) in accordance with these instructions. For ease of utilization, the use of recyclable color paper for the IWCD should be considered.

Construction Specification 44—Corrugated Polyethylene Tubing

1. Scope

The work consists of furnishing and installing tubing and the necessary fittings and appurtenances as shown on the drawings and as outlined in this specification.

2. Material

Corrugated polyethylene tubing and fittings shall conform to the material requirements as outlined in Material Specification 548, Corrugated Polyethylene Tubing.

When perforations are specified, the water inlet area shall be a minimum of 1 square inch per lineal foot of tubing. The inlets either shall be circular perforations or slots equally spaced along the length and circumference of the tubing. Unless otherwise specified, circular perforations shall not exceed 3/16 inch in diameter, and slot perforations shall not be more than 1/8 inch wide.

Geotextile filter socks, when required, shall meet the material requirements outlined in section 9 of this specification.

Granular bedding material, when specified, shall conform to the requirements specified in section 9 of this specification.

The tubing shall be appropriately marked with ASTM or AASHTO designation.

3. Handling and storage

Tubing shall be delivered to the job site and handled by means that provide adequate support to the tubing and do not subject it to undue stresses or damage. When handling and placing corrugated polyethylene tubing, care shall be taken to prevent impact blows, abrasion damage, and gouging or cutting (by metal edges and/or surface or rocks). The manufacturer's special handling requirements shall be strictly observed. Special care shall be taken to avoid impact when the pipe must be handled at a temperature of 40 degrees Fahrenheit or less.

Tubing shall be stored on a relatively flat surface so that the full length of the tube is evenly supported. Unless the tube is specifically manufactured to withstand exposure to ultraviolet radiation, it shall be covered with an opaque material when stored outdoors for 15 days or longer.

4. Excavation

Unless otherwise specified or approved by the engineer, excavation for and subsequent installation of each tube line shall begin at the outlet end and progress up grade. The trench or excavation for the tubing shall be constructed to the lines, depths, cross sections, and grade shown on the drawings, specified in Section 9 of this specification, or as approved by the engineer.

Trench shields, shoring and bracing, or other suitable methods necessary to safeguard the contractor's employees and the works of improvement and to prevent damage to the existing improvements shall be furnished, placed, and subsequently removed by the contractor.

5. Preparing the tubing bed and blinding the tubing

When a granular filter or envelope is specified, the filter or envelope material shall be placed in the bottom of the trench just before the tubing is laid. The tubing shall then be laid and the filter and envelope material placed to a depth over the top of the tubing of not less than that shown on the drawings or as specified in section 9 of this specification.

When a granular filter or envelope is not specified, the bottom of the trench shall be shaped to form a semicircular or trapezoidal groove in its center. This groove shall provide support for not less than a fourth of the outside circumference of the tubing. After the tubing is placed in the excavated groove, it shall be capped with friable material from the sides of the trench. The friable material shall be placed around the tubing, completely filling the trench to a depth of at least 3 inches over the top of the tubing. For material to be suitable, it must not contain hard clods, rocks, frozen soil, or fine material that will cause a silting hazard to the drain. Tubing placed during any day shall be blinded (place required soil material around and over pipe) and temporarily capped before construction activities are completed for that day.

6. Placement and joint connections

All tubing shall be installed to grade as shown on the drawings. After the tubing is placed in the trench and blinded, allow sufficient time for the tubing to adapt to the soil temperature before backfilling.

Maximum allowable stretch of the tubing is 5 percent. Special precautions must be implemented on hot, bright days to ensure that the stretch limit is not exceeded and excessive deflection does not occur as a result of installation procedures, including backfill operations.

Unless otherwise specified in section 9 of this specification or shown on the drawings, connections are made with manufactured junctions comparable in strength with the specified tubing. All split fittings shall be securely fastened with nylon cord or plastic zip ties before any backfill is placed. All buried ends shall be supplied with end caps unless otherwise approved by the engineer.

7. Backfilling

Unless otherwise specified in section 9 of this specification, the backfilling of the trench shall be as shown on the drawings and completed as rapidly as is consistent with the soil conditions. Automatic backfilling machines may be used only when approved by the engineer. Backfill shall extend above the ground surface and be well rounded and centered over the trench.

8. Measurement and payment

Method 1—For items of work for which specific unit prices are established in the contract, the quantity of each kind and size of tubing is determined to the nearest foot of length measured along the centerline of the installed tubing. Payment for each kind and size of tubing is made at the contract unit price for that kind and size of tubing. Such payment constitutes full compensation for all labor, equipment, tools, and all other items necessary and incidental to furnishing, transporting, and installing the tubing, including excavation, shoring, geotextile or granular filter (when specified), backfill and all fittings, appurtenances, and other items required to complete the work. Payment for appurtenances listed separately in the bid schedule is made at the contract unit price(s) for the size and type of appurtenance listed.

Method 2—For items of work for which specific unit prices are established in the contract, the quantity of each kind, size, and class of tubing is determined to the nearest foot by measurement of the laid length along the crown centerline of the tubing. Payment for each kind, size, and class of tubing is made at the contract unit price for the kind, size, and class. Such payment constitutes full compensation for furnishing, transporting, and installing the tubing, including shoring, all fittings, thrust blocks, appurtenances, and other items necessary and incidental to the completion of the work. Payment for appurtenances listed separately in the bid schedule are made at the contract prices for those items.

Compensation for any item of work described in the contract, but not listed in the bid schedule, is included in the payment for the item of work to which it is made subsidiary. Such items and the items to which they are made subsidiary are identified in section 9 of this specification.

9. Items of work and construction details

Instructions for use Construction Specification 45—Plastic Pipe

1. Applicability

Construction Specification 45 is applicable for the use of plastic pipe conduits except corrugated polyethylene tubing (see Construction Specification 44).

2. Material specification

Material Specification 547, Plastic Pipe, complements Construction Specification 45.

3. Included items

Items to be included in the construction specification and drawings follow:

- a. Line and grade of the conduit.
- b. Details of the bedding and shape and placement requirements.
- c. Description of the bedding material and grading limits, if needed.
- d. Excavation requirements. Provide pay limits or actual limits for excavation, minimum trench width, if applicable and any special considerations necessary in case of unstable trench bottom or walls or for safety.
- e. Backfill requirements. Provide pay limits or actual limits of backfill, compaction requirements, or other special methods of performing and controlling backfill, including the kind of material, as appropriate.
- f. Specify industry (ASTM or AWWA) material standards or specifications that the pipe material is required to meet, as applicable.

The designer may require a specific type of pipe by listing in section 14 of this construction specification or the appropriate reference specification(s). The designer must be prepared to evaluate and accept

pipe meeting other references that equal or exceed the minimum specified when proposed by the contractor or supplier. NRCS maintains a limited list of reference specifications in NRCS offices for use of design and construction personnel.

- g. Specify the salient features of the pipe that are required to meet the intent of the design.
 - (1) Size (diameter, include ID or OD if critical) and type of plastic (PE, HDPE, ABS, PVC 1120, or other).
 - (2) Schedule, SDR or DR, pressure class, and/or pressure rating, as appropriate.
 - (3) Perforation requirements if different from Material Specification 547.
- h. Type of joint by referring to a reference specification or details of any specific joint requirements.
 - i. Details of special fittings, when applicable.
 - j. Type of protective coatings for special fittings and appurtenances, when applicable (include field repair requirements).
 - k. Pressure testing specifications, including rate of filling requirements, if applicable. The test pressure specified should not be less than the normal operating pressure together with the duration of the test with the allowable pressure change that is acceptable.
 - l. Specify and detail concrete thrust blocks, encasement, and anchors where applicable. Requirements for concrete encasement and for thrust blocks if other than Construction Specification 32, Structure Concrete, Class 3000M.
 - m. Methods of measurement and payment.

4. Methods

Section 12, Pressure testing

The methods are self-explanatory. The choice of method must be consistent with the function of the conduit and the required operating pressure.

Section 13, Measurement and payment

The methods are self-explanatory.

When specifications are prepared using electronic procedures and all methods but one are deleted for use in a contract specification, delete from the last paragraph, *All Methods The following provisions apply to all methods of measurement and payment.* Left justify the remaining two sentences.

5. Discussion

This specification is written to include cast iron pipe sizes, iron pipe sizes (IPS), sewer pipe, pressure pipe, water pipe, drainpipe, and plastic irrigation pipe (PIP).

In addition to the ductile iron and cast iron fittings, one piece, injection molded, gasketed PVC plastic fittings are available for PVC pipe. These fittings are available for sewer pipe sizes 4 inches to 15 inches, for IPS-PVC pipe sizes 1.5 inches to 8 inches, and for AWWA Standard C900 pipes that are compatible with cast iron pipe sizes 4 inches to 8 inches.

6. Items of work and construction details

Starting at the top of page 45–8, prepare and outline job specific "Items of Work and Construction Details" (IWCD) in accordance with these instructions. For ease of utilization, the use of recyclable color paper for the IWCD should be considered.

Construction Specification 45—Plastic Pipe

1. Scope

The work consists of furnishing and installing plastic pipe (except corrugated polyethylene tubing) and the necessary fittings and appurtenances as shown on the drawings or as specified herein.

2. Material

Pipe, fittings, and gaskets shall conform to the requirements of Material Specification 547, Plastic Pipe, and as specified in section 14 of this specification or as shown on the drawings.

Perforated pipe shall conform to the requirements of Material Specification 547, Plastic Pipe, and as specified in section 14 of this specification or as shown on the drawings.

Unless otherwise specified, concrete shall conform to the requirements of Construction Specification 32, Structure Concrete, and section 8 of this specification.

Unless otherwise specified, earth backfill shall conform to the requirements of Construction Specification 23, Earthfill.

Unless otherwise specified, drainfill shall conform to the requirements of Construction Specification 24, Drainfill.

3. Handling and storage

Pipe shall be delivered to the job site and handled by means that provide adequate support to the pipe and do not subject it to undue stresses or damage. When handling and placing plastic pipe, care shall be taken to prevent impact blows, abrasion damage, and gouging or cutting (by metal edges and/or surface or rocks). The manufacturer's special handling requirements shall be strictly observed. Special care shall be taken to avoid impact when the pipe must be handled at a temperature of 40 degrees Fahrenheit or less.

Pipe shall be stored on a relatively flat surface so that the barrels are evenly supported. Unless the pipe is specifically manufactured to withstand exposure to ultraviolet radiation, it shall be covered with an opaque material when stored outdoors for 15 days or longer.

4. Excavation

Excavation shall be in accordance with Construction Specification 21, Excavation, and section 14 of this specification or as shown on the drawings.

The pipe foundation shall be excavated a minimum of 4 inches lower than the pipe grade shown on the drawings or staked in the field whenever bedrock, boulders, cobbles, or other material that may cause pipe damage is encountered at planned pipe grade.

5. Laying the pipe

Plastic pipe conduits complete with fittings and other related appurtenances shall be installed to the lines and grades shown on the drawings or specified in section 14 of this specification. The pipe shall be installed so that there is no reversal of grade between joints unless otherwise shown on the drawings. The pipe shall not be dropped or dumped on the bedding or into the pipe trench. The ground surface near the pipe trench shall be free of loose rocks and stones greater than 1 inch in diameter. This ensures that rock will not be displaced and impact the pipe.

Just before placement, each pipe section shall be inspected to ensure that all foreign material is removed from inside the pipe. The pipe ends and the couplings shall be free of foreign material when assembled. At the completion of a work shift, all open ends of the pipeline shall be temporarily closed off using a suitable cover or plug.

Care shall be taken to prevent distortion and damage during hot or cold weather. During unusually hot weather (daytime high temperature of more than 90 °F), the pipe assembled in the trench shall be lightly backfilled or shaded to keep it as near to ground temperature as possible until final backfill is placed. Backfill operations should be performed during daily construction periods when the ground temperature and the temperature of the pipe do not vary more than 40 degrees Fahrenheit.

Perforated pipe shall be installed with the perforations down and oriented symmetrically about the vertical centerline. Perforations shall be clear of any obstructions on the inside and outside of the pipe when the pipe is approved by the engineer for backfill.

During installation, the pipe shall be firmly and uniformly bedded throughout its entire length, to the depth and in the manner specified in section 14 of this specification or as shown on the drawings. Bell-holes shall be placed in bedding material under bells, couplings, and other fittings to assure the pipe is uniformly supported throughout its entire length. Blocking or mounding beneath the pipe to bring the pipe to final grade is not permitted.

6. Pipe embedment

Earth bedding—The pipe shall be firmly and uniformly placed on compacted earthfill bedding or an in-place earth material bedding of ample bearing strength to support the pipe without noticeable settlement. The earth material on which the pipe is placed shall be of uniform density to prevent differential settlement.

Unless otherwise specified, a groove that closely conforms to the outside surface of the pipe shall be formed in the bedding. The depth of the groove shall be equal to or greater than 0.3 of the pipe diameter.

Earth bedding shall be compacted to a density not less than adjacent undisturbed in-place earth material or be compacted earth backfill. Earthfill material used for compacted earth bedding shall be free of rocks or stones greater than 1 inch in diameter and earth clods greater than 2 inches in diameter. The pipe shall be loaded sufficiently during the compaction of bedding under the haunches and around the sides of the pipe to prevent displacement from its final approved placement.

Sand, gravel, or crushed rock bedding—When sand, gravel, or crushed rock bedding is specified, the pipe shall be firmly and uniformly placed on the bedding material. Material for bedding shall not exceed 1 inch in diameter. Unless otherwise specified in section 14 of this specification or shown on the drawings, the coarse-grained bedding material shall be carefully placed and compacted to a depth equal to or greater than 0.3 of the diameter of the pipe above the bottom of the pipe. The pipe shall be loaded sufficiently during backfilling and compaction around the sides to prevent displacement of the pipe from its final approved placement.

Pipe encased in drainfill—The pipe shall be firmly and uniformly placed on bedding of specified drainfill. Drainfill shall be placed and compacted as specified in section 14 of this specification or as shown on the drawings to form a continuous uniform support around the entire circumference of the pipe. The pipe shall be loaded sufficiently during backfilling around the sides and during compaction to prevent displacement of the pipe.

7. Backfill

Initial backfill—Unless otherwise specified, initial backfill to 6 inches above the top of the conduit is required. Earth haunching and initial backfill material shall consist of soil material that is free of rocks, stones, or hard clods more than 1 inch in diameter. Coarse backfill material shall be the specified sand, gravel, crushed rock, or drainfill material.

Initial backfill shall be placed in two stages. In the first stage (haunching), backfill is placed to the pipe spring line (center of pipe). In the second stage, it is placed to 6 inches above the top of the pipe.

The first stage material shall be worked carefully under the haunches of the pipe to provide continuous support throughout the entire pipe length. The haunching backfill material shall be placed in layers that have a maximum thickness of about 6 inches and are compacted as specified in section 14 of this specification or as shown on the drawings. During compaction operations, care shall be taken to ensure that the tamping or vibratory equipment does not come in contact with the pipe and the pipe is not deformed or displaced.

When pressure testing is not specified, the pipe shall be covered with a minimum of 6 inches of backfill material as soon as possible following assembling of the pipe in the trench, but not later than within the same day that placement has occurred. When pressure testing is specified, sufficient backfill material shall be placed over the pipe to anchor the conduit against movement during pressure testing activities.

Final backfill—Final backfill shall consist of placing the remaining material required to complete the backfill from the top of the initial backfill to the ground surface, including mounding at the top of the trench. Final backfill material within 2 feet of the top of the pipe shall be free of debris or rocks larger than 3 inches nominal diameter. Coarse backfill material shall be the specified sand, gravel, crushed rock, or drainfill. Final backfill shall be placed in approximately uniform, compacted layers. Final backfill compaction requirements shall be as specified in section 14 of this specification or as shown on the drawings.

Vehicles or construction equipment shall not be allowed to cross the pipe until the minimum earth cover and required density as specified in section 14 of this specification has been obtained.

8. Pipe encasement in concrete

Concrete encasement shall be carefully placed to form a continuous uniform support around the entire circumference of the pipe as specified in section 14 of this specification or as shown on the drawings. Pipes encased in concrete shall be securely anchored to prevent movement of the pipe during concrete placement. A clear distance of 1.5 inch shall be maintained between the pipe and the reinforcing steel.

The concrete for the encasement shall conform to the requirements of Construction Specification 32, Structure Concrete, for Class 3000M concrete unless otherwise specified.

9. Joints

Unless otherwise specified in section 14 of this specification or shown on the drawings, joints shall be either bell and spigot type with elastomeric gaskets, coupling type, solvent cement bell and spigot, or jointed by butt heat fusion. When a lubricant is required to facilitate joint assembly, it shall be a type having no deleterious affect on the gasket or pipe material.

Pipe joints shall be watertight at the pressures specified except where unsealed joints are indicated.

Pipe shall be installed and joined in accordance with the manufacturer's recommendations. Laying deflections and joint fitting or stab depths shall be within the manufacturer's recommended tolerances.

When solvent cement joints are specified for PVC or ABS pipe and fittings, they shall be made in accordance with the following ASTMs and the related appendix of each ASTM; D 2855 for PVC pipe and fittings and D 2235 for ABS pipe and fittings.

Flanged, banded, heat-fusion, or elastomeric-sealed mechanical joints shall be used when joining polyethylene (PE) and high density polyethylene (HDPE) pipe and fittings unless otherwise specified in section 14 of this specification or as shown on the drawings.

Pipe ends shall be cut square and be deburred to provide a uniform, smooth surface for the jointing process. Reference marks shall be placed on the spigot ends to assist in determining when proper seating depth has been achieved within the joint.

10. Fittings

Unless otherwise specified, steel fittings, valves, and bolted connections shall be painted or coated as recommended by the manufacturer.

Fittings for nonpressure pipe shall be of the same or similar material as the pipe and shall provide the same durability, watertightness, and strength as the pipe unless otherwise specified.

11. Thrust blocks and anchors

When specified, concrete thrust blocks and anchors shall be installed as shown on the drawings or specified in section 14 of this specification.

The concrete for the thrust blocks and anchors shall conform to the requirements of Construction Specification 32, Structure Concrete, for Class 3000M concrete unless otherwise specified in section 14 of this specification.

The thrust block cavity shall be hand dug into undisturbed soil or previously placed compacted backfill. The cavity shall be formed with soil or wood to hold the freshly placed concrete without displacement until an initial set has occurred.

When excavation beyond the designated trench widths and depths as shown on the drawings or specified in section 14 of this specification occurs at locations where installation of concrete thrust blocks is required, the contractor shall install an alternative thrust block provision. The concrete thrust block shall have a thickness of one pipe diameter and a contact face area that shall be formed against the pipe as shown on the drawings or specified in section 14 of this specification. Backfill shall be placed on all sides of the thrust block and to the sides of the excavation. It shall be compacted as specified for initial backfill.

12. Pressure testing

Method 1—Pressure testing of the completed conduit is not required.

Method 2—The conduit shall be tested for leaks in the following manner:

- a. Before pressure testing:
 - (1) Joints of the assembled pipeline shall be allowed to cure as recommended by the manufacturer.
 - (2) Pipeline shall be flushed and cleaned.
 - (3) All concrete anchors and thrust blocks shall be in place and allowed to cure for a minimum of 3 days.
 - (4) Earth backfill shall be sufficient to anchor the conduit against movement during the pressure testing and shall be compacted as specified in Section 14 of this specification or as shown on the drawings.

- (5) The conduit shall be braced, anchored, or both, at each end to restrict all potential pipe movement.
 - (6) The ends of the conduit shall be plugged. The upstream plug shall have a standpipe installed vertically having a minimum diameter of 2 inches and shall be equipped with a shutoff valve. All high points in the line shall be vented to evacuate air pockets. The conduit and the standpipe shall be slowly filled with water such that no air is entrapped during the filling operation. After filling is complete, all vents shall be closed.
- b. During pressure testing, the water level in the standpipe shall be continuously maintained at a minimum of 10 feet above the highest invert elevation of the conduit for no less than 2 hours unless otherwise specified in section 14 of this specification or as shown on the drawings.

The volume of water leakage in the 2-hour test period shall be recorded. The maximum allowable leakage (L) in gallons per hour shall not exceed 0.02 times the nominal pipe diameter (D) in inches for each 1,000 feet of pipe line, which is about 50 pipe joints ($L = 0.02 \times D$).

- c. When observed leakage exceeds the allowable, leaks shall be sealed by replacement of pipe and fittings as necessary. The conduit shall be retested as described above. This procedure shall be repeated until the conduit leakage does not exceed the allowable specified above.

The contractor shall be fully responsible for any and all work required to correct leakage exceeding the amount specified.

Method 3—The conduit shall be tested for leaks in the following manner:

- a. Before pressure testing:
 - (1) Joints of the assembled pipeline shall be allowed to cure as recommended by the manufacturer.
 - (2) Pipeline shall be flushed and cleaned.
 - (3) All concrete anchor and thrust blocks shall be in place and allowed to cure for at least 3 days.
 - (4) Earth backfill shall be sufficient to anchor the conduit against movement during the pressure testing and compacted as specified in section 14 of this specification or as shown on the drawings.
 - (5) The conduit shall be braced and/or anchored at each end to prevent all potential pipe movement.
 - (6) The ends of the conduit shall be plugged, and a pressure gauge shall be attached to the upstream and downstream ends. All high points along the pipeline shall be vented to permit the complete removal of all air within the pipeline. The conduit shall be slowly filled with water such that no air is entrapped during the filling operations.
- b. The testing pressure specified in section 14 of this specification shall be continuously maintained at the upstream gauge for a minimum of 2 hours. The pressure at the downstream gauge shall not exceed the pressure rating of the pipe.
- c. The volume of water leakage for the 2-hour test period shall be recorded. Maximum allowable leakage shall be in accordance with the following:

Allowable leakage for plastic pipe
(gal/hr/1,000 feet, or 50 pipe joints) 1/

Nominal pipe size (in)	Test pressure in the pipeline (lb/in ²)			
	50	100	150	200
	----- Allowable leakage -----			
4	.19	.27	.33	.38
6	.29	.41	.50	.57
8	.38	.54	.66	.76
10	.48	.68	.83	.96
12	.57	.81	.99	1.15
14	.67	.95	1.16	1.34
15	.72	1.02	1.25	1.44
16	.76	1.07	1.32	1.52
18	.86	1.22	1.49	1.72

1/ Computation basis $L = \frac{ND\sqrt{P}}{7,400}$

where:

- L = allowable leakage in gallons per hour
- N = number of joints (pipe and fittings)
- D = nominal diameter of pipe in inches
- P = test pressure in pounds per square inch

- d. When observed leakage exceeds the allowable, leaks shall be sealed by replacement of pipe and fittings as necessary. The conduit shall be retested as described in this section. The procedure shall be repeated until the conduit leakage does not exceed the allowable specified above.

The contractor shall be fully responsible for any and all work required to correct leakage exceeding the amount specified.

13. Measurement and payment

Method 1—For items of work for which specific unit prices are established in the contract, the quantity of each kind, size, and class of pipe is determined to the nearest foot by measurement of the laid length along the crown centerline of the conduit. Payment for each kind, size, and class of pipe is made at the contract unit price for that kind, size, and class. Such payment constitutes full compensation for furnishing, transporting, and installing the pipe including excavation, shoring, backfill, bedding, thrust blocks, and all fittings, appurtenances, and other items necessary and incidental to the completion of the work. Payment for appurtenances listed separately in the bid schedule is made at the contract prices for those items.

Method 2—For items of work for which specific unit prices are established in the contract, the quantity of each kind, size, and class of pipe is determined as the sum of the nominal laying lengths of the sections used. Payment for each kind, size, and class of pipe is made at the contract unit price for the kind, size, and class. Such payment constitutes full compensation for furnishing, transporting, and installing the pipe including excavation, shoring, backfill, bedding, thrust blocks, and all fittings, appurtenances, and other items necessary and incidental to the completion of the work. Payment for appurtenances listed separately in the bid schedule is made at the contract prices for those items.

Method 3—For items of work for which specific unit prices are established in the contract, the quantity of each kind, size, and class of pipe is determined to the nearest foot by measurement of the laid length along the crown centerline of the conduit. Payment for each kind, size, and class of pipe is made at the contract unit price for the kind, size, and class. Such payment constitutes full compensation for furnishing, transporting, and installing the pipe including shoring, all fittings, thrust blocks, appurtenances, and other items necessary and incidental to the completion of the work. Payment for appurtenances listed separately in the bid schedule is made at the contract prices for those items.

Method 4—For items of work for which specific unit prices are established in the contract, the quantity of each kind, size, and class of pipe is determined as the sum of the nominal laying lengths of the pipe sections used. Payment for each kind, size, and class of pipe is made at the contract unit price for that kind, size, and class. Such payment constitutes full compensation for furnishing, transporting, and installing the pipe including shoring, all fittings, thrust blocks, appurtenances, and other items necessary and incidental to the completion of the work. Payment for appurtenances listed separately in the bid schedule is made at the contract prices for those items.

Methods 3 and 4—Excavation, backfill, and bedding is paid separately under their respective bid items.

All measurement and payment methods—Compensation for any items of work described in the contract, but not listed in the bid schedule, is included in the payment for the item of work to which it is made subsidiary. Such items and items to which they are made subsidiary are identified in section 14 of this specification.

14. Items of work and construction details

Instructions for use Construction Specification 46—Tile Drains

1. Applicability

Construction Specification 46 is applicable to the installation of clay and concrete drain tile for land drainage.

2. Material specifications

The following material specifications complement Construction Specification 46:

543—Nonreinforced Concrete Pipe

544—Clay Pipe and Drain Tile

3. Included items

Items to be included in contract specifications and drawings follow:

- a. Line and grade for tile/pipe. Include statement in items of work that pipe shall be installed so that there is no reversal of grade between joints unless specifically shown otherwise on the drawings.
- b. Kind, size, and class of tile and/or pipe.
- c. Typical cross sections, including typical bedding details.
- d. Special fittings, appurtenances, and other items necessary to complete the work.
- e. Maximum and minimum trench widths.
- f. Procedures to use where unstable soils are encountered. Consider contractor's responsibility for construction safety.
- g. Typical pipe outlets.
- h. Details of appurtenances.
- i. Location and details of any special tile/pipe bedding requirements.
- j. Use or restrictions of automatic backfillers.
- k. Location of required compacted backfill.
- l. Details of any special fittings.
- m. Type of joint required (including spacers where required).
- n. Type, kind, and size of material to be used to cover joint or pipe.
- o. Type of envelope or filter.
- p. Gradation of sand-gravel envelope or filter material. Note the limits of the moisture content of sand material so bulking is avoided.
- q. Directions for covering pipe with envelope or filter material. Provide caution to avoid the dropping of gravel/rock material directly on clay tile.

4. Methods

Methods are included in sections 4, 5, and 7. The methods are self-explanatory.

When specifications are prepared using electronic procedures and all methods but one are deleted for use in the contract specification, delete from the last paragraph, *All Methods The following provisions apply to all methods of measurement and payment.* Left justify the remaining text.

5. Items of work and construction details

Starting at the top of page 46-4, prepare and outline job specific "Items of Work and Construction Details" (IWCD) in accordance with these instructions. For ease of utilization, the use of recyclable color paper for the IWCD should be considered.

Construction Specification 46—Tile Drains

1. Scope

The work consists of furnishing and installing drain tile and necessary fittings and appurtenances.

2. Material

Unless otherwise specified, the drain tile and fittings shall conform to the requirements of Material Specification 543, Nonreinforced Concrete Pipe, or Material Specification 544, Clay Pipe and Drain Tile, whichever is applicable.

3. Excavation

Unless otherwise specified, excavation for the installation of each tile line shall begin at the outlet end and progress upstream.

The trench or excavation for the tile shall be constructed to the depths and cross-sections shown on the drawings. The trench width may be increased above the top of the tile at the option of the contractor.

Trench shields, shoring and bracing, or other methods necessary to safeguard construction personnel and to prevent damage to the existing improvements shall be furnished, placed, and subsequently removed by the contractor.

4. Preparing the tile bed

Method 1—In stable soils the tile shall be firmly and uniformly bedded throughout its entire length to the specified depth and in the specified manner.

When the bottom of the trench does not provide a sufficiently stable or firm foundation for the drain tile, cradles for the tile (constructed of timber or fabricated lumber of a cleat-and-rail type construction), a sand-gravel mix, or other approved material shall be used to stabilize the bottom of the trench.

Drain tile shall not be laid on a rock foundation. In the event that boulders, rocks or ledge rock, or cemented material that prevents satisfactory bedding are encountered at the required grade with the trench cross-section, the trench shall be excavated to a minimum depth of 6 inches below grade and backfilled to grade with a sand-gravel mixture or other approved material. The bedding material shall be shaped to grade and compacted.

Method 2—Tile shall be bedded as shown on the drawings or as specified in section 10 of this specification.

5. Laying tile and joint covering

Method 1—Gaps between tile ordinarily shall be from 1/8 inch to 1/4 inch in clay, clay loam, and cohesive soil. Tile is laid without gaps in sandy soils and on lines to convey water with no intention of providing drainage.

Where tile is installed with the width of joint opening exceeding the limits stated above for noncohesive silts and fine and medium sands, the joint shall be covered with a permanent type material, such as coal tar pitch treated roofing paper, fiber glass sheet or mat, or plastic sheeting.

For tile installations on a curve alignment, the outside tile gap shall be covered with tile bats (broken tile) or covered as described above when the gap exceeds the recommended gap for the type of soil encountered. To maintain the gap within the allowable range, the inside pipe lip may be chipped and fitted to secure the required joint opening.

The ends and inside surface of all tiles shall be kept clean during installation. All earth or other extraneous material within the tile shall be removed before installation of the next tile section. At the end of work each day and when laying has been temporarily suspended, the inlet end shall be blocked so that earth or other extraneous material cannot enter the tile. The upper end of each tile line shall be blocked with permanent type material following satisfactory completion of tile installation.

Method 2—Tile shall be laid and joints shall be covered in the manner shown on the drawings or as specified in section 10 of this specification.

6. Connections

Lateral connections are made with manufactured junctions comparable in strength with the specified tile unless otherwise specified.

Where existing tile lines not shown on the drawings are crossed, they shall be bridged across the new trench or they shall be connected into the new tile lines, as directed by the engineer.

7. Blinding or filter material

Method 1—As soon as the tiles are placed satisfactorily, they shall be blinded by covering with friable soil material to a minimum depth of 6 inches. Material used for blinding shall not be frozen and, unless otherwise specified in section 10 of this specification, shall contain no rocks or stones that when dropped may cause tile damage. Sandy and other noncohesive soil shall not be used for blinding unless the joints are covered. All tile placed during any day shall be blinded at the completion of the work activities that day.

Method 2—Tile shall be covered with sand and gravel meeting the gradation, quality, quantities, and dimensions requirements and installed as shown on the drawings or as specified in section 10 of this specification. Material used for blinding shall not be frozen or contain rocks or stones that when dropped may cause tile damage. All tile placed during any day shall be blinded at the completion of the work activities that day.

Method 3—Unless otherwise specified, tile shall be covered with material obtained from required trench excavations.

8. Backfilling

Backfilling of the trench shall be completed as rapidly as consistent with the soil conditions.

Automatic backfilling machines may be used only when approved by the engineer. Backfill shall extend above the ground surface and be well rounded and centered over the trench.

Unless otherwise specified, where drain tile is installed under roads and at other designated locations shown on the drawings, the backfill shall be placed in successive layers of not more than 6 inches and each layer shall be compacted before the next layer is placed. The density of the compacted backfill shall not be less than the density of the surrounding adjacent earth material unless otherwise specified in section 10 of this specification.

9. Measurement and payment

For items of work for which specific unit prices are established in the contract, the quantity of each kind, size, and class of tile is determined to the nearest foot of length measured along the centerline of the installed tile. Payment for each kind, size, and class of tile is made at the contract unit price for that kind, size, and class of tile. Such payment constitutes full compensation for furnishing, transporting, and installing the tile, including excavation, shoring, backfill, and all fittings, appurtenances, and other items necessary and incidental to the completion of the work. Payment for appurtenances listed separately in the bid schedule is made at the contract prices for the sizes and types of appurtenances listed.

Compensation for any item of work described in the contract, but not listed in the bid schedule is included in the payment for the item of work to which it is made subsidiary. Such items and the items to which they are made subsidiary are identified in section 10 of this specification.

10. Items of work and construction details

Instructions for use Construction Specification 51—Corrugated Metal Pipe

1. Applicability

Construction Specification 51 is applicable to the installation of all types of corrugated metal pipe conduits.

2. Material specifications

The following material specifications complement Construction Specification 51:
551—Coated Corrugated Steel Pipe
552—Aluminum Corrugated Pipe

3. Included items

Items to be included in contract specifications and drawings follow:

- a. Line and grade of the conduit.
- b. Details of the pipe bedding including description and grading limits of the bedding material.
- c. Details of wall fittings, joint and other special pipe fittings.
- d. Details of struts or ties, as necessary.
- e. Pay limits or actual limits for excavation and backfill, if required. Due consideration of OSHA safety requirements for trench excavation should be considered for pay quantities.
- f. Applicable material specifications.
- g. Type, class, size, gauge, and length of pipe.
- h. Type of coupling and gasket, if required. Coupling bands may be detailed on the drawings and described in section 11, or may be specified in section 11 by describing the performance requirements by reference to ASTM A 798, paragraph 8, Pipe Installation. Using ASTM A 798, joint watertightness may be specified per paragraph 8.2.4.6 Watertightness; however, the method of testing and the basis for determining acceptance is needed.

- i. Close riveting or double riveting, if required.
- j. Type of pipe coating, if required.
- k. Methods of measurement and payment if the contract specification includes more than one method.
- l. Backfill requirements. Compaction requirements should be equal to requirements for the adjacent embankment for principal spillways or similar installations.

4. Methods

Section 10, Measurement and payment

The methods are self-explanatory.

When specifications are prepared using electronic procedures and all methods but one are deleted for use in a contract specification, delete from the last paragraph, *All Methods The following provisions apply to all methods of measurement and payment.* Left justify the remaining text.

5. Items of work and construction details

Starting at the top of page 51-4, prepare and outline job specific "Items of Work and Construction Details" (IWCD) in accordance with these instructions. For ease of utilization, the use of recyclable color paper for the IWCD should be considered.

Construction Specification 51—Corrugated Metal Pipe

1. Scope

The work consists of furnishing and placing circular, arched, or elliptical corrugated metal pipe and the necessary fittings.

2. Material

Pipe and fittings shall conform to the requirements of Material Specification 551, Coated Corrugated Steel Pipe, or Material Specification 552, Aluminum Corrugated Pipe, whichever is specified.

Unless otherwise specified in section 11 of this specification, perforated pipe furnished shall conform to the requirements for Class I perforations as described in ASTM A 760 or A 762.

3. Coupling bands and hardware

Pipe joint coupling bands shall be provided meeting the requirements specified in section 11 of this specification.

Hardware consisting of coupling bands and band fastening devices, such as connecting bolts, rods, lugs, and angles used in conjunction with zinc-coated iron or steel pipe, shall be galvanized by the hot-dip method. Hardware used in conjunction with aluminum pipe and aluminum or aluminum-zinc alloy-coated iron and steel pipe shall be of the same material as the pipe except that hot-dip galvanized or cadmium-plated fasteners may be used. The surface of all band-fastening devices for pipe specified with bituminous or polymer coating shall be coated with asphalt-mastic material meeting the requirements of ASTM A 849. The coupling band shall be coated similar to that specified for the pipe unless otherwise specified in section 11 of this specification.

Coupling bands shall be installed to provide straight alignment of the connecting pipe ends. Unless otherwise specified in section 11 of this specification, the bandwidth shall be as specified in ASTM A 760 and A 762. The bands shall be positioned to overlap adjacent pipe ends equally. The coupling bands shall be corrugated to match the corrugations of the pipe section ends being connected.

4. Fabrication

Fabrication of appurtenant sections shall be performed as shown on the drawings and described in section 11 of this specification. The items may consist of inlet sections, outlet sections, end sections, elbows, skew or beveled sections, rod reinforced ends, cut-off collars, or headwalls. Fabrication of these appurtenant sections shall be made from metallic-coated material identical to that from which the attached pipe is fabricated. Fabrication shall be of a quality and finished workmanship equal to that required for the pipe.

5. Handling the pipe

The contractor shall furnish equipment as necessary to install the pipe without damaging the pipe or coating. The pipe shall be transported and handled in a manner to prevent damage to the pipe and coating.

6. Laying and bedding the pipe

Unless otherwise specified, the pipe shall be installed in accordance with the manufacturer's recommendations. Pipe shall be installed so no reversal of grade between joints results unless otherwise shown on the drawings. The pipe shall be installed with the outside laps of circumferential joints pointing upstream and with longitudinal laps at the sides near the vertical mid-height of the pipe.

Field welding of corrugated galvanized iron or steel pipe is not permitted. The pipe sections shall be joined with fabricator-supplied coupling bands meeting the specified joint requirements. The coupling shall be installed as recommended by the fabricator.

The pipe shall be firmly and uniformly bedded throughout its full length to the depth and in the manner specified on the drawings.

Perforated pipe shall be installed with the perforations down and oriented symmetrically about a vertical centerline. Perforations shall be clear of any obstructions at the time the pipe is installed in its final position.

The pipe shall be loaded sufficiently during backfilling to prevent displacement from line and grade and to maintain full contact with the bedding during the placement operations.

7. Strutting

When required, struts or horizontal ties shall be installed in the manner specified on the drawings. Struts and ties shall remain in position until the backfill has been placed above the top of the pipe to a height of 5 feet or the pipe diameter, whichever is greater, or to the surface of the completed earth backfill when the fill height is less than 5 feet above the top of the pipe. The contractor shall remove the struts or ties following completion of the earth backfill requirements that apply.

8. Embedment in concrete

Special treatment shall be provided to the pipe surface when embedded or attached to concrete and the pipe material is aluminum or aluminum-coated and aluminum-zinc alloy-coated. Potential contact surfaces in contact with concrete and masonry surfaces shall be coated with two coats of a bituminous paint of the cutback type. Placement of the pipe shall be such that direct metal-to-metal contact with other metallic material, such as embedded steel reinforcement or water control gates, is prevented.

9. Repair of damaged coating

Any damage to the metallic coating shall be repaired by cleaning the damaged surface area by sand blasting, power disk sanding, or wire brushing. All loose and cracked coating, dirt, and any products of corrosion shall be removed before application of paint. Oil and grease material shall be removed by use of a solvent. The surface shall be clean and dry during the painting period and until the coating has completely dried.

Painting shall be accomplished by one of the following options based upon installed exposure conditions of the pipe as determined by the engineer.

Normal exterior or interior atmospheric exposure:

- a. Zinc dust - zinc oxide primer, ASTM D 79 and D 520
- b. Single package, moisture cured urethane prime in silver metallic color, or
- c. Zinc-rich cold galvanized compound, brush, or aerosol application

Submergence in water exposure:

- a. Zinc dust - zinc oxide primer, ASTM D 79 and D 520
- b. Zinc dust paint, ASTM D 4146

When the metallic coating is damaged in any individual area larger than 12 square inches or if more than 0.2 percent of the total surface area of a single pipe section is damaged, that section of pipe will be rejected.

Breaks or scuffs in bituminous coatings that are less than 36 square inches in area shall be repaired by applying two coats of hot-asphaltic paint or a coating of cold-applied bituminous mastic. The repair coating shall be a minimum of 0.05 inch thick after hardening and shall bond securely and permanently to the pipe and coating. The material shall meet the minimum physical requirements for bituminous coating in ASTM A 849 and A 885. Whenever individual breaks exceed 36 square inches in area or when the total area of breaks exceeds 0.5 percent of the total surface area of an individual pipe section, that section of pipe will be rejected.

Bituminous coating damaged by welding of coated pipe or pipefittings shall be repaired as specified in this section for breaks or scuffs in bituminous coatings.

Breaks or scuffs in polymer coatings that are less than 36 square inches in area shall be repaired by the application of a polymer material similar to and compatible with the durability, adhesion, and appearance of the original polymer coating, as described in ASTM A 849, paragraph 6.8. The repair coating shall be a minimum thickness of 0.010 inch (10 mils) after drying. Whenever individual breaks exceed 36 square inches in area or when the total area of breaks exceeds 0.5 percent of the total surface area of the individual pipe section, that section of pipe will be rejected.

10. Measurement and payment

Method 1—For items of work for which specific unit prices are established in the contract, the quantity of each type, class, size, and gauge of pipe is determined to the nearest 0.1 foot by measurement of the laid length of the pipe along the centerline of the pipe. Payment for each type, class, size, and gauge of pipe is made at the contract unit price for that type, class, size and gauge of pipe. Such payment constitutes full compensation for furnishing, transporting, and installing the pipe and fittings and all other items necessary and incidental to the completion of the work except items designated as *special fittings*. Special fittings are those sections of pipe requiring special fabrication to meet layout requirements. Payment for special fittings is made at the contract unit price for special fittings (CMP).

Method 2—For items of work for which specific unit prices are established in the contract, the quantity of each type, class, size, and gauge of pipe is determined as the sum of the nominal laying lengths of the pipe sections installed. Payment for each type, class, size, and gauge of pipe is made at the contract unit price for that type, class, size, and gauge of pipe. Such payment constitutes full compensation for furnishing, transporting, and installing the pipe and fittings and all other items necessary and incidental to the completion of the work except items designated as *special fittings*. Special fittings are those sections of pipe requiring special fabrication to meet layout requirements. Payment for special fittings is made at the contract unit price for special fittings (CMP).

Method 3—For items of work for which specific lump sum prices are established in the contract, payment for corrugated metal pipe structures is made at the contract lump sum price. Such payment constitutes full compensation for furnishing, fabricating, transporting, and installing the pipe structure complete with metal pipe, fittings, and appurtenances, and all other items necessary and incidental to completion of the work, which includes, except as otherwise specified, required excavation, dewatering, and earth backfill.

All Methods—The following provisions apply to all methods of measurement and payment. Compensation for any item of work described in the contract, but not listed in the bid schedule, is included in the payment for the item of work to which it is made subsidiary. Such items and items to which they are made subsidiary are identified in section 11 of this specification.

11. Items of work and construction details

Instructions for use Construction Specification 52—Steel Pipe

1. Applicability

Construction Specification 52 is applicable to the installation of steel pipe conduits.

2. Material specifications

The following material specifications complement Construction Specification 52:

554—Steel Pipe

581—Metal

3. Included items

Items to be included in contract specifications and drawings follow:

- a. Details of the bedding, including description and grading limits of the bedding material.
- b. Excavation requirements. If measurement and payment method 1 or 2 is used, a bid item and items of work and construction details for excavation and backfill would normally be covered under Construction Specification 21 and 23. If measurement and payment method 3 or 4 is used, construction details for excavation can be covered either in section 12, or as a subsidiary item under Construction Specification 21.
- c. Method of backfill selected from section 10.
- d. Pay limits or actual limits for excavation and backfill, if required.
- e. Kind of pipe. Include name, type, grade, finish, weight class, and wall thickness as required. (See appropriate reference specifications.)
- f. Size of pipe.
- g. Length of pipe.
- h. Type of protective lining and coating if required (Refer to AWWA Standard C203, AWWA Standard C209, or AWWA Standard

C214 for detailed information). **Note:** In accordance with AWWA C203, field welded pipe 27-inch diameter and larger is large enough to allow entry of personnel to clean the welded surface and apply primer and enamel. Therefore, lined pipe smaller than 27-inch diameter should not be field welded.

- i. Type of joint and details of special joints.
- j. Details of wall fittings and other special fittings and appurtenances.
- k. Watertightness or pressure test requirements, if applicable.
- l. Shop coating of fittings if the vinyl option is specified as described in section 6.
- m. Bonding details for cathodic protection, if applicable.
- n. Method of field lining, coating, wrapping, and repair selected from section 7.
- o. Method of measurement and payment in section 11.

4. Methods

Section 7, Field Lining, Coating, Wrapping, and Repair

Method 1—Intended for use when hot-applied linings and/or coatings are required or for repairing hot applied linings and/or coatings.

Method 2—Intended for use when cold-applied tapes are required for wrapping assembled joints and for repair of hot applied coatings.

Method 3—Intended for use when the pipe is coated in accordance with AWWA Standard C214.

Method 4—Intended for use when cold-applied linings and/or coatings are required or for repairing linings and/or coatings.

More than one method may be used, in which case the paragraphs should be linked with the word **or** and the following paragraph inserted before the last paragraph in the section:

All Methods—The following provisions apply to all methods of field coating, wrapping, and coating repair.

Section 10, Backfill

The methods are self-explanatory.

Section 11, Measurement and payment

The methods are self-explanatory.

When specifications are prepared using electronic procedures and all methods but one are deleted for use in a contract specification, delete from the last paragraph, **All Methods The following provisions apply to all methods of measurement and payment.** Left justify the remaining text.

5. Items of work and construction details

Starting at the top of page 52–6, prepare and outline job specific "Items of Work and Construction Details" (IWCD) in accordance with these instructions. For ease of utilization, the use of recyclable color paper for the IWCD should be considered.

Construction Specification 52—Steel Pipe

1. Scope

The work shall consist of furnishing and installing steel pipe complete with lining, coating, fittings, and appurtenances.

2. Material

Steel pipe and fittings shall conform to the requirements of Material Specification 554, Steel Pipe.

Unless otherwise specified, special fittings and appurtenances shall be of the same material as the pipe.

Welding electrodes shall conform to the requirements of Material Specification 581, Metal.

Coating and lining materials shall conform to the requirements of the following:

- AWWA C203, Standard for Coal-Tar Protective Coatings and Linings for Steel Water Pipelines - Enamel and Tape - Hot-Applied
- AWWA C209, Standard for Cold-Applied Tape Coatings for the Exterior of Special Sections, Connections, and Fittings for Steel Water Pipelines
- AWWA C214, Standard for Tape Coating Systems for the Exterior of Steel Water Pipelines

and as specified below:

- Shop coating material shall conform to the requirements of AWWA Standard C203 and AWWA Standard C214 and as specified in section 12 of this specification.
- Shop lining material shall conform to the requirements of AWWA Standard C203.
- Field coating and coating repair material shall conform to the requirements of AWWA Standard C203, AWWA Standard C209, AWWA Standard C214, and, as specified in Section 12 of this specification.
- Field lining material shall conform to the requirements of AWWA Standard C203 and as specified in section 12 of this specification.

3. Coating and lining

Shop coating of pipe, specials, and fittings shall be in accordance with AWWA Standard C203, AWWA Standard C209, or AWWA Standard C214 and as specified in Section 12 of this specification.

Shop lining of pipe, specials, and fittings shall conform to the requirements of AWWA Standard C203.

4. Excavation

Excavation shall be in accordance with Construction Specification 21 or as specified in section 12 of this specification.

5. Laying and bedding the pipe

Pipe shall be installed to the line and grade shown on the drawings. Unless otherwise specified, the pipe shall be installed so that there are no reversals of grade between joints, and shall be installed in accordance with the manufacturer's recommendations. The pipe shall be firmly and uniformly bedded to the depth and in the manner specified on the drawings. An ample bell hole working area may be left at pipe joints to perform welding, coating, and other related activities. The bell hole area shall then be bedded, as specified, before backfill operations.

The pipe shall be weighed down sufficiently to prevent its displacement from the bedding during placement of the backfill under the haunches.

6. Joints and connections

Pipe joints shall conform to the details shown on the drawings and shall be sound and watertight at the pressures specified in section 12 of this specification.

Welded joints—Welding and welded joints shall conform to the welding procedure details and requirements of AWWA Standard C206. Field welding shall be done in such a way as to avoid burning the protective coating on the pipe except in the immediate vicinity of the weld.

Where welded field joints are used, they shall be single welded butt joints or lap welded slip joints, as shown on the drawings. Special closure lap joints shall be used as described in AWWA Standard C206.

Bell and spigot joints—The dimensions of bells and spigots shall be in accordance with the manufacturer's standard design dimensions and tolerances.

The pipe shall be laid with the bell oriented upstream. The spigot end shall be seated in the bell to a depth as recommended by the manufacturer. The spigot, when seated, shall compress the gasket radially in its annular recess to provide a positive seal. Joints with fish-mouthed gaskets will be taken apart and reseated with a new gasket.

Rubber gaskets shall meet the requirements of AWWA Standard C200.

Mechanical couplings—The ends of pipe to be connected with mechanical couplings shall be machined to allow coupling the pipe sections without damaging or displacing the gaskets and to ensure uniform end separation of the pipes. Machined ends of the pipe that receive the coupling sleeves shall be free from dents, gouges, rust, or scale. The pipe and couplings shall be assembled with continuous rubber ring gaskets conforming to the dimensions and tolerances recommended by the pipe manufacturer. Coupling followers shall be drawn up evenly to ensure uniform pressure on the gaskets.

Grooved and shouldered joints shall be furnished and installed in accordance with AWWA Standard C606.

Flanged joints—All steel ring flanges shall be fabricated in accordance with AWWA Standard C207. Gaskets shall be either a neoprene cloth insert 1/16 or 1/8 inch thick or red rubber 1/16 inch thick. The gasket shall be full face where used between flat face flange surfaces. All flanged joints shall be made up tightly and shall not leak.

Fitting and coupling coatings—Compression couplings, mechanical couplings, and flanged fittings shall be shop coated with the AWWA Standard C203 coal tar enamel coating, as recommended by the coating manufacturer, or a factory-applied vinyl coating at least 12 mils thick and as specified in section 12 of this specification. All bolts furnished for flanges, couplings, and other types of bolted connections shall be stainless steel or low alloy steel and shall be field coated with a coal tar enamel or vinyl coating after installation.

7. Field lining, coating, wrapping, and repair

Lining and coating or wrapping of field joints or connections and repair of damage to the wrap or coating on pipe, couplings, fittings, and appurtenances shall be made in accordance with section 12 of this specification and one of the following methods:

Method 1—All field coating, lining, and repair shall be as specified in AWWA Standard C203.

Method 2—All field wrapping and repair shall be as specified in AWWA Standard C209 with type I or II tape.

Method 3—All field wrapping and repair shall be as specified in AWWA Standard C214 and as specified in section 12 of this specification.

Surface preparation—Bare steel surfaces shall be prepared for coating by removing all grease and oil or other soluble contaminants with solvent commercial cleaners (wiping, dipping, or steam) or vapor degreasing. After degreasing, surfaces shall be cleaned with hand tools to remove all loose scale rust and other loose detrimental foreign matter.

On previously coated surfaces, all dirt, paper, and other foreign matter and loose coating shall be removed. Kraft paper, whitewash, or other surface protective layers shall be removed at least 12 inches on either side of the bare steel to be coated.

Welds shall be cleaned of all welding slag, splatter, and scale. Sharp edges or burrs that could puncture or cut the coating shall be removed by grinding or filing. All welds shall be allowed to cool before applying primer or coatings.

Primer application—After surface preparation is complete, primer shall be thoroughly mixed and applied in strict adherence to manufacturer's instructions. The primer shall be permitted to dry to the consistency recommended by the manufacturer before applying the coating. No foreign matter shall come in contact with the primed surface before application of the coating. Application of primer to surfaces shall be limited to that amount of area that can be wrapped during the same workshift. Primed areas not wrapped during the same workshift shall be reprimed. Cold weather applications of primer shall be done in accordance with AWWA Standard C203.

Coating application—The specified coating shall be applied in accordance with the manufacturer's recommendations unless otherwise specified.

After assembly, all pipe joints shall be field wrapped in accordance with AWWA C209 or AWWA C214, as appropriate. Surface preparation and primer application to the ends of the pipe to be wrapped shall be as previously described in this specification. A tape or filler tape shall be cigarette wrapped over the annular ring of the joint. The pipe coating shall be primed 2 inches back from the coating cutback and two layers of tape shall be wrapped overlapping 2 inches of pipe coating on one side of the joint, extending across the joint and overlapping 2 inches of coating on the other side of the joint. Coal tar enamel coating cutback edges shall be tapered back until 1 inch of coal tar is exposed on the taper before priming and wrapping. Wraps shall be terminated on the underside of the pipe. Tape widths shall be 6 inches for pipe greater than 8 inches in diameter and 4 inches for pipe 2 to 8 inches in diameter.

Welded field joints of lined pipe shall be lined in accordance with AWWA Standard C203, section 4.3, or as specified in section 12 of this specification.

Repair and patching factory coatings—All loose or disbonded material shall be removed from the area of the "holiday." All points, burrs, or rough edges shall be smoothed to a feathered edge. The surface shall be cleaned and prepared as specified for joints, couplings, and fittings. The area to be cleaned and prepared shall be at least twice the size of the "holiday." The repair coating shall be worked onto the surface of the steel to leave no voids or wrinkles on the surface.

Coal tar enamel coatings shall be repaired in accordance with AWWA Standard C203, section 2.15. Tape coatings shall be repaired in accordance with AWWA Standard C214, Section 3.4, Coating Repair. The repair shall be made by wrapping tape around the circumference of the pipe.

All damaged vinyl coat areas shall be cleaned and recoated in accordance with the manufacturer's recommendation.

8. Handling the pipe

The contractor shall furnish such equipment as is necessary to place the pipe without damaging the pipe or coating. Coated pipe shall be handled in the manner specified in AWWA Standard C203 or C214, as appropriate.

9. Pressure testing

If pressure testing of the conduit is specified, it shall be performed as follows:

- a. Placement of backfill before pressure testing shall be as specified in section 10 of this specification.
- b. Before pressure testing, the pipeline shall be flushed and cleaned.
- c. The pipeline shall not be pressure tested until concrete in the anchor and thrust blocks has attained the minimum specified compressive strength.
- d. The total conduit or section of the conduit, to be tested shall be filled with clean water at the rate specified and tested at the pressure specified in section 12 of this specification.
- e. The section of conduit being tested shall be allowed to stand full of water for at least 24 hours before the start of pressure and leakage test. Test pressure shall be held constant for 2 hours. If the amount of water loss exceeds the limit specified, the leaks shall be repaired and the conduit shall be retested. The procedure shall be repeated until the amount of water loss is within the limits specified in section 12 of this specification.

10. Backfill

Method 1—Backfill, in accordance with Construction Specification 23 and section 12 of this specification, shall be made only in sufficient amount to hold the conduit in place during testing, with the following exceptions:

- a. Compacted backfill shall be placed to its final depth as shown on the drawings at vertical and horizontal angle points, road crossings, and thrust blocks. Backfill shall be placed in such a way that the conduit and joints will not be subject to displacement or damage.
- b. All joints and connections shall be completely exposed for visual inspection during testing, except at locations that may be exempt as outlined in the previous exemption.

Method 2—Backfill, in accordance with Construction Specification 23 and section 12 of this specification, shall be to its final depth as shown on the drawings for the section of conduit being tested.

Use with either method—The contractor shall be fully responsible for any and all work required to repair any leakage when water loss exceeds the amount specified in section 12 of this specification. After pressure testing is satisfactorily completed, the backfill shall be placed in accordance with Construction Specification 23 and section 12 of this specification.

11. Measurement and payment

Method 1—For items of work for which specific unit prices are established in the contract, the quantity of each type and size of pipe is determined to the nearest 0.1 foot by measurement of the installed length of pipe along the centerline of the pipe. Payment for each type and size of pipe is made at the contract unit price for that type and size of pipe. Such payment constitutes full compensation for furnishing, transporting, and installing the pipe, including the necessary fittings and all other items necessary and incidental to the completion of the work.

Method 2—For items of work for which specific unit prices are established in the contract, the quantity of each type and size of pipe is determined to the nearest 0.1 foot by measurement of the installed length of pipe along the centerline of the pipe. Payment for each type and size of pipe is made at the contract unit price for that type and size of pipe. Such payment constitutes full compensation for furnishing, transporting, and installing the pipe, complete in place, including the necessary fittings and all other items necessary and incidental to the completion of the work except the special fittings and appurtenances listed separately in the bid schedule. Payment for each special fitting and appurtenance is made at the contract unit price for that type and size of fitting or appurtenance.

Method 3—For items of work for which specific unit prices are established in the contract, the quantity of each type and size of pipe is determined to the nearest 0.1 foot by measurement of the installed length of pipe along the centerline of the pipe. Payment for each type and size of pipe is made at the contract unit price for that type and size of pipe. Such payment constitutes full compensation for furnishing, transporting, and installing the pipe, including excavation, shoring, backfill, and all the necessary fittings and all other items necessary and incidental to the completion of the work.

Method 4—For items of work for which specific unit prices are established in the contract, the quantity of each type and size of pipe is determined to the nearest 0.1 foot by measurement of the installed length of pipe along the centerline of the pipe. Payment for each type and size of pipe is made at the contract unit price for that type and size of pipe. Such payment constitutes full compensation for furnishing, transporting, and installing the pipe, complete in place, including excavation, shoring, backfill, and all the necessary fittings and all other items necessary and incidental to the completion of the work except the special fittings and appurtenances listed separately in the bid schedule. Payment for each special fitting and appurtenance is made at the contract unit price for that type and size of fitting or appurtenance.

All methods—The following provisions apply to all methods of measurement and payment. Compensation for any item of work described in the contract, but not listed in the bid schedule, is included in the payment for the item of work to which it is made subsidiary. Such items, and the items to which they are made subsidiary, are identified in section 12 of this specification.

12. Items of work and construction details

Instructions for use

Construction Specification 53—Ductile-Iron Pipe

1. Applicability

Construction Specification 53 is applicable to the installation of ductile-iron pipe and fittings used in water distribution systems.

2. Material specifications

Material Specification 553, Ductile-Iron Pipe, complements Construction Specification 53.

3. Included items

Items to be included in the contract specifications and drawings follow:

- a. Line and grade of the conduit. Include a statement in items of work that the pipe shall be installed so reversal of grade between joints does not occur unless shown on the drawings.
- b. Details of bedding including description and grading limits of bedding material.
- c. Method of backfill consistent with minimum job requirements, complexity, and inspection compliance considerations. Refer to Construction Specification 23, Earthfill, if used.
- d. Pay limits or actual limits for excavation, minimum trench width, and any special considerations necessary. Consider the need for contractor's compliance with the excavation safety requirements of OSHA.
- e. Pay limits of actual limits of backfill, compaction requirements, or other special methods of performance and controlling backfill, as appropriate. (AWWA Standard C600 provides a prepared standard that may be referenced for installation as appropriate.) Provide the necessary guidance when sand bedding is specified so bulking potential is avoided.
- f. Kind of pipe (thickness class and rated working pressure).
- g. Size of pipe (diameter).
- h. Laying length of pipe.
- i. Type of joints for pipe and fittings (mechanical push-on or flanged). Pipe joining details if different from manufacturer's recommendations.
- j. Lining thickness and coating for pipe (interior and exterior) and methods of repair. Loose polyethylene pipe encasement, tube or sheet form, for corrosion protection can be specified as per ANSI A21.5 (AWWA C105). Provide placing and handling details as appropriate. Protective coatings applied to the pipe during manufacture must be specified on the job basis. Outline minimum repair procedures to correct tears and rips in the loose encasement coverings.
- k. Pressure and leakage test requirements including the duration of the test period.
- l. Details of special fittings and appurtenances.
- m. Concrete thrust and anchor block specifications and details.

4. Methods

Section 7, Backfill

Methods are self-explanatory.

Section 8, Measurement and Payment

When deduction in measured pipe length will be made for special fittings and other appurtenances, outline in section 9 the procedures that will be implemented to determine pipe length for payment purposes.

5. Items of work and construction details

Starting at the top of page 53-3, prepare and outline job specific "Items of Work and Construction Details" (IWCD) in accordance with these instructions. For ease of utilization, the use of recyclable color paper for the IWCD should be considered.

Construction Specification 53—Ductile-Iron Pipe

1. Scope

The work consists of furnishing and installing ductile-iron pipe, fittings, and appurtenances as specified in section 9 of this specification and as shown on the drawings.

2. Material

Ductile-iron pipe and fittings shall conform to the requirements of Material Specification 553, Ductile-Iron Pipe. Thickness class of pipe and rated working pressure shall be as specified in section 9 of this specification or as shown on the drawings.

Unless otherwise specified, special fittings and appurtenances shall be the same material as the pipe.

3. Laying and bedding the pipe

Pipe shall be installed to the lines and grades shown on the drawings with bell socket ends aligned upstream unless otherwise specified. The pipe shall be installed in accordance with the manufacturer's recommendations, unless otherwise specified. Two copies of the pipe manufacturer's installation instructions shall be provided to the engineer before any pipe placement. The pipe shall be firmly and uniformly bedded within the trench throughout the entire length of the pipe section to the depth and in the manner specified. Bell holes for flanged, push-on, or mechanical joint pipe shall be provided as necessary to allow space for joint assembly and to permit the pipe barrel to be uniformly supported on the bedding.

4. Joints and connections

Pipe joints shall conform to the details shown on the drawings and shall be sound and watertight at the pressures specified in section 9 of this specification.

5. Handling the pipe

The contractor shall furnish all equipment and facilities needed to handle, store, and place the pipe without damaging the pipe, lining, encasement, or coating. Pipe coating, encasement, or lining that is damaged shall be repaired using methods recommended by the manufacturer unless otherwise specified in section 9 of this specification.

6. Pressure testing

Pressure testing of the conduit, when specified, shall be conducted as follows:

- a. Placement of backfill before pressure testing shall be as specified in section 7 of this specification.
- b. Before pressure testing, the pipeline shall be flushed and free of all foreign material.
- c. The pipeline shall not be pressure tested until concrete for anchor and thrust blocks has attained the minimum specified compressive strength unless other specified methods of thrust restraint are provided.
- d. The total conduit or continuous section of conduit to be tested shall be filled with clean water at a rate not to exceed the maximum specified and tested at the pressure(s) specified in section 9 of this specification.
- e. The section of conduit being tested shall be allowed to stand full of water for a minimum of 24 hours before the start of pressure and leakage tests. Test pressures shall be held constant for 2 hours. When the amount of water loss exceeds the maximum allowable loss specified in section 9 of this specification, the leak(s) shall be repaired or otherwise corrected and the conduit shall be retested. The testing procedure shall be repeated until the requirements of the specifications are met.

7. Backfill

Method 1—Backfill in accordance with section 9 of this specification shall be accomplished only in sufficient amount to hold the conduit in place during testing, with the following exceptions:

- a. Compacted backfill shall be placed to its final depth as shown on the drawings at vertical and horizontal deflection points, road crossings, and thrust blocks. Backfill shall be placed so that conduit and joint displacement does not occur.
- b. All joints and connections shall be completely exposed for visual observation during testing, except at locations described in the exception above.

Method 2—Backfill in accordance with section 9 of this specification shall be to the final depth as shown on the drawings for the section of conduit being tested.

Use with either method—The contractor shall be fully responsible for any and all work required to correct any leakage when the leakage test results in water loss that exceeds the amount specified in section 9 of this specification.

8. Measurement and payment

For items of work for which specific unit prices are established in the contract, the quantity of each size, and thickness class of pipe is determined to the nearest foot by measurement of the installed length of pipe along the crown centerline of the conduit. Payment for each size and thickness class of pipe is made at the contract unit price for that size and thickness class of pipe. Such payment constitutes full compensation for furnishing, transporting, handling, and installing the pipe and necessary fittings and appurtenances complete in place.

Compensation for any item of work described in the contract, but not listed, is included in the payment for the item of work to which it is made subsidiary. Such items and the items to which they are made subsidiary are identified in section 9 of this specification.

9. Items of work and construction details

Instructions for use Construction Specification 61—Rock Riprap

1. Applicability

Construction Specification 61 is applicable to equipment-placed or hand-placed rock riprap, granular filter, and granular bedding. It is also applicable for riprap placed over geotextile fabrics installed in accordance with Construction Specification 95.

2. Material specifications

Material Specifications 521, 523, and 592 complement Construction Specification 61. Select rock type 1, 2, or 3 of Specification 523, section 2, as appropriate and specify in section 8.

Rock type 1—For exposure conditions that require sound and durable material because of aggressive environment and demanding requirements, or in locations where replacement or repair would be difficult if breakdown or other failure were to occur.

Rock type 2—A lesser degree of durability is required while meeting a good standard of performance. The hazard is not a major consideration, and accessibility for repair or replacement is practical. No design changes are necessary for use of this rock type.

Rock type 3—Does not meet our normal requirements for quality, but because of the lack of onsite availability or availability of better materials, it is advantageous to use. Design changes, such as greater rock thickness and/or flatter slopes, may be required to compensate for the lack of long-term durability. More frequent repair and replacement should be anticipated.

3. Included items

Items to be included in contract specifications and drawings follow:

- a. Complete plans and cross-sections of the required riprap.

- b. Type of placement (equipment or hand-placed).
- c. Pay limits, where applicable.
- d. Foundation preparation requirements, if any.
- e. Gradation requirements for material.
- f. Screening, selection, or other processing requirements to ensure obtaining rock of the required quality and grading. For example, if angular to subangular rock is preferred over subrounded to rounded rock, specify this requirement in section 8.
- g. Sources of material if the sources are to be specified. When sources are designated in the contract, the adequacy of quantity and quality of usable material at each source must be determined in advance by:
 - (1) Geologic investigations with adequate sampling and testing
 - (2) Specific case history that establishes the quality by satisfactory performance under comparable conditions of use and exposure or acceptable prequalification by other agencies.
- h. ASTM D 5240 should be specified to check for rock resistance to freeze-thaw damage on sites that have large volumes of riprap, at highly hazardous locations, or on sites that would be difficult to repair if rock breakdown occurs. Acceptance limits in the specification must be evaluated and strengthened, if needed, to ensure the use of the appropriate rock type and quality.
- i. Method(s) of measurement and payment.
- j. When geotextile filters are specified, Construction Specification 95 should be used.

4. Methods

Section 8, Measurement and payment

The methods listed below provide two basic options for measuring and paying for rock riprap using either weight (ton) or volume (cubic yard) methods. Advantages of each option are as follows:

Weight—Ton methods would be more appropriate for quarried rock imported to a site. Contractors generally pay their supplier for quarried rock by the ton. Payment by the ton provides for direct pricing without the need to convert from a ton basis to cubic yards. Variations in riprap characteristics, such as rock specific gravity, transportation and placement losses, denseness of placement, make it necessary for the contractor to add contingencies that include these variations.

Volume—Cubic yard methods would be more appropriate for riprap that is produced from onsite locations, for gathered field stone, quarried rock sold by the truck load, and other situations where a certified scale is not readily available. It would also be appropriate for small quantities of rock where quantity measurement is not complex or a major task. Cubic yard methods can also be an advantage where the riprap end section is uniform for long reaches on larger projects. The elimination of the need to keep track of delivery tickets may be a considerable timesavings.

Cubic yard methods can be expected to impose some contingency considerations from the contractor because of the necessity to convert from tons to cubic yards in quantity estimation.

Methods 1, 2, and 3—Provide various means of measurement and are intended for use where filter or bedding aggregate, if any, is to be paid for as a separate item.

Method 4—Intended for use where filter or bedding aggregate is a minor item and payment for it is to be included in the payment for rock riprap.

Methods 5 and 6—Intended for use when geotextile filters are specified or when no filter, bedding aggregate, or geotextile are specified.

When all methods but one are deleted for use in a contract specification, delete from the last paragraph **All Methods The following provisions apply to all methods of measurement and payment.** Left justify the remaining text.

5. Items of work and construction details

Starting at the top of page 61–4, prepare and outline job specific "Items of Work and Construction Details" (IWCD) in accordance with these instructions. For ease of utilization, the use of recyclable color paper for the IWCD should be considered.

Construction Specification 61—Rock Riprap

1. Scope

The work shall consist of the construction of rock riprap revetments and blankets, including filter or bedding where specified.

2. Material

Rock riprap shall conform to the requirements of Material Specification 523, Rock for Riprap, or if so specified, shall be obtained from designated sources. It shall be free from dirt, clay, sand, rock fines, and other material not meeting the required gradation limits.

At least 30 days before rock is delivered from other than designated sources, the contractor shall designate in writing the source from which rock material will be obtained and provide information satisfactory to the contracting officer that the material meets contract requirements. The contractor shall provide the contracting officer's technical representative (COTR) free access to the source for the purpose of obtaining samples for testing. The size and grading of the rock shall be as specified in section 8.

Rock from approved sources shall be excavated, selected, and processed to meet the specified quality and grading requirements at the time the rock is installed.

Based on a specific gravity of 2.65 (typical of limestone and dolomite) and assuming the individual rock is shaped midway between a sphere and a cube, typical size/weight relationships are:

Sieve size of rock	Approx. weight of rock	Weight of test pile
16 inches	300 pounds	6,000 pounds
11 inches	100 pounds	2,000 pounds
6 inches	15 pounds	300 pounds

The results of the test shall be compared to the gradation required for the project. Test pile results that do not meet the construction specifications shall be cause for the rock to be rejected. The test pile that meets contract requirements shall be left on the job site as a sample for visual comparison. The test pile shall be used as part of the last rock riprap to be placed.

Filter or bedding aggregates when required shall conform to Material Specification 521, Aggregates for Drainfill and Filters, unless otherwise specified. Geotextiles shall conform to Material Specification 592, Geotextile.

3. Subgrade preparation

The subgrade surface on which the rock riprap, filter, bedding, or geotextile is to be placed shall be cut or filled and graded to the lines and grades shown on the drawings. When fill to subgrade lines is required, it shall consist of approved material and shall conform to the requirements of the specified class of earthfill.

Rock riprap, filter, bedding, or geotextile shall not be placed until the foundation preparation is completed and the subgrade surface has been inspected and approved.

4. Equipment-placed rock riprap

The rock riprap shall be placed by equipment on the surface and to the depth specified. It shall be installed to the full course thickness in one operation and in such a manner as to avoid serious displacement of the underlying material. The rock for riprap shall be delivered and placed in a manner that ensures the riprap in place is reasonably homogeneous with the larger rocks uniformly distributed and firmly in contact one to another with the smaller rocks and spalls filling the voids between the larger rocks. Some hand placing may be required to provide a neat and uniform surface.

Rock riprap shall be placed in a manner to prevent damage to structures. Hand placing is required as necessary to prevent damage to any new and existing structures.

5. Hand placed rock riprap

The rock riprap shall be placed by hand on the surface and to the depth specified. It shall be securely bedded with the larger rocks firmly in contact one to another without bridging. Spaces between the larger rocks shall be filled with smaller rocks and spalls. Smaller rocks shall not be grouped as a substitute for larger rock. Flat slab rock shall be laid on its vertical edge except where it is laid like paving stone and the thickness of the rock equals the specified depth of the riprap course.

6. Filter or bedding

When the contract specifies filter, bedding, or geotextile beneath the rock riprap, the designated material shall be placed on the prepared subgrade surface as specified. Compaction of filter or bedding aggregate is not required, but the surface of such material shall be finished reasonably smooth and free of mounds, dips, or windrows.

7. Measurement and payment

Method 1—For items of work for which specific unit prices are established in the contract, the quantity of each type of rock riprap placed within the specified limits is computed to the nearest ton by actual weight. The volume of each type of filter or bedding aggregate is measured within the specified limits and computed to the nearest cubic yard by the method of average cross-sectional end areas. For each load of rock riprap placed as specified, the contractor shall furnish to the COTR a statement-of-delivery ticket showing the weight to the nearest 0.1 ton.

Payment is made at the contract unit price for each type of rock riprap, filter, or bedding. Such payment is considered full compensation for completion of the work.

Method 2—For items of work for which specific unit prices are established in the contract, the quantity of each type of rock riprap placed within the specified limits is computed to the nearest 0.1 ton by actual weight. The quantity of each type of filter or bedding aggregate delivered and placed within the specified limits is computed to the nearest 0.1 ton. For each load of rock riprap placed as specified, the contractor shall furnish to the engineer a statement-of-delivery ticket showing the weight to the nearest 0.1 ton. For each load of filter or bedding aggregate, the contractor shall furnish to the COTR a statement-of-delivery ticket showing the weight to the nearest 0.1 ton.

Payment is made at the contract unit price for each type of rock riprap, filter, or bedding. Such payment is considered full compensation for completion of the work.

Method 3—For items of work for which specific unit prices are established by the contract, the volume of each type of rock riprap and filter or bedding aggregate is measured within the specified limits and computed to the nearest cubic yard by the method of average cross-sectional end areas.

Payment is made at the contract unit price for each type of rock riprap, filter, or bedding. Such payment is considered full compensation for completion of the work.

Method 4—For items of work for which specific unit prices are established by the contract, the volume of each type of rock riprap, including filter and bedding aggregate, is measured within the specified limits and computed to the nearest cubic yard by the method of average cross-sectional end areas.

Payment is made at the contract unit price for each type of rock riprap, including filter and bedding. Such payment is considered full compensation for completion of the work.

Method 5—For items of work for which specific unit prices are established by the contract, the quantity of each type of rock riprap placed within the specified limits is computed to the nearest ton by actual weight. For each load of rock for riprap placed as specified, the contractor shall furnish to the COTR a statement-of-delivery ticket showing the weight to the nearest 0.1 ton.

Payment is made at the contract unit price for each type of rock riprap, including geotextile used for filter or bedding. Such payment is considered full compensation for completion of the work.

Method 6—For items of work for which specific unit prices are established by the contract, the volume of each type of rock riprap is measured within the specified limits and computed to the nearest cubic yard by the method of average cross-sectional end areas.

Payment is made at the contract unit price for each type of rock riprap, including geotextile used for filter or bedding. Such payment is considered full compensation for completion of the work.

All methods—The following provision applies to all methods of measurement and payment. Compensation for any item of work described in the contract, but not listed in the bid schedule, is included in the payment for the item of work to which it is made subsidiary. Such items and the items to which they are made subsidiary are identified in section 8.

No separate payment is made for testing the gradation of the test pile. Compensation for testing is included in the appropriate bid item for riprap.

8. Items of work and construction details

Instructions for use Construction Specification 62—Grouted Rock Riprap

1. Applicability

Construction Specification 62 is applicable to the placement of grouted rock riprap on channel slopes and in other designated areas.

2. Material specifications

The following material specifications complement Construction Specification 62:

- 521—Aggregates for Drainfill and Filters
- 522—Aggregates for Portland Cement Concrete
- 523—Rock for Riprap
- 531—Portland Cement
- 532—Mineral Admixtures for Concrete
- 533—Chemical Admixtures for Concrete
- 534—Concrete Curing Compound
- 592—Geotextile

Construction Specifications 31, 32, and 95 also complement Construction Specification 62.

3. Included items

Items to be included in construction specifications and drawings follow:

- a. Complete plans and cross-sections clearly defining the grouted rock riprap requirements.
- b. Pay limits, where applicable.
- c. Gradation of rock.
- d. Gradation of filter or bedding materials, if used.
- e. Location of weep holes and pipe material for weep holes, if used.
- f. Placement tolerances.
- g. Design of grout mix together with the slump range and amount of air content.
- h. Type of cement.
- i. Type of admixtures, if any.
- j. Gradation of coarse aggregate.
- k. Designate equipment-placed or hand-placed rock.

- l. Designate if grout is to be placed or pumped.
- m. Method of measurement and payment.

4. Methods

Section 4, Placement of rock riprap

Method 1—Intended for use when rock placement operations that may cause some displacement of the filter or bedding material is not critical. Access to the site for dumping by hauling and placing equipment is reasonable.

Method 2—Intended for sites with limited access by hauling and placement equipment. This method should be considered when using geotextile filter material and sharp angular rock so puncture of the geotextile can be minimized. Hand-placed operations should be considered on steeper slopes.

Section 12, Measurement and payment

Method 1—Intended for use when the volume of riprap and grout, together with the filter or bedding material when used, is computed as one quantity and paid for at the contract unit price for grouted rock riprap.

Method 2—Intended for use when the volume of riprap, the volume of filter or bedding, the volume of concrete grout, and the area of geotextile are computed and paid as separate items.

Method 3—Intended for use when the actual weight of rock and filter/bedding material delivered is determined and paid to the nearest 0.1 ton, the grout volume is determined and paid to the nearest 0.1 cubic yard from batch volumes delivered, and the geotextile is determined and paid to the nearest square yard.

When specifications are prepared using electronic procedures and all methods but one are deleted for use in a contract specification, delete from the last paragraph, ***All Methods The following provisions apply to all methods of measurement and payment.*** Left justify the remaining text.

5. Items of work and construction details

Starting at the top of page 62-7, prepare and outline job specific "Items of Work and Construction Details" (IWCD) in accordance with these instructions. For ease of utilization, the use of recyclable color paper for the IWCD should be considered.

Construction Specification 62—Grouted Rock Riprap

1. Scope

The work consists of furnishing, transporting, and the installation of grouted rock riprap revetments and blankets, including filter or bedding where specified.

2. Material

Rock for riprap shall conform to the requirements of Material Specification 523, or, if so specified, shall be obtained from designated sources. It shall be free from dirt, clay, sand, rock fines, and other material not meeting the required gradation limits.

At least 30 days before rock is delivered from other than designated sources, the contractor shall designate, in writing, the source from which rock material will be obtained and provide information satisfactory to the engineer that the material meets contract requirements. The contractor shall provide the engineer free access to the source for the purpose of obtaining samples for testing. The size and grading of the rock shall be as specified in section 13 of this specification.

Rock from approved sources shall be excavated, selected, and processed to meet the specified quality and grading requirements at the time the rock is installed.

When specified in section 13 of this specification or when requested by the contracting officer, a gradation quality control check shall be made by the contractor and subject to inspection by the engineer. The test shall be performed at the work site in accordance to ASTM D 5519 Test Method B Size, Size-Range Grading, on a test pile of representative rock. The weight or size of the test pile shall be large enough to ensure a representative gradation of rock from the source and to provide test results within a 5 percent accuracy.

Based on a specific gravity of 2.65 (typical of limestone and dolomite), and assuming the individual rock is shaped midway between a sphere and a cube, typical size/weight relationships are:

Sieve size	Approx. weight of rock	Weight of test pile
16 inches	300 pounds	6,000 pounds
11 inches	100 pounds	2,000 pounds
6 inches	15 pounds	300 pounds

The results of the test shall be compared to the gradation required for the project. Test pile results that do not meet the construction specifications shall be cause for the rock to be rejected. The test pile that meets contract requirements shall be left on the job site as a sample for visual comparison. The test pile shall be used as part of the last rock riprap to be placed.

Filter or bedding aggregates, when required, shall conform to Material Specification 521, Aggregates for Drainfill and Filters, unless otherwise specified.

Portland cement shall conform to the requirements of Material Specification 531 for the specified type.

Pozzolan conforming to Specification ASTM C 618, Class C or F, in amounts not to exceed 25 percent based on absolute volume, may be substituted for an equivalent amount of portland cement in the grout mixture unless otherwise specified in section 13 of this specification.

Aggregates shall conform to the requirements of Material Specification 522, Aggregates for Portland Cement Concrete, except that the grading for coarse aggregate shall be as specified in section 13 of this specification.

Water shall be clean and free from injurious amounts of oils, acid, alkali, organic matter, or other deleterious substances.

Air-entraining admixtures shall conform to the requirements of Material Specification 533, Chemical Admixtures for Concrete.

Curing compound shall conform to the requirements of Material Specification 534, Concrete Curing Compound.

Other admixtures, when required, shall be as specified in section 13 of this specification.

Geotextiles shall conform to the requirements of Material Specification 592.

3. Subgrade preparation

The subgrade surface on which the grouted rock riprap, filter, bedding, or geotextile is to be placed shall be cut or filled and graded to the lines and grades shown on the drawings. When fill to subgrade lines is required, it shall consist of approved material and shall conform to the requirements of the specified class of earthfill.

Rock riprap, filter, bedding, or geotextile shall not be placed until the foundation preparation is completed and the subgrade surface has been inspected and approved.

4. Placement of rock riprap

Method 1 Equipment-placed rock—The rock riprap shall be placed by equipment on the surface and to the depth specified. It shall be installed to the full section thickness in one operation and in such a manner as to avoid serious displacement of the underlying material. The rock for riprap shall be delivered and placed in a manner that ensures that the riprap in place shall be reasonably homogeneous with the larger rocks uniformly distributed and firmly in contact one to another with the smaller rocks and spalls filling the voids between the larger rocks. Some hand placing may be required to provide a neat and uniform surface.

Rock riprap shall be placed in a manner to prevent damage to structures. Hand placing is required as necessary to prevent damage to any new and existing structures.

Method 2 Hand-placed rock—The rock riprap shall be placed by hand on the surface and to the depth specified. It shall be securely bedded with the larger rocks firmly in contact one to another without bridging. Spaces between the larger rocks shall be filled with smaller rocks and spalls. Smaller rocks shall not be grouped as a substitute for larger rock. Flat slab rock shall be laid on its vertical edge except where it is installed like paving stone and the thickness of the rock equals the specified depth of the riprap section.

5. Filter or bedding

When the contract specifies filter, bedding, or geotextile beneath the rock riprap, the designated material shall be placed on the prepared subgrade surface as specified. Compaction of filter or bedding

aggregate is not required, but the surface of such material shall be finished reasonably smooth and free of mounds, dips, or windrows.

6. Design of the grout mix

The mix proportions for the grout mix shall be as specified in the construction details in section 13 of this specification. During installation, the engineer may require adjustment of the mix proportions whenever necessary. The mix shall not be altered without the approval of the engineer.

7. Handling and measurement of grout material

Material shall be stockpiled and batched by methods that prevent segregation or contamination of aggregates and ensure accurate proportioning of the mix ingredients.

Except as otherwise provided in section 13 of this specification, cement and aggregates shall be measured as follows:

- Cement shall be measured by weight or in bags of 94 pounds each. When cement is measured in bags, no fraction of a bag shall be used unless weighed.
- Aggregates shall be measured by weight. Mix proportions shall be based on the batch weight of each aggregate saturated, surface-dry weight plus the weight of surface moisture it contains at the time of batching.
- Water shall be measured, by volume or by weight, to an accuracy within 1 percent of the total quantity of water required for the batch.
- Admixtures shall be measured within a limit of accuracy of plus or minus 3 percent.

8. Mixers and mixing

The mixer, when operating at capacity, shall be capable of combining the ingredients of the grout mix into a thoroughly mixed and uniform mass and of discharging the mix with a satisfactory degree of uniformity.

The mixer shall be operated within the limits of the manufacturer's guaranteed capacity and speed of rotation.

The time of mixing after all cement and aggregates have been combined in the mixer shall be a minimum of 1 minute for mixers having a capacity of 1 cubic yard or less. For larger capacity mixers, the minimum time shall be increased 15 seconds for each cubic yard or fraction thereof of additional capacity. The batch shall be so charged into the mixer that some water will enter in advance of the cement and aggregates, with the balance of the mixing water introduced into the mixer before a fourth of the total minimum mixing time has elapsed.

When ready-mix grout is furnished, the contractor shall furnish to the engineer at the time of delivery a ticket showing the time of loading and the quantities of material used for each load of grout mix delivered.

No mixing water in excess of the amount required by the approved job mix shall be added to the grout mix during mixing or hauling or after arrival at the delivery point.

9. Conveying and placing

The grout mix shall be delivered to the site and placed within 1.5 hours after the introduction of the cement to the aggregates. In hot weather or under conditions contributing to accelerated stiffening of the concrete, the time between the introduction of the cement to the aggregates and complete discharge of the grout batch shall be a maximum of 45 minutes. The engineer may allow a longer time provided the

setting time of the grout is increased a corresponding amount by the addition of an approved set-retarding admixture. In any case concrete shall be conveyed from the mixer to the final placement as rapidly as practicable by methods that prevent segregation of the aggregates, loss of mortar, displacement of the rock riprap, or a combination of these.

Grout mix shall not be allowed to free fall more than 5 feet unless suitable equipment is used to prevent segregation.

The grout mix shall not be placed until the rock riprap has been inspected and approved by the engineer for the placement of grout.

Rock to be grouted shall be kept moist for a minimum of 2 hours before grouting.

The rock riprap shall be flushed with water before placing the grout to remove the fines from the rock surfaces. The rock shall be kept moist before the grouting and without placing in standing or flowing water. Grout placed on inverts or other nearly level areas may be placed in one operation. On slopes, the grout shall be placed in two nearly equal applications consisting of successive lateral strips about 10 feet in width starting at the toe of the slope and progressing upward. The grout shall be delivered to the place of final deposit by approved methods and discharged directly on the surface of the rock. A metal or wood splash plate is used to prevent displacement of the rock directly under the grout discharge. The flow of grout shall be directed with brooms, spades, or baffles to prevent grout from flowing excessively along the same path and to assure that all intermittent spaces are filled. Sufficient barring shall be conducted to loosen tight pockets of rock and otherwise aid in the penetration of grout to ensure the grout fully penetrates the total thickness of the rock blanket. All brooming on slopes shall be uphill. After the grout has stiffened, the entire surface shall be rebroomed to eliminate runs and to fill voids caused by sloughing. The surface finish, following the completion of grout installation, shall consist of one-third of the rock extended above the level of grout. The exposed rock will not have a plastered appearance.

After completion of any strip or panel, no individual(s) or equipment shall be permitted on the grouted surface for 24 hours. The grouted surface shall be protected from injurious action by the sun, rain, flowing water, mechanical injury, or other potential damaging activity.

10. Curing and protection

The completed finished surface shall be prevented from drying for a minimum curing period of 7 days following placement. Exposed surfaces shall be maintained in a moist condition continuously for the 7-day curing period or until curing compound has been applied as specified in this section. Moisture shall be maintained by sprinkling, flooding, or fog spraying or by covering with continuously moistened canvas, cloth mats, straw, sand, or other approved material. Water or moist covering shall be used to protect the grout during the curing process without causing damage to the grout surface by erosion or other mechanisms that may cause physical damage.

The grouted rock may be coated with an approved curing compound as an alternative method to maintaining a continuous moisture condition during the curing period. The compound shall be sprayed on the moist grout surface as soon as free water has disappeared and all surface finishing has been completed. The compound shall be applied at a minimum uniform rate of 1 gallon per 175 square feet of surface and shall form a continuous adherent membrane over the entire surface. Curing compound shall not be applied to surfaces requiring bond to subsequently placed grout and/or concrete. If the membrane is damaged during the curing period, the damaged area shall be resprayed at the rate of application specified for the original treatment.

Grout mix shall not be placed when the daily minimum temperature is less than 40 degrees Fahrenheit unless facilities are provided to ensure that the temperature of the material is maintained at a minimum

temperature of 50 degrees Fahrenheit and not more than 90 degrees Fahrenheit during placement and the curing period. Grout mix shall not be placed on a frozen surface. When freezing conditions prevail, rock to be grouted must be covered and heated to within a range of 50 to 90 degrees Fahrenheit for a minimum of 24 hours before placing grouting material.

11. Inspecting and testing fresh grout

The grout material shall be checked and tested throughout the grouting operation. Sampling of fresh grout shall be conducted in conformance with ASTM C 172. The volume of each batch will be determined by methods prescribed in ASTM C 138.

The engineer shall have free access to all parts of the contractor's plant and equipment used for mixing and placing grout during the period of the contract. Proper facilities shall be provided for the engineer to sample material and view processes implemented in the mixing and placing of grout as well as for securing grout test samples. All tests and inspections shall be conducted so that only a minimum of interference to the contractor's operation occurs.

For ready-mixed grout, the contractor shall furnish to the engineer a statement-of-delivery ticket for each batch delivered to the site. The ticket shall provide as a minimum: weight in pounds of cement, aggregates (fine and coarse), water; weight in ounces of air-entraining agent; time of loading; and the revolution counter reading at the time batching was started.

12. Measurement and payment

Method 1—For items of work for which specific unit prices are established in the contract, the volume of grouted rock riprap, including filter layers or bedding, is determined to the nearest cubic yard from the specified thickness shown on the drawings and the area on which acceptable placement has been installed. Payment for grouted rock riprap is made at the contract unit price. Such payment is considered full compensation for all labor, material, equipment, and all other items necessary and incidental to the completion of the grouted rock riprap, filter layers and bedding, and geotextile material.

Method 2—For items of work for which specific unit prices are established in the contract, the volume of riprap and the volume of filter layers or bedding is determined to the nearest cubic yard from the specified thickness shown on the drawings and the area in which acceptable placement has been installed. The volume of grout is determined from the calculated batch volume and the number of mixed batches delivered to the site and placed in accordance with the specification. The area of geotextile is determined to the nearest square yard from measurements of geotextile material installed according to the contract requirements. Payment is made at the contract unit price for each type of rock riprap, filter or bedding, concrete grout, and geotextile. Such payment is considered full compensation for all labor, material, equipment, and all other items necessary and incidental to the completion of the work.

Method 3—For items of work for which specific unit prices are established in the contract, the quantity of each type of rock riprap placed within the specified limits is computed to the nearest 0.1 ton by actual weight. The quantity of each type of filter or bedding aggregate delivered and placed within the specified limits is computed to the nearest 0.1 ton. For each load of rock riprap placed as specified, the contractor shall furnish to the engineer a statement-of-delivery ticket showing the weight to the nearest 0.1 ton. For each load of filter or bedding aggregate, the contractor shall furnish to the engineer a statement-of-delivery ticket showing the weight to the nearest 0.1 ton. The volume of grout is determined from the calculated batch volume and the number of mixed batches delivered to the site and placed in accordance with the specifications and drawings. The area of geotextile is determined to the nearest square yard from measurements of geotextile material installed according to the contract requirements. Payment is made at the contract unit price for each type of rock riprap, filter or bedding, concrete grout, and geotextile. Such payment is considered full compensation for all labor, material, equipment, and all other items necessary and incidental to the completion of the work.

All methods—The following provision applies to all methods of measurement and payment. Compensation for any item of work described in the contract, but not listed in the bid schedule is included in the payment for the item of work to which it is made subsidiary. Such items and the items to which they are made subsidiary are identified in section 13 of this specification.

13. Items of work and construction details

Instructions for use Construction Specification 63—Treatment of Rock Surfaces

1. Applicability

Construction Specification 63 is applicable to the treatment of rock surfaces. Included are the cleaning and preparing of the surfaces and the furnishing and placing of the treatment material. Where large volumes of concrete are involved, or when desired, Construction Specification 32 may be used as an alternative to this specification. Treatment details would then be placed in construction details for Construction Specification 32.

2. Material specifications

The following material specifications complement Construction Specification 63:
522—Aggregate for Portland Cement Concrete
531—Portland Cement
534—Concrete Curing Compound

3. Included items

Items to be included in contract specifications and drawings follow:

- a. Plan view showing location and extent of surface treatment.
- b. Details for cleaning and treatment of cracks, and dental excavation.
- c. Type of treatment including design of mix, slump, air content, and special placement methods when required.
- d. Type of cement.
- e. Type of admixtures, include necessary material specifications.
- f. Gradation of coarse aggregate.
- g. Slope limitations for the finished surface(s), as determined by site topography, plasticity of available fill material, embankment zoning, and other design considerations, stated as follows:

Except for small local areas, the slope of the finished surface shall not be steeper than ___ horizontal to ___ vertical. Steeper surfaces extending not more than ___ feet, measured vertically, are permitted.

- h. Method of curing and protection in section 8.
- i. Method of measurement and payment in section 9.

4. Methods

Section 8, Curing and protection

Method 1—Treatment of rock surfaces is intended to remove surface irregularities that could contribute to nonuniform installation of earth material.

Method 2—Treatment of rock surfaces is an integral phase to ensure blending and/or bonding of surface treatment and the proposed earth embankments. Water-tightness and the reduction of potential seepage paths are major design considerations. (See figure 63–1.)

Section 9, Measurement and payment

Method 1—Intended for use when the area to be treated is not fully definable and the full extent of treatment needs to be determined at the time of installation. This method applies to rock surfaces that have significant irregularities and are not readily determined before installation.

Method 2—Intended for use when the area to be treated is clearly definable and the extent of treatment has been determined. This method applies to rock surfaces that can be viewed and where the extent of treatment will not vary.


When specifications are prepared using electronic procedures and all methods but one are deleted for use in a contract specification, delete from the last paragraph *All Methods* **The following provisions apply to all methods of measurement and payment.** Left justify the remaining text.

5. Items of work and construction details

Starting at the top of page 63–5, prepare and outline job specific "Items of Work and Construction Details" (IWCD) in accordance with these instructions. For ease of utilization, the use of recyclable color paper for the IWCD should be considered.

Construction Specification

Figure 63–1 Typical treatments of rock surfaces

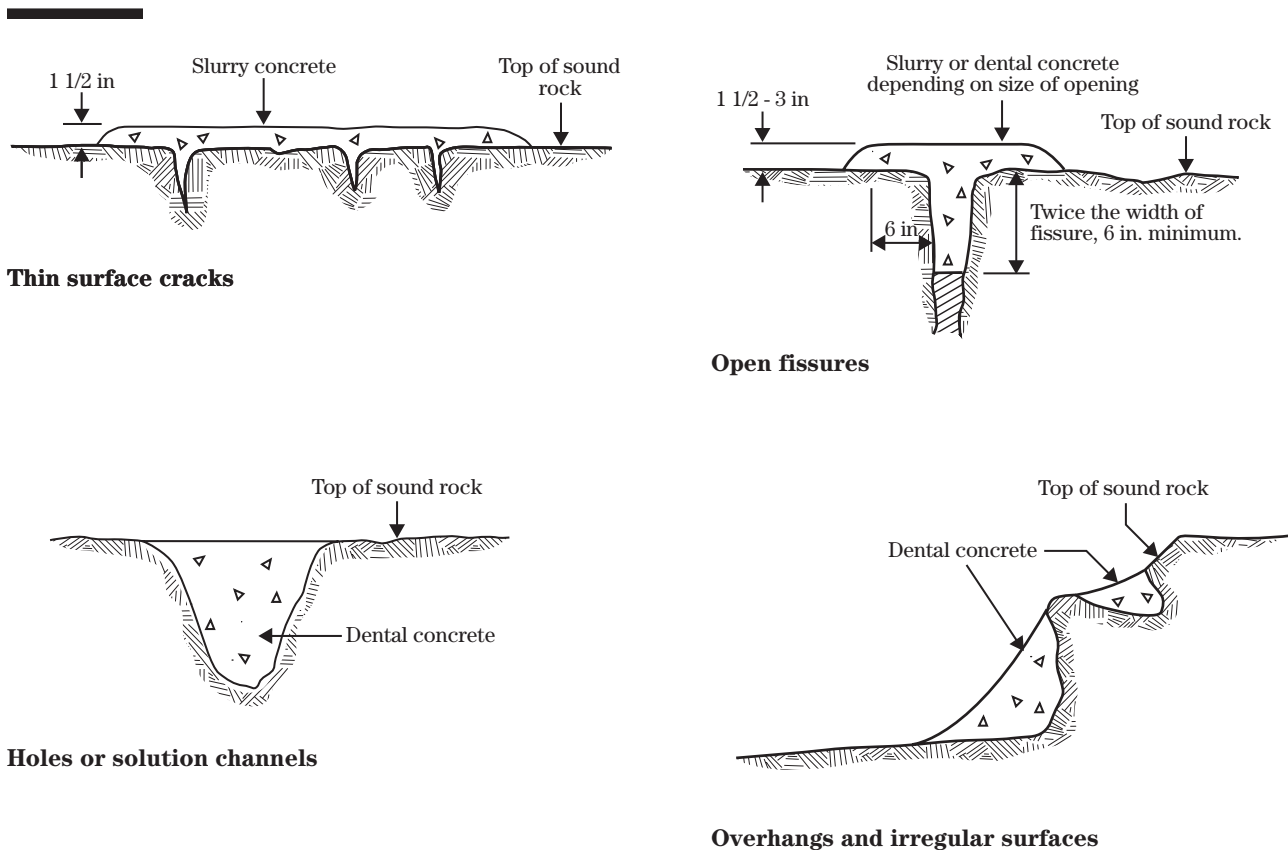

63—Treatment of Rock Surfaces

1. Scope

This work consists of preparing and cleaning the designated rock surfaces, including the specified dental excavation, and the furnishing and placing of the specified treatment material for either dental or slurry grout.

2. Material

Portland cement shall conform to the requirements of Material Specification 531 for the type specified in section 10 of this specification.

Pozzolans conforming to the ASTM C 618, Class C or F, may be used in amounts not to exceed 25 percent, based on absolute volume, to substitute for an equal amount of portland cement in the concrete grout mixture, unless otherwise specified in section 10 of this specification.

Aggregates shall conform to the requirements of Material Specification 522, Aggregates for Portland Cement Concrete, except that the grading for coarse aggregate shall be as specified in section 10 of this specification.

Water shall be clean and free from injurious amounts of oil, acid, alkali, organic matter, or other deleterious substances.

Admixtures, when specified, shall be of the type and quality specified in section 10 of this specification.

Curing compound shall conform to the requirements of Material Specification 534, Concrete Curing Compound.

3. Preparation and cleaning

After excavation of the overburden has been completed, the rock surfaces shall be thoroughly cleaned and dewatered. All loose rock, ledges, and overhangs exposed during preparation of the rock surfaces shall be removed. Surfaces exceeding the slope limitations specified in section 10 of this specification shall be eliminated by excavation or by filling with concrete as described in section 7 of this specification.

Dental excavation shall consist of the removal of all soil and soft or loose rock from cracks, fissures, holes, and solution channels exposed during excavation activities. The extent of the dental excavation shall be as shown on the drawings with onsite adjustments as determined by the engineer.

Rock surfaces shall be cleaned by air-water cutting, water jetting, wire brush scrubbing, or other suitable methods determined necessary to obtain an acceptable surface. No surface treatment material shall be applied until rock surfaces have been inspected and approved.

Rock surfaces shall be free of standing or running water during the placement of surface treatment material.

4. Design of surface treatment material

The treatment material and mix proportions shall be as specified in section 10 of this specification. During the surface treatment operation, the engineer may require adjustment of the mix proportions. The mix shall not be altered without the approval of the engineer.

5. Handling and measurement of material

Material shall be stockpiled and batched by methods that prevent segregation or contamination of aggregates and ensure accurate measurement and proportioning of the mix ingredients.

Except as otherwise provided in section 10 of this specification, cement and aggregates shall be measured as follows:

- a. Cement shall be measured by weight or in bags of 94 pounds each. When cement is measured in bags, no fraction of a bag shall be used unless properly weighed.
- b. Aggregates shall be measured by weight. Mix proportions shall be based on saturated, surface-dry weights. The batch weight of each aggregate shall be required saturated, surface-dry weight plus the weight of the surface moisture it contains at the time of batching.
- c. Water shall be measured, by volume or weight, to an accuracy within 1 percent of the total quantity of water required for the batch.
- d. Admixtures shall be measured within a limit of accuracy of 3 percent.

6. Mixers and mixing

The mixer, when operating at capacity, shall be capable of combining the ingredients of the concrete into a thoroughly mixed and uniform mass and of discharging the mix with a satisfactory degree of uniformity.

The mixer shall be operated within the limits of the manufacturer's guaranteed capacity and speed of rotation.

The time of mixing, after all cement and aggregates are combined in the mixer, shall be a minimum of 1 minute for mixers having a capacity of 1 cubic yard or less. For larger capacity mixers, the minimum time shall be increased 15 seconds for each cubic yard or fraction thereof of additional capacity. The batch shall be so charged into the mixer that some water enters before the cement and aggregates, with the balance of the mixing water introduced into the mixer before a fourth of the total mixing time has elapsed.

No mixing water in excess of the amount required by the approved job mix shall be added to the grout mix during mixing or hauling or after arrival at the delivery point.

7. Conveying and placing

Surface treatment material shall be delivered to the site and placed within 1.5 hours after the introduction of the cement to the aggregates. In hot weather or under conditions contributing to accelerated stiffening of the concrete, the time between the introduction of the cement to the aggregates and complete discharge of the concrete shall be a maximum of 45 minutes. The engineer may allow a longer period if the setting time of the concrete is increased a corresponding amount by the addition of an approved set-retarding admixture. In any case concrete shall be conveyed from the mixer to the final placement as rapidly as practical by methods that prevent segregation of the aggregates, loss of mortar, or both.

Concrete shall not be allowed to free fall more than 5 feet unless suitable equipment is used to prevent segregation.

Surface treatment material shall not be placed until the rock surfaces have been inspected and approved by the engineer.

All cracks, fissures, solution channels, and other surfaces within the designated area shall be treated as shown on the drawings. Surfaces to be treated shall be kept moist for at least 2 hours before treatment.

Concrete shall be filled against any specified remaining rock surfaces that exceed the slope limitations and shall be shaped so that no part of the finished surface exceeds these limitations.

Material placed in cracks, fissures, and solution channels shall be consolidated by vibration, spading, or tamping as necessary to assure complete filling of the void.

8. Curing and protection

Method 1—The surface of treatment material shall be prevented from drying for a minimum curing period of 7 days after placement. Exposed surfaces shall be maintained in a moist condition continuously for the 7-day curing period or until curing compound has been applied as specified in this section. Moisture shall be maintained by sprinkling, flooding, or fog spraying or by covering with continuously moistened canvas, cloth mats, straw, sand, or other acceptable material. Water or moist covering shall be used to protect the concrete treatment during the curing process without causing damage to the treatment surface by erosion or other mechanisms that may cause physical damage.

The concrete treatment material may be coated with an approved curing compound as an alternative method to maintaining a continuous moisture condition during the curing period. The compound shall be sprayed on the moist treatment surfaces as soon as free water has disappeared and all surface finishing has been completed. The compound shall be applied at a minimum uniform rate of 1 gallon per 175 square feet of surface and shall form a continuous adherent membrane over the entire treated surface. Curing compound shall not be applied to surfaces requiring bond to subsequently placed grout or concrete. If the membrane is damaged during the curing period, the damaged area shall be resprayed at the rate application specified for the original treatment.

Backfilling operations shall not commence for a minimum period of 24 hours following the placement of concrete treatment unless otherwise specified.

Method 2—A minimum earth cover of 1.5 feet depth shall be placed and compacted before the rock surface treatment material (concrete) has established an initial set. The earth cover may be placed on the concrete with a dragline or hoe, or it can be bladed onto the treated surface by lightweight dozer or similar equipment operating from a covered and compacted surface. Compaction shall be accomplished by pneumatic-tired equipment or by an alternative method that provides an equivalent density.

Use with either method—No backfill material shall be placed until the treated surfaces have been inspected and approved by the engineer.

Surface treatment material shall not be placed when the daily minimum temperature is less than 40 degrees Fahrenheit unless facilities are provided to ensure that the temperature of the material is maintained at a minimum temperature of 50 degrees Fahrenheit and not greater than 90 degrees Fahrenheit during placement and the curing period. Concrete treatment material shall not be placed on a frozen surface. When freezing conditions prevail, rock surfaces to be treated must be covered and heated to within a range of 50 to 90 degrees Fahrenheit for a minimum period of 24 hours before placing concrete treatment material.

9. Measurement and payment

Method 1—For items of work for which specific unit prices are established in the contract, the area of rock surfaces to be prepared, cleaned, and treated is measured to the nearest square yard within the limits established by the engineer. The volume of surface treatment material placed within the established limits is computed to the nearest 0.1 cubic yard of concrete placed. Payment is made at the contract unit price for surface preparation, cleaning, and installation of surface treatment material. Such payment constitutes full compensation of all labor, equipment, material, and all other items necessary and incidental to the completion of the work.

Method 2—For items of work for which specific unit prices are established in the contract, the area of rock surfaces to be prepared, cleaned, and treated will not be measured. The volume of surface treatment material delivered and properly installed to treat rock surfaces is determined to the nearest 0.1 cubic yard. Areas to be treated are shown on the drawings with the final extent of rock surface treatment to be determined by the engineer. The volume of any waste or otherwise unsuitable material is determined by procedures established by the engineer and deducted from the volume of concrete delivered to the site. Payment is made at the contract unit price for surface preparation, cleaning, and installation of surface treatment material. Such payment constitutes full compensation of all labor, equipment, material, and all other items necessary and incidental to the completion of the work.

All methods—For each load of concrete delivered to the site for placement as rock treatment material, the contractor shall furnish to the engineer a delivery ticket at the time of delivery. This ticket shall provide as a minimum: Weights in pounds of cement, aggregates (fine and coarse), pozzolan (if used), and water; weight in ounces of air-entraining agent; time of loading; and, the revolution counter reading at the time batching was started.

Compensation for any item of work described in the contract, but not listed in the bid schedule is included in the payment for the item of work to which it is made subsidiary. Such items and the items to which they are made subsidiary are identified in section 10 of this specification.

10. Items of work and construction details

Instructions for use

Construction Specification 64—Wire Mesh Gabions and Mattresses Twisted (Woven) or Welded Mesh

1. Applicability

Construction Specification 64 is applicable to the installation of wire mesh gabion baskets and mattresses, including bedding, filter, or geotextile where specified.

2. Material specifications

The following material specifications complement Construction Specification 64:

- 521—Aggregates for Drainfill and Filters
- 523—Rock for Riprap
- 592—Geotextile

Construction Specification 95, Geotextile, also complements this specification.

3. Included items

Items to be included in contract specifications and drawings follow:

- a. Complete drawings showing alignment, layout, size of baskets or mattresses required, interior support details, lacing, connecting or fastening plans as applicable, and any other related appurtenances or details.
- b. Gabions designated as basket or mattress, as appropriate. Type of gabion construction: twisted or welded mesh.
- c. Specify in section 8 if alternate ring fasteners as recommended by the manufacturer are to be allowed for basket interconnection and closure of tops. The specification only allows the use of alternative ring fasteners for the assembly of empty gabion baskets or mattresses. If it is determined that the use of these fasteners can provide a minimum strength of 1,400 pounds per linear foot for gabions and 900 pounds per linear foot for gabion mattresses, then section 8 of this specification may be used to allow their use to join gabions and to close the lids of gabions. The manufacturer's recommendations are to be followed concerning the proper interlocking of fasteners and their spacing to attain the required strength.
- d. Specify in section 8 the type of wire (plain, galvanized, or PVC coated) if specific design requirements need to be met, coating color, and any special requirements, such as different wire size or mesh openings, as applicable. Note in table 2 of the construction specification that only PVC coated gabion mattresses are specified.
- e. Details of bedding, filter material and/or geotextile including gradation for material, compaction requirements of material, class of geotextile, and any special requirements, if required. Refer to the respective construction specifications as applicable. Both types of gabions perform best when placed on relatively smooth and unyielding foundations. A coarse aggregate or a stone leveling course can be successfully used under gabions to enhance good support and grade control.
- f. Source of rock and prequalification of other material as appropriate.
- g. Rock size if different than that specified.
- h. Requirements for concrete cap, if applicable, including location and placement details. Include and refer to Construction Specifications 31, 32, or 33 as necessary.
- i. Rockfill and lid closure requirements for gabions placed on a slope to serve as a chute with flow down the top surface. These gabions must be filled as densely as possible to avoid movement and distortion during design flow events.

- j. The specified batter to the front face of vertical gabion walls. A minimum wall batter of 6 degrees is recommended (1 horizontal to 10 vertical). Where possible, design stepped faced gabion walls instead of vertical faced walls.
- k. Method of measurement and payment in section 8.

4. Methods

Section 7, Measurement and payment

Method 1—Used when payment is to be made for gabions or mattresses and rock filler. Bedding, filter, or geotextile is to be paid under a separate item.

Method 2—Used when payment is made for gabions or mattresses and rock filler including the bedding or filter and geotextile. Include a description of the subsidiary items in section 8 of this specification and in the items of work and construction details of the appropriate companion construction specification.

Method 3—Used when payment is to be made for gabion mattresses and rock filler. Bedding, filter, or geotextile is to be paid under a separate item of work.

Method 4—Used when payment is made for completed gabion mattresses and rock filler including the bedding or filter and geotextile. Include a description of the subsidiary items in section 8 and in the items of work and construction details of the appropriate companion construction specification.

When all methods but is deleted for use in a contract specification, delete from the last paragraph ***All Methods The following provisions apply to all methods of measurement and payment.*** Left justify the remaining text.

5. Items of work and construction details

Starting at the top of page 64–6, prepare and outline job specific "Items of Work and Construction Details" (IWCD) in accordance with these instructions. For ease of utilization, the use of recyclable color paper for the IWCD should be considered.

Construction Specification 64—Wire Mesh Gabions and Mattresses Twisted (Woven) or Welded Mesh

1. Scope

The work consists of furnishing, assembling, and installing rock filled wire mesh gabion baskets and mattresses.

2. Types

Gabions shall consist of rectangular wire mesh formed containers filled with rock. Gabions will conform to one of the following types:

Woven mesh—Nonraveling, double twisted, hexagonal wire mesh consisting of two wires twisted together in two 180-degree turns.

Welded mesh—Welded-wire mesh with a uniform square or rectangular pattern and a resistance weld at each intersection. The welded wire connections shall conform with the requirements of ASTM A 185, including wire smaller than W1.2 (0.124 in.), except that the welded connections shall have a minimum average shear strength of 70 percent and a minimum shear strength of 60 percent of the minimum ultimate tensile strength of the wire.

Gabions—Gabions shall be furnished as baskets or mattresses as specified in section 8. Baskets and mattresses shall be fabricated within a dimension tolerance of plus or minus 5 percent.

Baskets—Baskets are at least 12 inches high.

Mattresses—Mattresses are no more than 12 inches thick.

3. Material

Gabions shall be fabricated, assembled, and installed in accordance with the nominal wire sizes and dimensions shown in tables 64–1 and 64–2, using the following materials unless otherwise specified in section 8.

Wire for fabrication and assembly shall be hot-dipped galvanized. The wire shall have a minimum tensile strength of 60,000 pounds per square inch. Galvanized steel wire shall conform to ASTM A 641, Class 3, Soft Temper.

When epoxy or polyvinyl chloride (PVC) coated wire is specified in section 8, the galvanized wire shall be coated by fusion bonded epoxy; fusion bonded, extruded; or extruded and bonded PVC material. The wire coating shall be black, gray, green, or silvery, and the initial properties of the PVC coating shall meet the following requirements:

- a. Specific gravity. In the range of 1.30 to 1.40, ASTM D 792.
- b. Abrasion resistance. The percentage of weight loss shall be less than 12 percent when tested according to ASTM D 1242, method B, at 200 cycles, CSI-A abrader tape, 80 grit.
- c. Brittleness temperature. Not higher than 15 °F, ASTM D 746.
- d. Tensile strength. Extruded coating (not less than 2,980 lb/in², ASTM D 412); fusion bonded coating (not less than 2,275 lb/in², ASTM D 638).
- e. Modulus of elasticity. Extruded coating (not less than 2,700 lb/in² at 100 percent strain, ASTM D 412); fusion bonded coating (not less than 1,980 lb/in² at 100 percent strain, ASTM D 638).
- f. Ultraviolet light exposure. An exposure period of not less than 3,000 hours at 63 degrees centigrade, ASTM G 152.

Table 64-1 Minimum requirements***Gabion baskets—height 12, 18, or 36 inches; length as specified**

Type of wire	Mesh size (in)	Wire diameter (in)	PVC coating (in)	Total diameter (in)	Galvanized coating oz./ft ²
Woven mesh	3.25 x 4.5	0.118	None	0.118	0.80
	3.25 x 4.5	0.105	0.02	0.145	0.80
Selvage		0.153	None	0.153	0.80
		0.132	0.02	0.172	0.80
Lacing and internal connecting wire		0.086	0.02	0.126	0.70
Welded	3 x 3	0.118	None	0.118	0.80
Mesh	3 x 3	0.105	0.02	0.145	0.80
Spiral binder		0.105	0.02	0.145	0.80

Table 64-2 Minimum requirements***Gabion mattresses—height 6, 9, or 12 inches; length as specified**

Type of wire	Mesh size (in)	Wire diameter (in)	PVC coating (in)	Total diameter (in)	Galvanized coating oz./ft ²
Woven mesh	2.5 x 3.25	0.086	0.02	0.126	0.70
Selvage		0.105	0.02	0.145	0.80
Lacing and internal connecting wire		0.086	0.02	0.126	0.70
Welded mesh	1.5 x 3	0.080	0.02	0.120	0.70
Spiral binder		0.105	0.02	0.145	0.80

* Note: The wire sizes and PVC coating thickness shown are nominal sizes. The wire sizes include the galvanizing coating thickness.

g. Salt spray test. A test period of not less than 3,000 hours, ASTM B 117.

After the exposure to ultraviolet light and the salt spray test as specified above, the PVC coating shall not show cracks, blisters, splits, nor noticeable change of coloring (surface chalk). In addition, the specific gravity shall not change more than 6 percent, resistance to abrasion shall not change more than 10 percent, tensile strength shall not change more than 25 percent, and modulus of elasticity shall not change more than 25 percent from their initial values.

The wire sizes shown in tables 64–1 and 64–2 are the size of the wire after galvanizing and before coating with PVC.

Spiral binders are the standard fastener for welded-mesh gabion baskets and mattresses, and shall be formed from wire meeting the same quality and coating thickness requirements as specified for the gabion baskets and mattresses.

Alternate fasteners for use with wire mesh gabions, such as ring fasteners, shall be formed from wire meeting the same quality and coating thickness requirements as specified for the gabions and, as a minimum, shall conform to the manufacturer's recommendations.

Standard fasteners and alternate fasteners must provide a minimum strength of 1,400 pounds per lineal foot for gabion baskets and 900 pounds per lineal foot for gabion mattresses. When used to interconnect gabion baskets or mattresses with PVC coating, ring fasteners shall be made of stainless steel and spiral fasteners will be PVC coated. All fasteners shall meet all of the closing requirements of the gabion manufacturer in addition to any requirements specified in section 8.

Rock shall conform to the quality requirements in Material Specification 523, Rock for Riprap, unless otherwise specified in section 8. At least 85 percent of the rock particles, by weight, shall be within the predominant rock size range.

Gabion basket or mattress height	Predominant rock size (in)	Minimum rock dimension (in)	Maximum rock dimension (in)
12-, 18-, or 36-inch basket	4 to 8	4	8
6-, 9-, or 12-inch mattress	3 to 6	3	6

At least 30 days before delivery to the site, the contractor shall inform the engineer in writing of the source from which the rock will be obtained. The test data and other information by which the material was determined by the contractor to meet the specification are included. The contractor shall provide the engineer free access to the source for the purpose of obtaining samples for testing and source approval.

Bedding or filter material, when specified, shall meet the gradation shown on the plans, or as specified in section 8, and the requirements of Material Specification 521, Aggregates for Drainfill and Filters. Geotextile, when specified, shall conform to the requirements specified in section 8 and those of Material Specification 592.

4. Foundation preparation

The foundation on which the gabions are to be placed shall be cut or filled and graded to the lines and grades shown on the drawings. Surface irregularities, loose material, vegetation, and all foreign matter

shall be removed from the foundation. When fill is required, it shall consist of material conforming to the specified requirements. Gabions and bedding or specified geotextiles shall not be placed until the foundation preparation is completed and the subgrade surfaces have been inspected and approved by the COTR.

Compaction of bedding or filter material is required as specified in section 8. The surface of the finished material shall be to grade and free of mounds, dips, or windrows. Geotextile shall be installed in accordance with the requirements of Construction Specification 95.

5. Assembly and placement

Unless otherwise specified in section 8, the assembly and placement of gabions shall be in accordance with the following procedures:

Assembly—Rotate the gabion panels into position and join the vertical edges with fasteners for gabion assembly. Where lacing wire is used, wrap the wire with alternating single and double half-hitches at 4- to 5-inch intervals. Where spiral fasteners are used for welded-wire mesh, crimp the ends to secure the spirals in place. Where ring type alternate fasteners are used for basket assembly, install the fasteners at a maximum spacing of 6 inches. Use the same fastening procedures to install interior diaphragms where they are required.

Interior diaphragms are required where any inside dimension exceeds 3 feet. Diaphragms are installed to assure that no open intervals are present that exceed 3 feet.

Placement—Place the empty gabions on the foundation and interconnect the adjacent gabions along the top, bottom, and vertical edges using lacing wire. Wrap the wire with alternating single and double half-hitches at 4- to 6-inch intervals. Unless otherwise specified in section 8, lacing wire will be the only fastener allowed for interconnecting woven mesh gabions. Spiral fasteners are commonly used for the assembly and interconnection of welded mesh gabions. Spirals are screwed down at the connecting edges then each end of the spiral is crimped to secure it in place. Lacing may be used as needed to supplement the interconnection of welded mesh gabions and the closing of lids.

Interconnect each layer of gabions to the underlying layer of gabions along the front, back, and sides. Stagger the vertical joints between the gabions of adjacent rows and layers by at least half of a cell length.

6. Filling operation

After adjacent empty woven wire gabion units are set to line and grade and common sides properly connected, they shall be placed in straight line tension and stretched to remove any kinks from the mesh and to gain a uniform alignment. Welded-mesh gabions do not require stretching. The gabions may be staked to maintain the established proper alignment before the rock is placed. No stakes shall be placed through geotextile material. Connecting lacing wire and other fasteners (as allowed) shall be attached during the filling operation to preserve the strength and shape of the structure.

Internal connecting crosstie wires shall be placed in each unrestrained gabion cell of more than 18 inches in height, including gabion cells left temporarily unrestrained. Two internal connecting wires shall be placed concurrently with rock placement at each 12-inch interval of depth. In woven mesh gabions these crossties are placed evenly spaced along the front face and connecting to the back face. All crosstie wires shall be looped around two mesh openings and each wire end shall be secured by a minimum of five 180-degree twists around itself after looping.

In welded mesh gabions these crossties or stiffeners are placed across the corners of the gabions (at 12 inches from the corners) providing diagonal bracing. Lacing wire or preformed hooked wire stiffeners may be used.

The gabions shall be carefully filled with rock by machine or hand methods to ensure alignment, avoid bulges, and provide a compact mass that minimizes voids. Machine placement requires supplementing with hand work to ensure the desired results. The cells in any row shall be filled in stages so that the depth of rock placed in any one cell does not exceed the depth of rock in any adjoining cell by more than 12 inches. Along the exposed faces, the outer layer of stone shall be carefully placed and arranged by hand to ensure a neat, compact placement with a uniform appearance.

The last layer of rock shall be uniformly leveled to the top edges of the gabions. Lids shall be stretched tight over the rock filling using only approved lid closing tools as necessary. The use of crowbars or other single point leverage bars for lid closing is prohibited as they may damage the baskets. The lid shall be stretched until it meets the perimeter edges of the front and end panels. The gabion lid shall then be secured to the sides, ends, and diaphragms with spiral binders, approved alternate fasteners, or lacing wire wrapped with alternating single and double half-hitches in the mesh openings.

Any damage to the wire or coatings during assembly, placement, and filling shall be repaired promptly in accordance with the manufacturer's recommendations or replaced with undamaged gabion baskets.

7. Measurement and payment

Method 1—For items of work for which specific unit prices are established in the contract, the volume of rock is measured within the neat lines of the gabion structure and computed to the nearest cubic yard. Payment for gabions is made at the contract unit price and includes the wire mesh and rock. Such payment is considered full compensation for all labor, material, equipment, and all other items necessary and incidental to completion of the work.

Method 2—For items of work for which specific unit prices are established in the contract, the volume of the gabions is measured within the neat lines of the gabion structure and computed to the nearest cubic yard. Payment for the gabions is made at the contract unit price and includes the wire mesh, rock, and specified bedding material or geotextile. Such payment is considered full compensation for all labor, material, equipment, and all other items necessary and incidental to the completion of the work.

Method 3—For items of work for which specific unit prices are established in the contract, the surface area is measured within the neat lines of the gabion mattress structure and computed to the nearest square yard. Payment for the gabion mattress is made at the contract unit price and includes the wire mesh and rock. Such payment is considered full compensation for all labor, material, equipment, and all other items necessary and incidental to the completion of the work.

Method 4—For items of work for which specific unit prices are established in the contract, the surface area is measured within the neat lines of the gabion mattress structure and computed to the nearest square yard. Payment for the gabion mattress is made at the contract unit price and includes the wire mesh, rock, and specified bedding material or geotextile. Such payment is considered full compensation for all labor, material, equipment, and all other items necessary and incidental to the completion of the work.

All methods—The following provisions apply to all methods of measurement and payment. Unless otherwise specified in section 8, no deduction in volume is made for any void or embedded item. Compensation for any item of work described in the contract, but not listed in the bid schedule, is included in the payment for the item of work to which it is made subsidiary. Each item and the items to which they are made subsidiary are identified in section 8 of this specification.

8. Items of work and construction details

Instructions for use

Construction Specification 71—Water Control Gates

1. Applicability

Construction Specification 71 is applicable to the installation of gates for the purpose of water control, including slide gates, flap gates, and radial gates.

2. Material specifications

Material Specifications 571, 572, and 573 complement Construction Specification 71. Table 71-1 is a guide to selection of metal water control gates. When fabricated wooden gates are required for special applications, a material specification tailored to the specific job generally is more appropriate.

3. Included items

Items to be included in contract specifications and drawings follow:

- a. Plans, elevations, and sections showing location of gates and type and size of openings.
- b. Types of gates and applicable material specifications.
- c. Class of gate (seating and unseating heads expressed as a numerical symbol). Example: Class 40-10 denotes a seating head of 40 feet and an unseating head of 10 feet.
- d. Type of frame (flat, spigot, flange, flange with spigot) and details of the method of attaching the gate to the structure or pipe. Include thimble details, when required, together with designation of type of thimble (E, F, C, L, flange and bell, or flange and flare).
- e. Special gate requirements (self-contained, nonrising stem, flush-bottom opening); include material requirements for fabricated metal gates if other than steel is required.

- f. Type and capacity of gate stems, hoists, lifts, stem guides, stem housings, couplings, sleeves, and other appurtenances.
- g. Paint systems to be used in shop and field painting. (Refer to Construction Specification 82, Painting Metalwork.)
- h. Special gate operating requirements, particularly if the gate is intended to operate in other than the fully open or fully closed position. Example: Gate will be required to operate in a partly open position under a full head.

4. Methods

No alternative methods are included.

5. Items of work and construction details

Starting at the top of page 71-3, prepare and outline job specific "Items of Work and Construction Details" (IWCD) in accordance with these instructions. For ease of utilization, the use of recyclable color paper for the IWCD should be considered.

Table 71-1 Guide to selection of metal water control gates

Type of gate	Application	Frequency of use	----- Types of gates satisfactory for exposure condition -----		
			fresh water or slight pollution	moderate pollution (domestic and agricultural sewage, industrial waste)	extreme pollution, (sea water, brackish water)
Slide	Drainage gates	Frequent	MLS-1&2, MMS-1		
	Canal headgates	Infrequent	MMS-1, MHS-1	MHS-2	MHS-3
	Sediment pool drainage gate	Infrequent	MMS-2, MHS-1	MHS-2	MHS-3
	Reservoir water supply	Frequent	MMS-2, MHS-1	MHS-2	MHS-3
	Intake gates	Infrequent	MHS-1, MHS-2	MHS-3	MHS-3
Flap	Accessible gravity outlets	MMF-1, MLF-1	MHF-2	MHF-3	
	Inaccessible gravity outlets	MHF-1, MMF-1	MHF-2	MHF-3	
	Pump outlets, not subject to slamming	MHF-1, MMF-1	MHF-2	MHF-3	
	Pump outlets, subject to slamming	MHF-1R	MHF-2R	MHF-3R	

Construction Specification 71—Water Control Gates

1. Scope

The work consists of furnishing and installing water control gates including gate stems, hoists, lifts, and other appurtenances.

2. Material

The gates furnished shall conform to the requirements of Material Specifications 571, 572, and 573, as appropriate, and as specified in section 8 of this specification and on the drawings. All gates shall be furnished complete with hoisting equipment and other specified appurtenances.

3. Installing gates

The contractor shall install the gates in a manner that prevents leakage around the seats and binding of the gates during normal operation.

Surfaces of metal against which concrete will be placed shall be free from oil, grease, loose mill scale, loose paint, surface rust, and other debris or objectionable coatings.

Anchor bolts, thimbles, and spigot frames shall be secured in true position within the concrete forms and maintained in alignment during concrete placement.

Concrete surfaces against which rubber seals will bear or against which flat frames or plates are to be installed shall be finished to provide a smooth and uniform contact surface.

When a flat frame is installed against concrete, a layer of concrete mortar shall be placed between the gate frame and the concrete.

When a gate is attached to a wall thimble, a mastic or resilient gasket shall be applied between the gate frame and the thimble in accordance with the recommendations of the gate manufacturer.

Wall plates, sills, and pin brackets for radial gates shall be adjusted and fastened by grouting and bolting after the gates have been completely assembled in place.

4. Installing hoists and lifts

Gate stems, stem guides, and gate lifts shall be carefully aligned so that the stem shall be parallel to the guide bars or angles on the gate frame following installation.

5. Radial gate seals

The rubber seals for radial gates shall be installed so that the seals contact the walls or wall plates throughout the entire gate length when the gate is in the closed position.

6. Operational tests

After the gate(s) and hoist(s) (or lifts) have been installed, they shall be cleaned, lubricated, and otherwise serviced by the contractor in accordance with the manufacturer's instructions. The contractor shall test the gate and hoist by operating the system several times throughout its full range of operation. The contractor shall make any changes or adjustments necessary to ensure satisfactory operation of the complete gate system.

7. Measurement and payment

The number of each type, size, and class of gate is counted. Payment for furnishing and installing each type, size, and class of gate shall be made at the contract unit price for that type, size, and class of gate. Such payment constitutes full compensation for all labor, equipment, material, and all other items necessary and incidental to the completion of the work including furnishing and installing anchor bolts and all specified appurtenances and fittings.

Compensation for any item of work described in the contract, but not listed in the bid schedule is included in the payment for the item of work to which it is made subsidiary. Such items and items to which they are made subsidiary are identified in section 8 of this specification.

8. Items of work and construction details

Instructions for use Construction Specification 81—Metal Fabrication and Installation

1. Applicability

Construction Specification 81 is applicable to the construction of items of metalwork not covered by other specifications. It is applicable to such items as trash guards, anti-vortex hoods and baffles, flashboard guides, and similar structures or parts. It is not applicable to the installation of concrete reinforcing steel, water control gates, fences, wells, piles, or pipe conduits.

2. Material specifications

Material Specification 581 and 582 and Construction Specification 82 complement Construction Specification 81.

3. Included items

Items to be included in construction specifications and drawings follow:

- a. Detailed drawings as necessary to show the dimensions and method of fabrication and erecting the item or structure.
- b. For aluminum, the alloy to be used in the work if other than specified in Material Specification 581. Alloys specified for use should be limited to those for which ASCE Specifications for Structures of Aluminum Alloy are available. Such specifications are published in section A of the Aluminum Construction Manual of The Aluminum Association.
- c. Type of steel if other than structural quality. Use *commercial* or *merchant* quality only for small parts where the strength is not a major design consideration. Examples: Noncritical angles and other shapes less than 3 inches in maximum dimension of section, shear plates for construction joints in concrete, small trash rack parts, and other similar metal features.

- d. Details of connections showing sizes and number of bolts; sizes, kinds, and dimensions of welds; and sizes and number of rivets.
- e. Designation of items to be galvanized or painted and designation of paint systems to be used.
- f. Ordering data listed in the material specifications, as appropriate, including such items as:
 - (1) Type, kind, size, hardness, and length of bolts.
 - (2) Class, grade, condition, and finish of castings.
 - (3) Type, composition, hardness, size, and form of other material.
- g. Methods of measurement and payment if the standard specification includes more than one method.

4. Methods

Section 6, Measurement and payment

Method 1—Intended for use when the metalwork is a minor portion of the contract and consists largely of items that would normally be fabricated by the contractor.

Method 2—Intended for use when the metalwork is a significant portion of the contract.

Method 3—Intended for use when the metalwork includes individual items of significant scope or complexity or which would normally be procured from outside sources or fabricated for the contractor by others.

When specifications are prepared using electronic procedures and all methods but one are deleted for use in a contract specification, delete from the last paragraph, ***All Methods The following provisions apply to all methods of measurement and payment.*** Left justify the remaining text.

5. Items of work and construction details

Starting at the top of page 81–3, prepare and outline job specific "Items of Work and Construction Details" (IWCD) in accordance with these instructions. For ease of utilization, the use of recyclable color paper for the IWCD should be considered.

Construction Specification 81—Metal Fabrication and Installation

1. Scope

The work consists of furnishing, fabricating, and erecting metalwork, including the metal parts and fasteners of the composite structures.

2. Material

Unless otherwise specified, material shall conform to the requirements of Material Specification 581, Metal. Steel shall be structural quality unless otherwise specified. Castings shall be thoroughly cleaned and subjected to careful inspection before installation. Finished surfaces shall be smooth and true to assure proper fit. Galvanizing shall conform to the requirements of Material Specification 582, Galvanizing.

3. Fabrication

Fabrication of structural steel shall conform to the requirements of *Specification for the Design, Fabrication and Erection of Structural Steel for Buildings (Riveted, Bolted and Arc-Welded Construction)*, American Institute of Steel Construction.

Fabrication of structural aluminum shall conform to the requirements in the Aluminum Design Manual available from The Aluminum Association.

4. Erection

The frame of metal structures shall be installed true and plumb. Temporary bracing shall be placed wherever necessary to resist all loads to which the structure may be subjected, including those applied by the installation and operation of equipment. Such bracing shall be left in place as long as may be necessary for safety.

As erection progresses the work shall be securely bolted up, or welded, to resist all dead load, wind, and erection stresses. The contractor shall furnish such installation assisting bolts, nuts, and washers as may be required.

No riveting or welding shall be performed until the structure is stiffened and properly aligned.

Rivets driven in the field shall be heated and driven with the same care as those driven in the shop.

All field welding shall be performed in conformance to the requirements for shop fabrication except those that expressly apply to shop conditions only.

5. Protective coatings

Items specified to be galvanized shall be completely fabricated for field assembly before the application of the zinc coatings. Galvanized items shall not be cut, welded, or drilled after the zinc coating is applied.

Items specified to be painted shall be painted in conformance to the requirements of Construction Specification 82 for the specified paint systems.

6. Measurement and payment

Method 1—The work is not measured. Payment for metal fabrication and installation is made at the contract lump sum price in the contract. Such payment constitutes full compensation for all labor, equipment, material, and all other items necessary and incidental to the completion of the work including connectors and appurtenances, such as rivets, bolts, nuts, pins, studs, washers, hangers, and weld metal.

Method 2—The weight of metal installed complete in place shall be determined to the nearest pound. Unless otherwise specified, the weight of metal shall be computed by the method specified in section 3 of the Code of Standard Practice for Steel Buildings and Bridges, American Institute of Steel Construction, except that the following unit weights shall also be used, as appropriate, as the basis of computation:

Material	Unit weight (lb/ft ³)
Aluminum alloy	173
Bronze or copper alloy	536
Iron, malleable	470
Iron, wrought	487

Payment for furnishing, fabricating, and installing metalwork is made at the contract unit price for the specified types of labor, material, equipment, and all other items necessary and incidental to the completion of the work.

Method 3—The work is not measured. Payment for furnishing, fabricating, and installing each item of metalwork is made at the contract price for that item. Such payment constitutes full compensation for all labor, equipment, material, and all other items necessary and incidental to the completion of the work including connectors and appurtenances, such as rivets, bolts, nuts, pins, studs, washers, hangers, and weld metal.

All methods—The following provisions apply to all methods of measurement and payment. Compensation for any item of work described in the contract, but not listed in the bid schedule, is included in the payment for the item of work to which it is made subsidiary. Such items and the items to which they are made subsidiary are identified in section 7 of this specification.

7. Items of work and construction details

Instructions for use Construction Specification 82—Painting Metalwork

1. Applicability

Construction Specification 82 is applicable to the painting of metalwork including structural metal, water control gates, piping, pumps, and other metal equipment and machinery.

The durability of paint films on metal depends upon the exposure condition, the types of paints used, the thickness of the coating, and the method of preparing the metal surface before the application of primers and paint. To a large extent the type of paint required is dictated by the exposure condition, and the required surface preparation is dictated by the type of paint to be applied. Each paint system specifies the type and quality of paint, the number of coats or minimum paint film thickness required, and the finish (gloss, semigloss, flat).

The paint systems are not equivalent optional methods. Each paint system is designed to provide protection for a particular exposure condition or to produce a particular finished appearance or both. The criteria for selection of the appropriate paint system and surface preparations for that finish are summarized in table 82-1 of these instructions.

Where a minor amount of painting is to be performed and it is not required for protection, use a simple note on the drawings rather than Construction Specification 82.

2. Material specifications

Material Specification 583, Coal Tar-Epoxy Paint, complements Construction Specification 82 when Paint System F is specified. References to the Steel Structures Paint Council (SSPC) for surface preparation are summarized. Refer to SSPC for full text as appropriate. No other material specifications complement this specification. Any material requirements are to be specified in section 10.

3. Included items

Items to be included in contract specifications and drawings follow:

- a. Indicate by notes on the drawings, the surfaces and items to be painted.
- b. Designate the paint system (by letter) to be used for painting each indicated item. If all metalwork is to be painted by the same paint system, one standard note to that effect is sufficient.
- c. Waiver of the requirement that the contractor furnish a plan and material list if the plan is not necessary.
- d. Provide color requirements, finish (gloss, semigloss, flat) and any special requirements as appropriate.
- e. Instructions for painting, surface preparation, or other special conditions or methods not covered by the standard specification.
- f. Surface preparation for needed maintenance painting may be limited to those spots or areas having loss of protection by corrosion and/or wearing surfaces. A clean, sound paint surface provides a good base for added layers.
- g. Provide tinting requirements as appropriate. Various coatings have a unique tolerance for pigmentation. Under- or over-pigmentation can produce poor cover quality (hide) and less than desirable performance.
- h. Note in section 10 if the contractor is to provide paint specification information to the engineer that is to be shared with the owners to use for their responsibility for operation and maintenance.

4. Methods

Select the method or methods for surface preparation that is appropriate for the durability and length of service required. Refer to table 82-1 for surface preparation recommendations. The quality of surface preparation diminishes as the method number increases, and the expected surface life is reduced accordingly. The small cost increase in selecting a higher quality preparation can significantly reduce operation and maintenance costs and untimely coating failure.

5. Items of work and construction details

Starting at the top of page 82-5, prepare and outline job specific "Items of Work and Construction Details" (IWCD) in accordance with these instructions. For ease of utilization, the use of recyclable color paper for the IWCD should be considered.

Table 82-1 Paint systems for metalwork*

Paint system	Type of paint material	Description and conditions for use	Example applications	Surface preparation
A	Alkyd primer (type 1) Alkyd enamel (type 2) Gloss or semigloss (type 3)	A good interior and exterior system. It is not intended for humid or damp environments. System A should not be applied to a surface that constantly sweats or is immersed in water. It chinks or oxidizes when subjected to sunlight.	Interior and exterior surfaces of buildings, piping, pumps, and machinery above operating floors, doors, frames, tanks.	Method 2 or 3, commercial blast or brush-off blast.
B	Single package moisture cured urethane primer (type 9) Alkyd enamel (type 2) Gloss or semigloss (type 3)	Similar to the qualities of system A. Urethane primer allows system to be applied over poorly prepared surfaces particularly in areas where proper preparation is difficult or impractical. It is a good system for repainting over old existing paint for rehabilitation.	Exterior or interior surfaces of buildings, piping, pumps, and machinery above operating level. Good rehabilitation system when preparation is minimal.	Method 2 or 3, commercial blast or brush-off blast.
C	Epoxy polyamide (type 4) Epoxy polyamide (type 5)	An excellent system for constant or intermittent immersion in salt or fresh water. Excellent for surfaces exposed to constant humidity and sweating. Excellent chemical resistance and available in almost all colors. Will chalk or oxidize when exposed to sunlight.	Trash racks and guards or flap gates, stop logs and guides, pumps, piping, machinery, and storage tanks.	Method 1, near white blast.

See footnotes at end of table.

Table 82-1 Paint systems for metalwork—Continued

Paint system	Type of paint material	Description and conditions for use	Example applications	Surface preparation
D	Epoxy polyamide primer (type 4) Epoxy polyamide (type 5) Acrylic polyurethane gloss (type 6) or semigloss (type 7)	Same as system C except is topcoated with acrylic polyurethane. Not recommended for immersed metals. Excellent interior or exterior in humid or arid environment. High abrasion resistance. Excellent color and gloss retention (15 times greater than systems A, B, or C). Excellent on steel that sweats. Available in either gloss or semi-gloss. Should be considered for long-term exposure to sunlight or when esthetics are a factor.	Exterior surfaces of buildings, such as drains, overflows, gutters, and piping exposed to either humid or arid conditions. Any metal items that gather condensation and/or have high exposure to sunlight. Interior surfaces, such as walls, ceilings, structural steel, equipment, and piping.	Method 2 or 3, commercial blast or brush-off blast.
E	Single package moisture cured Urethane primer (type 9) Acrylic polyurethane gloss (type 6) or semigloss (type 7)	Good system for dry or humid environments. Excellent color and gloss retention. Cannot be used for coating immersed metals and is not as good as system D in constant moisture. Excellent long-term esthetics.	Structural steel, siding, doors, frames, piping, machinery, and storage tanks.	Method 2 or 3, commercial or brush-off blast.
F	Coal tar epoxy (type 10)	Excellent in constant or intermittent immersion in salt or fresh water. Excellent also for buried steel surfaces. Available in black only; changes to brown when exposed to sunlight, but sunlight does not adversely effect performance. Excellent chemical resistance and dependability exhibited in extensive use throughout the water and wastewater treatment industry. Note: Galvanized surfaces require a pretreatment vinyl acid wash primer before applying paint, as noted in type 8 paints. Sandblasting or aged galvanized surfaces do not require a vinyl wash treatment.	Trash guards, water control gates, pipes, steel piling, stop logs and guides, water tanks, and flumes.	Method 1, near white blast.
G	Epoxy polyamide primer (type 4) Single package moisture cured urethane (type 9)	Excellent system for repair of damaged galvanized metal in humid or arid environments. Provides protection for surfaces exposed to constant humidity and sweating.	Trash guards, CMP, stop logs and guides, and other galvanized metalwork.	Method 4 or 5, hand tool or solvent clean.

See footnotes at end of table.

Table 82-1 Paint systems for metalwork—Continued

Paint system	Type of paint material	Description and conditions for use	Example applications	Surface preparation
H	Vinyl acid wash treatment (type 8)	For use as a pretreatment wash for galvanized and nonferrous metals that require painting.	Trash guards, CMP, stop logs and guides, gutters, downspouts, and other galvanized or nonferrous metals.	Steam clean with TSP, or solvent clean, regularly changing rags.

Footnotes:

- a. All surface preparation referred to herein shall be performed in accordance with SSPC (Steel Structures Painting Council).
- b. All painting and coating shall be performed per SSPC Good Painting Practices and paint manufacturer's recommendations.
- c. Coated steel subjected to potable water service shall be coated in accordance with American Water Works Association (AWWA) provisions and directions. Said coatings shall meet United States National Sanitation Foundation (US-NSF) requirements.
- d. When special protective coatings or other specific painting recommendations are necessary, refer to the Paint Manual, United States Department of Interior (USDI), Bureau of Reclamation, or paint manufacturer's data.
- e. Surface preparation indicated is the method that will provide coating quality appropriate for exposure conditions. Methods that produce a greater or a lesser quality can be chosen to produce the quality of work that is necessary. Hand tool cleaning (method 4) and solvent cleaning (method 5) are applicable for field applications, small areas requiring coating, or in making repairs to factory coatings.

Construction Specification 82—Painting Metalwork

1. Scope

The work consists of cleaning metal surfaces and applying paints and protective coatings.

2. Paint

For the purpose of this specification, paints and coatings shall be designated by types as defined below.

Materials for systems requiring two or more coats shall be supplied by the same manufacturer.

Unless otherwise specified and before application, the contractor shall furnish in writing to the engineer for approval a plan outlining procedures proposed for painting metalwork and a list of material including name of manufacturer, pertinent product identification names and numbers, and product data sheets. Data shall reflect the requirements set forth in this section.

Type 1 - Alkyd primer. Alkyd based, rust inhibitive primer shall be lead and chromate free. Primer shall have a minimum of 54 percent solids, by volume. Color availability shall be red, gray, and white. Primer shall be able to be applied satisfactory at 2 to 3 mils dry-film thickness in one coat.

Type 2 - Alkyd enamel (gloss). Alkyd based enamel shall be lead free. It shall have a minimum of 49 percent solids, by volume. Alkyd enamel shall be able to be applied satisfactory at 2 to 3 mils dry-film thickness in one coat. Finish shall be gloss.

Type 3 - Alkyd enamel (semigloss). Alkyd based enamel shall be lead free. It shall have a minimum of 55 percent solids, by volume. Alkyd enamel shall be able to be applied satisfactory at 2 to 3 mils dry-film thickness in one coat. Finish shall be semigloss.

Type 4 - Epoxy polyamide primer. Epoxy polyamide primer shall be lead and chromate free. It shall have a minimum of 56 percent solids, by volume. Epoxy primer shall be able to be applied satisfactory at 4 to 6 mils dry-film thickness in one coat. Color availability shall be red, gray, and white. Epoxy primer shall conform to AWWA Standard C 210 and AWWA Standard D 102.

Type 5 - Epoxy polyamide (intermediate or finish). Epoxy polyamide shall be lead free. It shall have a minimum of 56 percent solids, by volume. Epoxy polyamide shall be able to be applied satisfactory at 4 to 6 mils dry-film thickness in one coat. Finish shall be semigloss. Epoxy finish shall conform to AWWA C 210 and AWWA D 102.

Type 6 - Acrylic polyurethane (gloss). Acrylic polyurethane shall be lead free. It shall have a minimum of 74 percent solids, by volume. Polyurethane shall be able to be applied satisfactory at 3 to 5 mils dry-film thickness in one coat. Finish shall be gloss.

Type 7 - Acrylic polyurethane (semigloss). Acrylic polyurethane shall be lead free. It shall have a minimum of 58 percent solids, by volume. Polyurethane shall be able to be applied satisfactory at 3 to 5 mils dry-film thickness in one coat. Finish shall be semigloss.

Type 8 - Vinyl acid wash treatment. Pretreatment primer for galvanized and nonferrous metal. Pretreatment primer shall have a minimum of 8 percent solids, by volume. The applied dry-film thickness of pretreatment primer shall not exceed 0.5 mil. Steel primed with pretreatment primer shall be topcoated within 6 to 8 hours in humid conditions.

Type 9 - Single package moisture cured urethane primer. Urethane primer shall have a minimum of 50 percent solids, by volume. Primer shall be able to be applied satisfactory at 2 to 3 mils dry-film thickness in one coat. Color shall be metallic aluminum.

Type 10 - Coal tar epoxy. Coal tar epoxy shall have a minimum of 75 percent solids, by volume, and conform to the requirements of NRCS Material Specification 583 Coal Tar Epoxy Paint (Steel Structures Paint Council PS No. 16, Type I). Coal tar epoxy shall be able to be applied satisfactory at 8 to 15 mils dry-film thickness in one coat.

3. Tinting

Tinting shall not be performed in the field unless otherwise specified.

4. Surface preparation

Surfaces to be painted shall be thoroughly cleaned before the application of paint or coatings. Surface preparations required by this specification are as designated by SSPC (Steel Structures Painting Council) and are summarized by the methods listed in this section.

Method 1—Near white blast (SSPC-SP10). All surfaces to be coated shall be prepared by removing all grease and oil using steam cleaning or solvent cleaning methods per method 5. After degreasing is completed, sand or grit blasting shall be performed to remove all dirt, rust, mill scale, and other foreign material or residue. The cleaned, finished surface shall be a minimum of 95 percent free of all visible foreign material or residue.

Method 2—Commercial blast (SSPC-SP6). All surfaces to be coated shall be prepared by removing all grease and oil using steam cleaning or solvent cleaning methods per method 5. After degreasing is completed, sand or grit blasting shall be performed to remove all dirt, rust, mill scale, or other foreign material or residue. The cleaned, finished surface shall be a minimum of 67 percent free of all visible foreign material or residue.

Method 3—Brush-off blast cleaning (SSPC-SP7). All surfaces to be coated shall be prepared by removing all grease and oil using steam cleaning or solvent cleaning methods per method 5. After degreasing is completed, sand or grit blasting shall be performed to remove dirt, rust, mill scale, or other foreign material or residue. Mill scale, rust, and paint are considered tightly adherent if they cannot be removed by lifting with a dull putty knife.

Method 4—Hand tool cleaning (SSPC-SP2). All surfaces to be coated shall be prepared by removing all oil or grease using steam cleaning or solvent cleaning methods per method 5. After degreasing is completed, nonpower handtools shall be used to remove loose, detrimental foreign material. Adherent mill scale, rust, and paint need not be removed.

Method 5—Solvent cleaning (SSPC-SP1). Surfaces to be coated shall be prepared by removing all visible oil, grease, soil, drawing and cutting compounds, and other soluble contaminants from surfaces with solvents or commercial cleaners using various methods of cleaning, such as wiping, dipping, steam cleaning, or vapor degreasing.

5. Paint systems

For the purposes of this specification, systems of painting and coating metalwork are designated as defined in this section.

Paint system A—Consists of the application of one primer coat of type 1 and two or more coats of type 2 (gloss) or type 3 (semigloss) to provide a minimum dry-film thickness of 6 mils.

Paint system B—Consists of the application of one primer coat of type 9 and two or more coats of type 2 (gloss) or type 3 (semigloss) to provide a minimum dry-film thickness of 6 mils.

Paint system C—Consists of the application of one coat of type 4 and one or more coats of type 5 to provide a minimum dry-film thickness of 8 mils.

Paint system D—Consists of the application of one coat of type 4 primer, one coat of type 5, and one coat of type 6 (gloss) or type 7 (semigloss) to provide a minimum dry-film thickness of 11 mils.

Paint system E—Consists of the application of one coat of type 9 and one coat of type 6 (gloss) or type 7 (semigloss) to provide a minimum dry-film thickness of 5 mils.

Paint system F—Consists of the application of two coats of type 10 at a dry-film thickness of 8 mils. per coat. Total system shall provide a minimum dry-film thickness of 16 mils.

Paint system G—Consists of the application of two coats of type 4 and two coats of type 9 paint. Total system shall provide a minimum dry-film thickness of 14 mils.

6. Application of paint

Surfaces shall be painted immediately after preparation or within the same day as prepared with a minimum of one coat of the primer type specified. Remaining surfaces not required to be painted shall be protected against contamination and damage during the cleaning and painting operation.

Paints shall be thoroughly mixed immediately before application.

After erection or installation of the metalwork, all damage to shop-applied coating shall be repaired and all bolts, nuts, welds, and field rivet heads shall be cleaned and painted with one coat of the specified priming paint.

Initial priming coats shall be applied by brush except on surfaces accessible only to spray equipment. All other coats may be applied by brush or spray. Each coat shall be applied in such a manner to produce a paint film of uniform thickness with a rate of coverage within the guidelines and limits recommended by the paint manufacturer and as outlined in section 2 of this specification.

The drying time between coats shall be as prescribed by the paint manufacturer, but not less than that required for the paint film to thoroughly dry. The elapsed time between coats in paint system F shall not exceed 24 hours. If for any reason the critical recoat time is exceeded, the coated surface shall be treated with the manufacturer's recommended tackifier solvent or brush blasted to roughen the surface.

The finished surface of each coat shall be free from runs, drops, ridges, laps, or excessive brushmarks and shall present no variation in color, texture, and finish. The surface of each dried coat shall be cleaned as necessary before application of the next coat.

7. Atmospheric conditions

Paint application shall not be performed when the temperature of the item to be painted or the surrounding air is less than 50 degrees Fahrenheit. Painting shall be performed only when the humidity and temperature of the surrounding air and the temperature of the metal surfaces are such that evaporation rather than condensation results during the time required for application and drying. The surface shall be dry and a minimum of 5 degrees Fahrenheit above the dew point. Surfaces protected from adverse atmospheric conditions by special cover, heating, or ventilation shall remain so protected until the paint is thoroughly dry.

8. Tests

Dry-film thickness on ferrous metal shall be determined by the use of a nondestructive magnetic instrument, such as an Elcometer or Mikrotest gauge. Instruments shall have been calibrated within 1 month before use. Film thickness on nonferrous metal shall be determined with film gauges during the application process. Systems with film thickness less than specified shall be brought into conformance by the application of one or more additional coats of the specified material.

9. Payment

For items of work for which lump sum prices are established in the contract, payment is made as the work proceeds, but after presentation of invoices by the contractor supporting actual related costs and evidence of the charges of suppliers, subcontractors, and others for supplies furnished and work completed. If the total of such payments is less than the lump sum contract price for this item, the unpaid balance is included in the next appropriate contract payment. Payment of the lump sum contract price constitutes full compensation for completion of the work.

Compensation for any item of work described in the contract, but not listed in the bid schedule, is included in the payment for the item of work to which it is made subsidiary. Such items and the items to which they are made subsidiary are identified in section 10 of this specification.

10. Items of work and construction details

Instructions of use

Construction Specification 83—Timber Fabrication and Installation

1. Applicability

Construction Specification 83 is applicable to all types of timber construction (except pile driving or the use of round timber) that are normally an integral part of structures designed and installed under agency programs. Supplementary specifications will be required for works of a special nature, such as bridges or buildings.

2. Material specifications

Material Specifications 581, 582, 584, and 585 and Construction Specification 84 complement Construction Specification 83.

3. Included items

Items to be included in contract specifications and drawings follow:

- a. Plans and dimensions of all structural elements.
- b. Complete details of all connections including number, type, size, and kind of nails or spikes or bolts with nuts if the design requires that these be specified; depth of embedment of screws and pins, and other such information.
- c. For lumber and timber, specify:
 - (1) Stress grade
 - (2) Species according to standard commercial name
 - (3) Heartwood requirements or other special requirements
 - (4) Nominal size and dress requirements (rough or dressed)
 - (5) Preservative treatment, if required (refer to ASTM D 1760 for guidance to type of treatment)
 - (6) Applicable grading rule, including the name of the agency that sponsors the rule (such as National Hardwood Lumber Association), the paragraph number, and year of issue.

- d. For plywood and chipboard, specify:
 - (1) Number of plies, width and length of sheet
 - (2) Species or group according to PS 1
 - (3) Grade
 - (4) Type (exterior, interior)
 - (5) Finished thickness
 - (6) Finish requirements (such as sanded or unsanded)
- e. Designation of surfaces to be painted.
- f. Special instructions concerning cutting of treated lumber or timber, if such operations are to be allowed.

4. Methods

Section 6, Measurement and payment

Method 1—Intended for use in cases where the quantities of lumber and timber are large and the measurement of structural elements is feasible.

Method 2—Considered more appropriate for structures of moderate size.

Method 3—Provides a flexible method of payment when there are some structure units that can be paid for as completed structures and also structures that lend themselves to partial payment on a linear foot basis.

When specifications are prepared using electronic procedures and all methods but one are deleted for use in a contract specification, delete from the last paragraph, **All Methods The following provisions apply to all methods of measurement and payment.** Left justify the remaining text.

5. Items of work and construction details

Starting at the top of page 83–3, prepare and outline job specific "Items of Work and Construction Details" (IWCD) in accordance with these instructions. For ease of utilization, the use of recyclable color paper for the IWCD should be considered.

Construction Specification 83—Timber Fabrication and Installation

1. Scope

The work shall consist of the construction of timber structures and timber parts of composite structures.

2. Material

Structural timber and lumber shall conform to the requirements of Material Specification 584. Treated timber and lumber shall be impregnated with the specified type and quantity of preservative and in the manner specified in Material Specification 585.

Hardware, except cast iron, shall be galvanized as specified for iron and steel hardware in Material Specification 582. Unless otherwise specified, structural steel shapes, plates, and rods shall not be galvanized. Nuts, driftbolts, dowels, and screws shall be either wrought iron or steel.

Steel bolts shall conform to the requirements of ASTM A 307. When galvanized or zinc-coated bolts are specified, the zinc coating shall conform to the requirements of Material Specification 582.

Washers shall be ogee gray iron castings or malleable iron castings unless washers cut from medium steel or wrought iron plate are specified on the drawings or in section 7 of this specification. Cast washers shall have a thickness equal to the diameter of the bolt and a diameter equal to four times the thickness. The thickness for plate washers shall be equal to half the diameter of the bolt, and the sides of the square shall be equal to four times the diameter of the bolt. Holes in washers shall have a maximum diameter of 1/8 inch larger than the diameter of the bolt. Split ring connectors, tooth ring connectors, and pressed steel shear plate connectors shall be manufactured from hot-rolled, low carbon steel conforming to the requirements of ASTM A 711, Grade 1015. Malleable iron shear plate connectors and spike grid connectors shall be manufactured in conformance with the requirements of ASTM A 47, Grade No. 35018. All connectors shall be of approved design and the type and size specified.

Structural shapes, rods, and plates shall be structural steel conforming to the requirements of Material Specification 581. No welds are permitted in truss rods or other main members of trusses or girders.

3. Workmanship

All framing shall be true and exact. Timber and lumber shall be accurately cut and assembled to a close fit and shall have even bearing over the entire contact surface. No open or shimmed joints will be accepted. Nails and spikes shall be driven with just sufficient force to set the heads flush with the surface of the wood. Deep hammer marks in wood surfaces shall be considered evidence of poor workmanship and may be sufficient cause for rejection of the work.

Holes for round driftpins and dowels shall be bored with a bit 1/16 inch smaller in diameter than that of the driftpin or dowel to be installed. The diameter of holes for square driftpins or dowels shall be equal to one side of the driftpin or dowel. Holes for lag screws shall be bored with a bit not larger than the body of the screw at the base of the thread.

Washers shall be used in contact with all bolt heads and nuts that would otherwise be in contact with wood. Cast iron washers shall be used when the bolt will be in contact with earth. All nuts shall be checked or burred effectively with a pointed tool after finally tightened.

Unless otherwise specified, surfacing, cutting, and boring of timber and lumber shall be completed before treatment. If field cutting or field repair of treated timber and lumber is approved, all cuts and

abrasions shall be carefully trimmed and coated with two paint-on or swab-applied applications of a wood preservative that is not less than 5 percent (by weight) pentachlorophenol. A copper metal solution of 2 percent (by weight) copper naphthenate may be used as a replacement for pentachlorophenol, which is a controlled substance. After timber assembly, any unfilled holes shall be plugged with tightly fitting wooden plugs that have been treated with preservative as specified.

4. Handling and storing material

All timber and lumber stored at the site of the work shall be neatly stacked on supports a minimum of 12 inches above the ground surface and protected from the weather by suitable covering(s). Untreated material shall be staked and stripped to permit free circulation of air between the tiers and courses. Treated timber may be close-staked. The ground surface for the stockpile of timber and lumber shall be free of weeds and rubbish. The use of cant hooks, peavies, or other pointed tools except end hooks is not permitted in the handling of structural timber and/or lumber. Treated timber shall be handled with rope slings or by other methods that prevent the breaking or bruising of outer fibers or penetration of the surface in any manner.

5. Painting

Except as otherwise specified, surfaces designated for painting shall be prepared and painted in accordance with Construction Specification 84.

6. Measurement and payment

Method 1—The unit of measurement of lumber and timber is the number of thousand feet board measure (MBM) of each type, size, species, and grade of lumber and timber installed in the completed structure. The quantity of each type, size, species, and grade is computed from the nominal dimensions and actual lengths of the pieces in the completed structure and does not include waste timber used for erection purposes (such as falsework or temporary sheeting and bracing) or any part of any pile or other round timber. The total quantity of lumber and timber in each type, size, species, and grade is computed to the nearest 0.01 MBM.

The unit of measurement of plywood is the number of square feet of each type, species, grade, and thickness installed in the completed structure.

Payment for each type, size, species, and grade of lumber and timber is made at the contract unit price for that type, size, species, and grade. Payment for each type, species, grade, and thickness of plywood is made at the contract unit price for that type, species, grade, and thickness. Such payment is considered full compensation for completion of the work.

Method 2—No measurement of material quantities is made. Payment for each structure, complete in place, is made at the contract lump sum price for that structure. Such payment is considered full compensation for completion of the work.

Method 3—For items of work for which specific unit prices are established in the contract, measurement and payment for each structure unit except those for which a linear foot payment is established is counted and payment made at the contract unit price. Items for which a linear foot payment is established are measured to the nearest linear foot, and payment is made at the contract unit prices as appropriate. Such payment is considered full compensation for completion of the work.

All methods—The following provisions apply to all methods of measurement and payment. Compensation for any item of work described in the contract, but not listed in the bid schedule, is included in the payment for the item of work to which it is made subsidiary. Such items and the items to which they are made subsidiary are identified in section 7 of this specification.

7. Items of work and construction details

Instructions for use Construction Specification 84—Painting Wood

1. Applicability

Construction Specification 84 is applicable to the exterior painting of wood material.

2. Material specifications

No material specifications complement Construction Specification 84.

3. Included items

Items to be included in construction specifications and drawings follow:

- a. Surfaces to be painted.
- b. Instructions for tinting if colors other than white are required.
- c. Paint and primer to be used if other than specified in section 2.
- d. Number of paint and/or primer coats if other than specified in section 4.

4. Methods

No methods are included.

5. Items of work and construction details

Starting at the top of page 84-3, prepare and outline job specific "Items of Work and Construction Details" (IWCD) in accordance with these instructions.

Construction Specification 84—Painting Wood

1. Scope

The work shall consist of cleaning and preparing wood surfaces and applying protective paint coatings.

2. Material

Unless otherwise specified in section 7 of this specification, painting material shall meet the following requirements:

- Exterior paint primer shall conform to the requirements of Master Painters Institute—MPI #5 Exterior Alkyd Wood Primer.
- Exterior oil paint shall conform to the requirements of Master Painters Institute—MPI #8 Exterior Alkyd, Flat. Unless otherwise specified, the color shall be white. The second coat of exterior oil paint may be thinned with mineral spirits conforming to the requirements of ASTM D 235 or with pure gum turpentine. The amount of thinner shall not exceed 1 pint per gallon of paint.
- When tinting is required, it shall be accomplished by the addition of pigment-in-oil tinting colors conforming to the requirements of Federal Specification A-A-3108A.

3. Surface preparation

All surfaces to be painted/primed shall be thoroughly cleaned before the application of paint/primer. Pitch pockets and knots shall be scraped and sealed with a shellac varnish conforming to the requirements of ASTM D 360. Previously painted surfaces shall be scraped and brushed to remove any checked or blistered paint and all excess chalk.

4. Application of paint/primer

Surfaces shall be clean and dry during paint/primer application. No paint/primer shall be applied until the prepared surfaces have been inspected and approved for paint/primer application.

Surfaces of new wood shall be painted with 1 brush coat of exterior primer paint and two brush coats of exterior oil paint unless otherwise specified in section 7 of this specification.

Paints/primers shall be thoroughly mixed at the time of application.

Each paint and primer coat shall be applied in such a manner as to produce a coating film of uniform thickness with a finished surface free of runs, drops, ridges, laps, or excessive brush marks. The minimum drying time between applications shall be as prescribed by the manufacturer of the paint/primer and not before the previous paint/primer application being thoroughly dry.

The surface of each dried coating shall be cleaned as necessary before application of the next coat.

The first coat of exterior oil paint shall be tinted off-color by the addition of 3 ounces of an appropriate tinting color per gallon of paint.

5. Atmospheric conditions

Unless otherwise specified in section 7 of this specification or by the manufacturer of the coating products, paint and primer shall not be applied when the temperature of the wood surface or of the surrounding air is less than 45 degrees Fahrenheit. Coatings shall not be applied when atmospheric conditions result in moisture condensation on the surface to be painted/primed. Surfaces protected from atmospheric conditions by special cover or enclosure, heating, or ventilation shall remain to provide full protection until the paint/primer is thoroughly dry.

6. Payment

For items of work for which specific lump sum prices are established in the contract, payment for priming and painting wood is made at the contract lump sum price. Such payment is full compensation for furnishing, preparing the surfaces, and applying all coating material to wood surfaces designated to be painted including labor, tools, equipment, material, and all other items necessary and incidental to the completion of the work.

Compensation for any item of work described in the contract, but not listed in the bid schedule is included in the payment for the item of work to which it is made subsidiary. Such items and the item to which they are made subsidiary are identified in section 7 of this specification.

7. Items of work and construction details

Instructions for use

Construction Specification 91—Chain Link Fence

1. Applicability

Construction Specification 91 is applicable to the installation of chain link fences.

2. Material specifications

No material specifications complement Construction Specification 91.

3. Included items

Items to be included in contract specifications and drawings follow:

- a. Plan showing the location and extent of fences including location of gates, corners, pull posts, and end points.
- b. Dimensions of the fence including post spacing, clearance from ground, and height of fence.
- c. Details of posts and assemblies:
 - (1) Types of post and top rails if other than specified in section 2.
 - (2) Line post detail showing height of post, depth of embedment.
 - (3) Details of corner post assembly, pull post, and corner post, including embedment, top rail connections, tension wire detail, braces, and trusses.
 - (4) Show diameters of embedment items.
 - (5) Special anchor requirements, if any.
- d. Dimensions of gate opening (clear opening between inside faces of the gateposts).
- e. Dimensions of gates and type if other than specified in section 2.
- f. Required appurtenances, such as locks with number of keys, barbed wire arms, barbed wire, and post tops.
- g. Type, mesh, and gauge of chain link fabric, if other than specified in section 2.

- h. If the fence material is to be PVC coated, the following information should be included in the Items of Work and Construction Details:
 - (1) Specify PVC coating for the fence material.
 - (2) Specify desired standard color of PVC coating (see ASTM F 934) if other than black is to be used.

4. Methods

Section 5, Measurement and payment

Method 1—Intended for use when gates are a minor part of the work item.

Method 2—Intended for use when gates form a substantial part of the work item or when gates must be installed in existing fences.

When specifications are prepared using electronic procedures and all methods but one are deleted for use in a contract specification, delete from the last paragraph **All Methods The following provisions apply to all methods of measurement and payment.** Left justify the remaining text.

5. Items of work and construction details

Starting at the top of page 91–3, prepare and outline job specific "Items of Work and Construction Details" (IWCD) in accordance with these instructions. For ease of utilization, the use of recyclable color paper for the IWCD should be considered.

Construction Specification 91—Chain Link Fence

1. Scope

The work consists of furnishing and installing chain link fencing complete with all posts, braces, gates, and all other appurtenances.

2. Material

The material for the chain link fence shall be as follows:

Galvanized

Chain link fence fabric shall conform to the requirements of ASTM A 392, 2-inch mesh and 9-gauge galvanized steel wire. Zinc coating shall be class 2.

Posts and fence framework shall conform to the requirements of ASTM F 1043 Group 1A, for Heavy Industrial Fence. Coatings shall be a type A galvanized coating for internal and external surfaces. Steel pipe posts shall conform to the requirements of ASTM F 1043 and F 1083.

Fence fittings shall conform to the requirements of ASTM F 626. Fittings shall be galvanized steel. Wire ties and clips shall be 9-gauge.

Gates, gateposts, and gate accessories shall conform to the requirements of ASTM F 900. Coating shall be the same as selected for adjoining fence and framework.

Barbed wire shall be 12.5 gauge and shall conform to the requirements of ASTM A 121, chain link fence grade.

Galvanized and PVC coated

Chain link fence fabric shall conform to the requirements of ASTM F 668 for class 2a or 2b, 2-inch mesh, and 9-gauge galvanized steel wire. The fabric shall have a polymer top coating of the color specified in section 6.

Posts and fence framework shall conform to the requirements of ASTM F 1043 Group 1A, for Heavy Industrial Fence. Coatings shall be a type A galvanized coating for internal and external surfaces and covered with a polymer top coating of color as specified in section 6.

Fence fittings shall conform to the requirements of ASTM F 626. Fittings shall be galvanized steel with a polymer top coating of color as specified in section 6.

Any damage to the coating shall be repaired in accordance with the manufacturer's recommendations, or the damaged fencing material shall be replaced. The contractor shall provide the engineer a copy of the manufacturer's recommended repair procedure and materials before correcting damaged coatings.

3. Installing fence posts

Unless otherwise specified, line posts shall be placed at intervals of 10 feet measured from center to center of adjacent posts. In determining the post spacing, measurement is made parallel with the ground surface.

Posts shall be set in concrete backfill in the manner shown on the drawings.

Posts set in the tops of concrete walls shall be grouted into preformed holes to a depth of 12 inches.

All corner posts, end posts, gateposts, and pull posts shall be embedded, braced, and trussed as shown on the drawings or in accordance with appropriate industry practice if not otherwise shown or specified.

4. Installing wire fabric

Fencing fabric shall not be stretched until at least 4 days after the posts are grouted into walls or 7 days after the posts are set in the concrete backfill.

Fencing fabric shall be installed on the side of the posts designated on the drawings.

The fabric shall be stretched taut and securely fastened, by means of tie clips, to the posts at intervals not exceeding 15 inches and to the top rails or tension wires at intervals not exceeding 2 feet. Care shall be taken to equalize the fabric tension on each side of each post.

Barbed wire shall be installed as shown on the drawings and shall be pulled taut and fastened to each post or arm with the tie wires or metal tie clips.

5. Measurement and payment

Method 1—The length of fence is measured to the nearest 0.1 foot along the fence, including gates. Payment is made at the contract unit price for the specified height of fence. Such payment constitutes full compensation for all labor, material, equipment, and all other items necessary and incidental to the completion of the work.

Method 2—The length of fence is measured to the nearest 0.1 foot along the fence, excluding gate openings. Payment is made at the contract unit price for the specified height of fence. The number of each size and type of gate installed is determined. Payment is made at the contract unit price for that type and size of gate. Such payment constitutes full compensation for all labor, material, equipment, and all other items necessary and incidental to the completion of the work.

All methods—The following provisions apply to all methods of measurement and payment. Compensation for any item of work described in the contract, but not listed in the bid schedule, is included in the payment for the item of work to which it is made subsidiary. Such items and the items to which they are made subsidiary are identified in section 6 of this specification.

6. Items of work and construction details

Instructions for use

Construction Specification 92—Field Fence

1. Applicability

Construction Specification 92 is applicable to the installation of field fence of the barbed wire, woven wire, or wire netting types.

2. Material specifications

Material Specification 591 complements Construction Specification 92.

3. Included items

Items to be included in contact specifications and drawings follow:

- a. Plan showing the location and extent of fences including location of gates, corners, braces, and end points.
- b. Dimensions of the fence including post spacing, clearance from ground and height of fence.
- c. Details of concrete or other specialty post, if required.
- d. Details of posts and assemblies.
 - (1) Type and kind of posts as defined and referenced in Material Specification 591.
 - (2) Line post detail showing height of post, depth of embedment.
 - (3) Details of end panel assembly, pull post assembly, brace panel assembly, and corner assembly including types of posts, types of backfill, types and dimensions of braces, gauges of tension wires and details of fastening of tension wires to post.
 - (4) Special anchor requirements for posts at crossings over depressions or waterways.
 - (5) Where fencing is to be placed on a curved alignment, special consideration should be given to providing adequate vertical stability for prevention of pull-over. Consideration should include spacing of end panels, post spacing, type of posts, and post depth.
- e. Details of gates listed in this section may often be shown on a standard drawing developed for use for fencing projects within an agency administrative area.
- f. Type and kind of fencing as defined in section 11.
 - (1) For barbed wire fencing, specify the type, gauge of wire, gauge and spacing of barbs, and the number of points per barb.
 - (2) For woven wire fencing, specify the type, style, design number, and tensile strength grade.
 - (3) For wire netting, specify the type, style, height of netting, size of mesh and gauge of wire, or design number and coating class.
 - (4) For high tensile strength wire fencing material, specify the strength grade classification.
- g. Species of wood posts.
- h. Preservative treatment of wood posts and braces, as applicable.
- i. Protective coating (painted or zinc-coated) for steel posts and braces.

4. Methods

Section 10, Measurement and payment

Method 1—Intended for use when gates are simple and are considered to be of field fabricated type.

Method 2—Intended for use when gates must be shop fabricated, available on the market, or when gates must be installed within existing fences.

When specifications are prepared using electronic procedures and all methods but one are

deleted for use in a contract specification, delete from the last paragraph *All Methods The following provisions apply to all methods of measurement and payment.* Left justify the remaining text.

5. Items of work and construction details

Starting at the top of page 92-3, prepare and outline job specific "Items of Work and Construction Details" (IWCD) in accordance with these instructions. For ease of utilization, the use of recyclable color paper for the IWCD should be considered.

Construction Specification 92—Field Fence

1. Scope

The work shall consist of furnishing and installing field fence, including gates and fittings.

2. Material

Material for field fence shall conform to the requirements of Material Specification 591. All wooden posts shall be of the same species, when available.

3. Setting posts

Concrete or wood posts shall be set in holes and backfilled with earth except where otherwise specified. Wood posts may be driven when approved by the engineer. Steel posts shall be driven unless otherwise specified.

Holes for installing fence posts shall be at least 6 inches larger than the diameter or side dimension of the posts.

Earth backfill around posts shall be thoroughly tamped in layers not thicker than 4 inches and shall completely fill the posthole up to the ground surface. Concrete backfill around posts shall be rodded into place in layers not thicker than 12 inches and shall completely fill the posthole to the surface of the ground. Backfill, either earth or concrete, shall be crowned-up around posts at the ground surface.

No stress shall be applied to posts set in concrete for a period of not less than 24 hours following the development of a firm set of the concrete.

4. Corner assembly

Unless otherwise specified in section 11, corner assemblies shall be installed at all points where the fence alignment changes 15 degrees or more.

5. End panels

End panels shall be built at gates and fence ends.

6. Pull post assembly

Pull post assembly (bracing within a section of straight fence) shall be installed at the following locations:

- a. In straight fence sections, at intervals not to exceed 660 feet.
- b. At any point where the vertical angle described by two adjacent reaches of wire is upward and exceeds 10 degrees (except as provided in section 11 of this specification).
- c. At the beginning and end of each curved fence section.

7. Attaching fencing to posts

The fencing shall be stretched and attached to posts as follows:

- a. The fencing wire or netting shall be placed on the side of the post opposite the area being protected except for installation along curved sections.
- b. The fencing wire or netting shall be placed on the outside for installation along curved sections.
- c. The fencing wire or netting shall be fastened to each end post, corner post, and pull post by wrapping each horizontal strand around the post and tying it back on itself with not less than three tightly wound wraps.

- d. The fencing wire or netting shall be fastened to wooden line posts by means of steel staples. Woven-wire fencing shall be attached at alternate horizontal strands. Each strand of barbed wire shall be attached to each post. Steel staples shall be driven diagonally with the grain of wood and at a slight downward angle and shall not be driven so tightly as to bind the wire against the post.
- e. The fencing wire or netting shall be fastened to steel or concrete line posts with either two turns of 14 gauge galvanized steel or iron wire or in accordance with recommendations provided by the post's manufacturer.
- f. Wire shall be spliced by means of a Western Union splice or by suitable splice sleeves applied with a tool designed for that purpose. The Western Union splice shall have no less than eight wraps of each end about the other. All wraps shall be tightly wound and closely spaced. Splices made with splice sleeves shall have a tensile strength no less than 80 percent of the strength of the wire being spliced.

8. Stays

Stays shall be attached to the fencing at the spacing outlined in section 11 or as shown on the drawings to ensure maintenance of the proper spacing of the fence wire strands.

9. Crossings at depressions and watercourses

Where fencing is installed parallel to the ground surface, the line posts subject to upward pull shall be anchored.

- a. If the fence wire or netting is installed parallel to the ground surface, the line posts subject to uplift shall be anchored by means of extra embedment or by special anchors as detailed on the drawings.
- b. If the fence wire is installed with the top wire straight and parallel to the ground surface on either side of the depression, extra length posts shall be used to allow normal post embedment. Unless otherwise specified, excess space between the bottom of the fence and the ground shall be closed with extra strands of barbed wire or with netting.

10. Measurement and payment

Method 1—The length of each type and kind of fence is measured to the nearest foot along the profile of the fence, including gate openings. Payment for each type and kind of fence is made at the contract unit price for that type and kind of fence. Such payment constitutes full compensation for completion of the work, including fabricating and installing gates.

Method 2—The length of each type and kind of fence is measured to the nearest foot along the profile of the fence, excluding gate openings. Payment is made at the contract unit price for the specified height of fence. The number of each size and type of gate installed is determined. Payment is made at the contract unit price for that type and size of gate. Such payment constitutes full compensation for all labor, material, equipment, and all other items necessary and incidental to the completion of the work.

All methods—The following provisions apply to all methods of measurement and payment. Compensation for any item of work described in the contract, but not listed in the bid schedule, is included in the payment for the item of work to which it is made subsidiary. Such items and the items to which they are made subsidiary are identified in section 11 of this specification.

11. Items of work and construction details

Instructions for use Construction Specification 93—Identification Markers or Plaques

1. Applicability

The construction specification is applicable to the installation of identification markers or plaques to the works of improvement.

2. Material specifications

No material specifications complement this specification. Any specific material requirements must be indicated in the specifications or on the drawings.

3. Included items

Items to be included in contract specifications and drawings follows:

- a. Complete detail drawings for each type, kind, and size of marker or plaque, including material requirements.
- b. The style of letters and height of each line.
- c. A carefully worded exhibit showing the exact arrangement of words.
- d. The physical description for the installation location for each type and size of marker or plaque to be installed. Location selected should consider the audience intended and the potential for vandalism.
- e. Type of required monument or type of structure to which marker or plaque will be mounted.
- f. For markers signifying buried structures, state and/or local government regulations for sign specifications may apply. Ensure that project sign message and state and/or local government rules do not conflict.

4. Methods

Section 5, Measurement and Payment

Method 1—Intended for use when various sizes and types of markers or plaques are to be installed.

Method 2—Intended for use when a single marker or plaque is to be installed or multiple number of markers are to be installed and they are of similar type and size.

When specifications are prepared using electronic procedures and all methods but one are deleted for use in a contract specification, delete from the last paragraph ***All Methods The following provisions apply to all methods of measurement and payment.*** Left justify the remaining text.

5. Items of work and construction details

Starting at the top of page 93-2, prepare and outline job specific "Items of Work and Construction Details" (IWCD) in accordance with these instructions. For ease of utilization, the use of recyclable color paper for the IWCD should be considered.

Construction Specification 93—Identification Markers or Plaques

1. Scope

The work consists of furnishing and installing identification markers or plaques at the designated locations.

2. Material

The markers or plaques shall be constructed of the specified material, and shall meet all requirements for lettering, painting, finishing, and related items as shown on the drawings or as specified in section 6 of this specification.

3. Construction methods

The markers or plaques shall be installed at location(s) as shown on the drawings and in the manner or condition specified in section 6.

4. Monuments

Unless otherwise specified, the markers or plaques shall be mounted on concrete monuments, on existing structures, or on structures proposed for installation under this contract.

5. Measurement and payment

Method 1—For items of work for which specific unit prices are established in the contract, payment for each type, kind, and size of marker or plaque complete in place is made at the contract unit price for that type, kind, and size. Such payment constitutes full compensation for all labor, equipment, tools, and all other items necessary and incidental to the completion of the work.

Method 2—For items of work for which specific lump sum prices are established in the contract, payment for identification markers or plaques is made at the contract lump sum price. Such payment constitutes full compensation for all labor, equipment, tools, and all other items necessary and incidental to the completion of the work.

All methods—The following provisions apply to all methods of measurement and payment. Compensation for any item of work described in the contract, but not listed in the bid schedule, is included in the payment for the item of work to which it is made subsidiary. Such items and the items to which they are made subsidiary are identified in section 6 of this specification.

6. Items of work and construction details

Instructions for use

Construction Specification 94—Contractor Quality Control

1. Applicability

Construction Specification 94 is applicable to contracts that require the contractor to provide quality control (QC), material testing, and verification of material quality before use.

2. Material specifications

No material specifications complement Construction Specification 94. Any material requirements are to be specified in section 10 (see 3 b below).

3. Included items

Items to be included in the contract specification and drawings follow:

- a. Develop specific requirements for the quality control testing that the contractor is to provide. Establish, as appropriate for the method selected, the types of material the contractor is required to test, types of representative tests required, frequency of tests, and other site specific related details.
- b. Provide details on the required intensity of contractor's quality control inspection efforts with emphasis on the site-specific aspects of the work, equipment, and material to be used. Specify, as appropriate for the method selected, the documentation required for verification of foundations and cutoff trench excavations, subgrade for fills, placement of reinforcement and forming before ordering concrete, equipment operational tests and available equipment backups, and safety measures specified. Prescribe specific requirements regarding:
 - (1) Reliance on contractor for initial or benchmark testing, production testing, and testing to adjust to changes in material or methods.
 - (2) Standards to be used as reference for quality control testing and field inspections of material, methods, and procedures.
 - (3) Special testing or inspection procedures that need to be included in the quality control system.

- c. Contract specific qualifications or requirements for professional registration or certification of QC personnel if necessary to meet Federal, State, or local statutes or job requirements.
- d. Specify the required approvals by the contracting officer not covered in the basic specification for items, such as personnel qualifications, equipment condition, format of recordkeeping, and documentation.
- e. Describe the cooperation and communication aspects for the quality control and quality assurance activities.

4. Methods

Section 3, Quality Control System, and Section 4, Quality Control Personnel

Method 1—For use with the smaller or less complex work where the contractor's staff is expected to understand and be qualified to perform routine quality control. The contractor must develop an effective quality control system. The contractor and contracting officer will meet and reach agreement on the system. Specify in section 10 if the contracting officer will document by correspondence to the contractor the understanding reached concerning the quality control system. When the project supervisor can also function as the contractor's quality control manager, so state in section 10.

Method 2—For use with large or complex work where the contractor is required to have qualified quality control testing and inspection personnel on their staff or will subcontract for these services and provide NRCS with a written quality control plan and regularly submit quality control documentation.

Selection of either method 1 or method 2 in sections 3 and 4 must be uniformly made within the specification for each contract.

Section 9, Payment

Method 1—Used for larger, more complex projects where uniformity in QC activities may not exist.

Method 2—Used for smaller, simpler projects. The use of method 2 is encouraged when fair and equitable treatment will occur.

When specifications are prepared using electronic procedures and all methods but one are deleted for use in a contract specification, delete from the last paragraph ***All Methods The following provisions apply to all methods of measurement and payment.*** Left justify the remaining text.

5. Items of work and construction details

Starting at the top of page 94-4, prepare and outline job specific "Items of Work and Construction Details" (IWCD) in accordance with these instructions. For ease of utilization, the use of recyclable color paper for the IWCD should be considered.

Construction Specification 94—Contractor Quality Control

1. Scope

The work consists of developing, implementing, and maintaining a quality control system to ensure that the specified quality is achieved for all materials and work performed.

2. Equipment and materials

Equipment and material used for quality control shall be of the quality and condition required to meet the test specifications cited in the contract. Testing equipment shall be properly adjusted and calibrated at the start of operations and the calibration maintained at the frequency specified. Records of equipment calibration tests shall be available to the engineer at all times. Equipment shall be operated and maintained by qualified operators as prescribed in the manufacturer's operating instructions, the references specified, and as specified in section 10 of this specification. All equipment and materials used in performing quality control testing shall be as prescribed by the test standards referenced in the contract or in section 10.

All equipment and materials shall be handled and operated in a safe and proper manner and shall comply with all applicable regulations pertaining to their use, operation, handling, storage, and transportation.

3. Quality control system

Method 1—The contractor shall develop, implement, and maintain a system of quality control to provide the specified material testing and verification of material quality before use. The system activities shall include procedures to verify adequacy of completed work, initiate corrective action to be taken, and document the final results. The identification of the quality control personnel and their duties and authorities shall be submitted to the contracting officer in writing within 15 calendar days after notice of award.

Method 2—The contractor shall develop, implement, and maintain a system adequate to achieve the specified quality of all work performed, material incorporated, and equipment furnished before use. The system established shall be documented in a written plan developed by the contractor and approved by the contracting officer. The system activities shall include the material testing and inspection needed to verify the adequacy of completed work and procedures to be followed when corrective action is required. Daily records to substantiate the conduct of the system shall be maintained by the contractor. The quality control plan shall cover all aspects of quality control and shall address, as a minimum, all specified testing and inspection requirements. The plan provided shall be consistent with the planned performance in the contractor's approved construction schedule. The plan shall identify the contractor's onsite quality control manager and provide an organizational listing of all quality control personnel and their specific duties. The written plan shall be submitted to the contracting officer within 15 calendar days after notice of award. The contractor shall not proceed with any construction activity that requires inspection until the written plan is approved by the contracting officer.

All methods—The quality control system shall include, but not be limited to, a rigorous examination of construction material, processes, and operation, including testing of material and examination of manufacturer's certifications as required, to verify that work meets contract requirements and is performed in a competent manner.

4. Quality control personnel

Method 1—Quality control activities shall be accomplished by competent personnel. A competent person is: One who is experienced and capable of identifying, evaluating, and documenting that materials and processes being used will result in work that complies with the contract; and, who has authority to take prompt action to remove, replace, or correct such work or products not in compliance. Off-site testing laboratories shall be certified or inspected by a nationally recognized entity. The Contractor shall submit to the Contracting Officer, for approval, the names, qualifications, authorities, certifications, and availability of the competent personnel who will perform the quality control activities.

Method 2—Quality control activities shall be accomplished by competent personnel who are separate and apart from line supervision and who report directly to management. A competent person is one who is experienced and capable of identifying, evaluating, and documenting that material and processes being used will result in work that complies with the contract, and who has authorization to take prompt action to remove, replace, or correct such work or products not in compliance. Offsite testing laboratories shall be certified or inspected by a nationally recognized entity. The contractor shall submit to the contracting officer, for approval, the names, qualifications, authorities, certifications, and availability of the competent personnel who will perform the quality control activities.

5. Post-award conference

The contractor shall meet with the contracting officer before any work begins and discuss the contractor's quality control system. The contracting officer and the contractor shall develop a mutual understanding regarding the quality control system.

6. Records

The contractor's quality control records shall document both acceptable and deficient features of the work and corrective actions taken. All records shall be on forms approved by the contracting officer, be legible, and be dated and signed by the competent person creating the record.

Unless otherwise specified in section 10 of this specification, records shall include:

- a. Documentation of shop drawings including date submitted to and date approved by the contracting officer, results of examinations, any need for changes or modifications, manufacturer's recommendations and certifications, if any, and signature of the authorized examiner.
- b. Documentation of material delivered including quantity, storage location, and results of quality control examinations and tests.
- c. Type, number, date, time, and name of individual performing quality control activities.
- d. The material or item inspected and tested, the location and extent of such material or item, and a description of conditions observed and test results obtained during the quality control activity.
- e. The determination that the material or item met the contract provisions and documentation that the engineer was notified.
- f. For deficient work, the nature of the defects, specifications not met, corrective action taken, and results of quality control activities on the corrected material or item.

7. Reporting results

The results of contractor quality control inspections and tests shall be communicated to the engineer immediately upon completion of the inspection or test. Unless otherwise specified in section 10, the original plus one copy of all records, inspections, tests performed, and material testing reports shall be submitted to the engineer within one working day of completion. The original plus one copy of documentation of material delivered shall be submitted to the engineer before the material is used.

8. Access

The contracting officer and the engineer shall be given free access to all testing equipment, facilities, sites, and related records for the duration of the contract.

9. Payment

Method 1—For items of work for which lump sum prices are established in the contract, payment is made as the work proceeds, after presentation by the contractor of invoices showing related costs and evidence of charges by suppliers, subcontractors, and others for furnishing supplies and work performed. If the total of such payments is less than the lump sum contract price for this item, the remaining balance is included in the final contract payment. Payment of the lump sum contract price constitutes full compensation for completion of the work.

Payment is not made under this item for the purchase cost of material and equipment having a residual value.

Method 2—For items of work for which lump sum prices are established in the contract, payment is prorated and paid in equal amounts on each monthly estimate. The number of months used for prorating shall be the number estimated to complete the work. The final month's prorate amount is made with the final payment. Payment as described above constitutes full compensation for completion of the work.

Payment is not made under this item for the purchase cost of material and equipment having a residual value.

All methods—Compensation for any item of work described in the contract, but not listed in the bid schedule, is included in the payment for the item of work to which it is made subsidiary. Such items and the items to which they are made subsidiary are identified in section 10.

10. Items of work and construction details

Instructions for use Construction Specification 95—Geotextile

1. Applicability

This specification is applicable for the installation of both woven and nonwoven geotextiles used for purposes of slope protection, subsurface drains, and stabilization of soils.

2. Material specifications

Material Specification 592 complements Construction Specification 95.

3. Included items

Items to be included in the contract specifications and drawings follow:

- a. The purpose or use of the geotextile (i.e., slope protection) and the selection of class I, II, III, or IV, as appropriate, woven or nonwoven, (See Design Note 24).
- b. The range of apparent opening size (AOS) for woven geotextiles. Any increase or change from those parameters shown in tables 1 and 2 that are desired and based on specific design data.
- c. When specified, size and configuration of panels for payment (e.g., method 2). Note: A panel represents pieces from a roll that have been seamed together to create the specified size and shape.
- d. Details of panel joining and splicing; i.e., seaming, overlap or folding (method 1 or method 2 in section 5).
- e. The required roll width, when necessary.
- f. Details of panel placement, orientation, and anchorage, when necessary. Perimeter and toe anchorage details, as necessary. When the use of pins is acceptable as temporary anchorage, so specify.
- g. Requirements of cushioning or bedding material used to cover the geotextile to protect against damage during placement of surface material, such as rock riprap.
- h. Special installation requirements.

- i. Ultraviolet exposure requirements for conditions where the potential exposure is considered severe (use 500 hours). The 150-hour requirement listed in tables 1 and 2 is recommended for normal exposure conditions.
- j. In section 6 for measurement when method 1 or 2 is selected, note the method of measurement being horizontal or slope measurement in determining surface area of the geotextile for payment purposes.

4. Methods

Section 5, Placement

Method 1—Intended to be used when the primary use of the geotextile is to function as a filter and holes or "holidays" from anchoring pins might compromise the integrity of the installation.

Method 2—Intended to be used when the primary use of the geotextile is to function as a bedding and as a separator of material. Seepage may be present, but the potential for piping in the base soil material is not a concern.

May also need to specify whether a, b, or c in the Included items apply.

Section 6, Measurement and payment

Method 1—Intended for use when the geotextile is measured for payment based on the total surface area covered. The additional lap material needed for joining is not measured for payment.

Method 2—Intended for use when the geotextile is measured for payment based on the roll width and length used to cover the area. The measurement includes that amount needed for overlap and joining panels.

Method 3—Intended for use when the quantity is not measured for payment and there is not likely to be any change in quantity.

When specifications are prepared using electronic procedures and all methods but one are deleted for use in a contract specification, delete from the last paragraph, ***All Methods The following provisions apply to all methods of measurement and payment.*** Left justify the remaining text.

5. Items of work and construction details

Starting at the top of page 95-4, prepare and outline job specific "Items of Work and Construction Details" (IWCD) in accordance with these instructions. For ease of utilization, the use of recyclable color paper for the IWCD should be considered.

Construction Specification 95—Geotextile

1. Scope

This work consists of furnishing all material, equipment, and labor necessary for the installation of geotextiles.

2. Quality

Geotextiles shall conform to the requirements of Material Specification 592 and this specification.

3. Storage

Before use, the geotextile shall be stored in a clean, dry location out of direct sunlight, not subject to extremes of either hot or cold temperatures, and with the manufacturer's protective cover undisturbed. Receiving, storage, and handling at the job site shall be in accordance with the requirements listed in ASTM D 4873.

4. Surface preparation

The surface on which the geotextile is to be placed shall be graded to the neat lines and grades as shown on the drawings. It shall be reasonably smooth and free of loose rock and clods, holes, depressions, projections, muddy conditions, and standing or flowing water (unless otherwise specified in section 7 of this specification).

5. Placement

Before the geotextile is placed, the soil surface will be reviewed for quality assurance of the design and construction. The geotextile shall be placed on the approved prepared surface at the locations and in accordance with the details shown on the drawings and specified in section 7 of this specification. It shall be unrolled along the placement area and loosely laid, without stretching, in such a manner that it conforms to the surface irregularities when material or gabions are placed on or against it. The geotextile may be folded and overlapped to permit proper placement in designated area(s).

Method 1—The geotextile shall be joined by machine sewing using thread material meeting the chemical requirements for the geotextile fibers or yarn. The sewn overlap shall be 6 inches, and the sewing shall consist of two parallel stitched rows at a spacing of about 1 inch and shall not cross (except for any required re-stitching). The stitching shall be a lock-type stitch. Each row of stitching shall be located a minimum of 2 inches from the geotextile edge. The seam type and sewing machine to be used shall produce a seam strength, in the specified geotextile, that provides a minimum of 90 percent of the tensile strength in the weakest principal direction of the geotextile being used, when tested in accordance with ASTM D 4884. The seams may be factory or field sewn.

The geotextile shall be temporarily secured during placement of overlying material to prevent slippage, folding, wrinkling, or other displacement of the geotextile. Unless otherwise specified, methods of securing shall not cause punctures, tears, or other openings to be formed in the geotextile.

Method 2—The geotextile shall be joined by overlapping a minimum of 18 inches (unless otherwise specified) and secured against the underlying foundation material. Securing pins, approved and provided by the geotextile manufacturer, shall be placed along the edge of the panel or roll material to adequately hold it in place during installation. Pins shall be steel or fiberglass formed as a U, L, or T shape or contain "ears" to prevent total penetration through the geotextile. Steel washers shall be provided on all but the U-shaped pins. The upstream or upslope geotextile shall overlap the abutting downslope geotextile. At vertical laps, securing pins shall be inserted through the bottom layers along a line through approximately the mid-point of the overlap. At horizontal laps and across slope labs, securing shall be inserted

through the bottom layer only. Securing pins shall be placed along a line about 2 inches in from the edge of the placed geotextile at intervals not to exceed 12 feet unless otherwise specified. Additional pins shall be installed as necessary and where appropriate to prevent any undue slippage or movement of the geotextile. The use of securing pins will be held to the minimum necessary. Pins are to remain in place unless otherwise specified.

Should the geotextile be torn or punctured, or the overlaps or sewn joint disturbed, as evidenced by visible geotextile damage, subgrade pumping, intrusion, or grade distortion, the backfill around the damaged or displaced area shall be removed and restored to the original approved condition. The repair shall consist of a patch of the same type of geotextile being used and overlaying the existing geotextile. When the geotextile seams are required to be sewn, the overlay patch shall extend a minimum of 1 foot beyond the edge of any damaged area and joined by sewing as required for the original geotextile except that the sewing shall be a minimum of 6 inches from the edge of the damaged geotextile. Geotextile panels joined by overlap shall have the patch extend a minimum of 2 feet from the edge of any damaged area.

Geotextile shall be placed in accordance with the following applicable specification according to the use indicated in section 7:

Slope protection—The geotextile shall not be placed until it can be anchored and protected with the specified covering within 48 hours or protected from exposure to ultraviolet light. In no case shall material be dropped on uncovered geotextile from a height of more than 3 feet.

Subsurface drains—The geotextile shall not be placed until drainfill or other material can be used to provide cover within the same working day. Drainfill material shall be placed in a manner that prevents damage to the geotextile. In no case shall material be dropped on uncovered geotextile from a height of more than 5 feet.

Road stabilization—The geotextile shall be unrolled in a direction parallel to the roadway centerline in a loose manner permitting conformation to the surface irregularities when the roadway fill material is placed on its surface. In no case shall material be dropped on uncovered geotextile from a height of more than 5 feet. Unless otherwise specified, the minimum overlap of geotextile panels joined without sewing shall be 24 inches. The geotextile may be temporarily secured with pins recommended or provided by the manufacturer, but they shall be removed before the permanent covering material is placed.

6. Measurement and payment

Method 1—For items of work for which specific unit prices are established in the contract, the quantity of geotextile for each type placed within the specified limits is determined to the nearest specified unit by measurements of the covered surfaces only, disregarding that required for anchorage, seams, and overlaps. Payment is made at the contract unit price. Such payment constitutes full compensation for the completion of the work.

Method 2—For items of work for which specific unit prices are established in the contract, the quantity of geotextile for each type placed with the specified limits is determined to the nearest specified unit by computing the area of the actual roll size or partial roll size installed. The computed area will include the amount required for overlap, seams, and anchorage as specified. Payment is made at the contract unit price. Such payment constitutes full compensation for the completion of the work.

Method 3—For items of work for which specific lump sum prices are established in the contract, the quantity of geotextile is not measured for payment. Payment for geotextiles is made at the contract lump sum price and constitutes full compensation for the completion of the work.

All methods—The following provisions apply to all methods of measurement and payment. Compensation for any item of work described in the contract, but not listed in the bid schedule, is included in the payment for the item of work to which it is made subsidiary. Such items and the items to which they are made subsidiary are identified in section 7 of this specification.

7. Items of work and construction details

Instructions for use Construction Specification 96—Field Office

1. Applicability

Construction Specification 96 is applicable when an onsite project field office with the basic facilities for material testing and construction office needs is to be furnished by the contractor.

2. Material specifications

No material specifications complement Construction Specification 96.

3. Included items

Item to be included in contract specifications and drawings follow:

- a. Type of field office; identify type A, B, or C from table 1. If other equipment than that specified is required or is not necessary, supplement or amend table 1 in section 5 of this specification to provide appropriate requirements.
- b. Identify any exception, deletion, or special needs in the equipment, material, or furnishings, such as blinds, lighting, testing equipment (microwave oven), toilet facilities, typewriter (electric or manual), secure storage for nuclear equipment, computer (minimum features need to be identified), copy machine, FAX machine, telephone with answering equipment, and other related items. It should be determined if NRCS or sponsors are to furnish any required items or if they should be included in the contract for the contractor to provide.

- c. Include the responsibility for providing service during the construction period; such as delivery of bottled water, sanitary facility service, cleaning service, snow removal, maintenance of the field office equipment, and electric service. Include any requirements for inspections by utilities or government authorities, such as electrical safety or fire department inspection.
- d. Show on the drawings the approximate location where facilities are to be placed. When known, show the location of the utility services (electricity, natural gas, telephone, water, sewer) available.

4. Items of work and construction details

Starting at the top of page 96-4, prepare and outline job specific "Items of Work and Construction Details" (IWCD) in accordance with these instructions. For ease of utilization, the use of recyclable color paper for the IWCD should be considered.

Construction Specification 96—Field Office

1. Scope

This work shall consist of furnishing and maintaining a field office for the exclusive use of the engineer and other employees of the owner.

2. Logistics

The approximate location of the office shall be as shown on the drawings. Office space provided under this contract item shall be separated from any space used by the contractor for other purposes.

The field office and appurtenances shall be set up, equipped, and made ready for use within 20 days of the receipt of the written Notice to Proceed, unless otherwise specified in section 5. The field office and appurtenances shall remain the property of the contractor and shall be maintained in good condition and appearance until completion of the contract work.

When a mobile field office facility is furnished, it shall be leveled, blocked, and anchored in accordance with Standard A 225.1 of Manufactured Home Installations, 1987 of the National Conference of States on Building Codes and Standards, Inc., or the requirements of the local government that has jurisdiction.

The contractor shall install, provide, and maintain all utilities except telephone service as outlined in section 5. Contractor shall provide access to the telephone company and authorization for the installation of telephone service for the use of NRCS and their agents. Utility service maintenance may include heating fuel, electricity, water, and sewer. Contractor shall provide a sanitary facility (toilet) in accordance with the minimum OSHA Safety and Health Requirements for use by NRCS and their agents (see table 96-1, footnote 1).

The contractor shall provide and maintain a reasonable access road to the field office location together with parking for a minimum of four vehicles in the proximity of the field office site.

Upon completion and acceptance of the project work, the contractor shall remove the field office from the project site and, unless otherwise directed, shall restore all areas affected by the field office installation, including the entrance road and parking areas, to a condition equal to or better than existed before installation of the field office.

3. Materials and furnishings

The contractor shall furnish all materials and furnishings as set forth below:

- a. Provide the type of field office as specified in section 5 of this specification.
- b. The field office shall include, or possess as a minimum, the features shown below and as specified in table 96-1 for the office type specified:
 - (1) Be provided with all items in a clean, usable condition.
 - (2) Be structurally sound, entirely enclosed, secure, and waterproof.
 - (3) Have a ceiling height of not less than 7 feet.
 - (4) Be attractively painted on the outside with a finished interior.
 - (5) Be provided with two exterior doors except type C office shall have one door. The doors shall be equipped with dead-bolt type cylinder locks, including four keys for each lock. Exterior lock and hasps, or equivalent, shall also be provided for each door.
 - (6) Windows shall be equipped with screens and with provisions for opening and closing. Latches or other approved locking provisions to secure the windows shall be provided.
 - (7) Window blinds shall be available and provided for all windows.

- (8) Be provided with adequate artificial lighting to provide an average of 50 candlepower to all work areas within the office. Overhead lamps for each desk and drafting table shall be provided. Electric service shall be continuous for the period the field office is being used to service this contract. Electric lights and power service shall be supplied with at least four grounded duplex convenience outlets installed in each room.
 - (9) Be provided with an approved heating system capable of maintaining a temperature of at least 70 degrees Fahrenheit throughout the office during the periods of cold weather that can be expected to occur during the construction period.
 - (10) Be provided with an approved air conditioner(s) with a minimum capacity of 15,000 BTUs for each office room.
 - (11) Be provided with an electric or gas water heater with a 5-gallon minimum capacity.
- c. The field office shall be furnished with the following listed minimum equipment in good condition and as specified in table 96-1:
- (1) Desk(s) shall have a minimum of two drawers on each side and have minimum surface dimension of 30 inches by 60 inches. A standard office chair with arm rests and casters shall be provided with each desk.
 - (2) A slant-top adjustable height drafting table, with approximate dimensions of 36 inches wide by 60 inches long and a 36-inch height, and an adjustable height drafting stool.
 - (3) Work table with the approximate dimensions of 30 inches wide by 60 inches long and 30 inches high, a portable meeting table with approximate dimensions of 36 inches wide by 72 inches long and 30 inches high, and at least six folding or stacking office chairs.
 - (4) Closets with a minimum clear height of 7 feet and approximately 24 inches by 30 inches equipped with two adjustable and removable shelves.
 - (5) Bookcases or built-in shelving equivalent to five 4-foot-long shelves, each 10-inches wide and 12-inches high, suitably located to reflect an office environment.
 - (6) One two-burner propane or natural gas stove or electric grill that can accommodate two 12-inch diameter pans. Heating capacity shall be adequate to remove soil moisture to meet the requirements of the ASTM quick-dry method.
 - (7) Underwriters Laboratory approved wall-mounted fire extinguisher with a minimum rating of 10 ABC.
 - (8) Minimum of one 16-unit first aid kit approved or certified by the American Red Cross or equivalent.
 - (9) Four-drawer, locking, fireproof metal file cabinet with two keys provided.
 - (10) Electrical refrigerated cold water drinking equipment supplied with potable drinking water and disposable cups for the duration of the contract.
 - (11) Racks for hanging drawings, together with holders or clamps, to accommodate 24- by 36-inch maximum size sheets.
 - (12) Nonskid steps and landing platform with safety handrail for each entrance.
 - (13) One inside and usable sanitary facility (flush type) located within a private room.
 - (14) One utility sink approximately 24 inches by 24 inches equipped with hot and cold running water.
 - (15) One microwave oven with specifications as listed in footnote 2 to table 96-1.
- d. Before mobilizing and setting up the field office, the contractor shall prepare and submit detailed plans of the office to the engineer.
- e. The contractor shall provide access to the engineer for visual verification that the office and equipment meet contract requirements before mobilizing the field office to the work site.

4. Payment

This item is not measured, but is paid at the contract lump sum price established for this bid item in the contract, including mobilization and demobilization. The following progress payment schedule applies unless other provisions are outlined in section 5 of this specification:

- 40 percent of the lump sum price bid will be payable for the first monthly progress payment following satisfactory delivery and setup complete with full service installed.
- 20 percent of payment will be retained to cover the removal of service and demobilization following completion of the work and will be included in the final payment.
- 40 percent remaining will be prorated over the balance of the contract in accordance with the planned construction schedule.

Payment as described herein is full compensation for all labor, material, supplies, equipment, rental fees, utility charges (excluding telephone service charges), and incidentals required to provide, equip, maintain, insure, and cleanup the site following demobilization of the field office unit.

5. Items of work and construction details

Table 96-1 Equipment for field office types

Equipment	Field office type		
	A	B	C
Floor space (ft ²)	480 (2 rooms)	360 (2 rooms)	120 (1 room)
Window space (ft ²)	66	50	30
Air conditioning	Yes	Yes	Yes
Desk and chair	3	2	1
Rack for drawings	1	1	---
Work tables	2	1	1
Meeting table	1	1	---
Drafting table and stool	2	1	---
4-drawer file (D label) metal file cabinet	2	1	---
Folding/office chairs	10	8	4
Electric water cooler	1	1	1
Inside sanitary facility	1 ^{1/}	1 ^{1/}	1 ^{1/}
Oven, microwave	1 ^{2/}	1 ^{2/}	---
Cupboards, closets, etc.	^{3/}	^{3/}	^{3/}
2-burner stove	1	1	---
Fire extinguisher	1	1	1
First aid kit (16 unit)	1	1	1
Utility sink	1	1	---
Window blinds	Yes	Yes	No
Electrical service	Yes	Yes	^{4/}
Desk and table lamps	Yes	Yes	No

1/ Exterior self-contained sanitary facilities within 100 feet of the office with maintenance service is an option.

2/ A variable power microwave oven with minimum inside dimensions of 12 inch by 10 inch by 10 inch. The maximum power setting on the microwave oven shall operate at approximately 650 watts. The microwave oven shall have at least one power setting that operates at between 300 and 400 watts.

3/ Reasonable number for the size of the office.

4/ A generator to provide electric service for heating, lighting, and calculators is sufficient. Contractor is responsible for maintenance, fuel supplies, and service.

Instructions for use Construction Specification 97—Flexible Membrane Liner

1. Applicability

Construction Specification 97 is applicable to the placement of flexible membrane liners in liquid containment systems to control seepage.

2. Material specifications

Material Specification 594, Flexible Membrane Liner, is complementary to this specification.

3. Included items

Items to be included in the contract drawings and specifications follow:

- a. The type of liner material being used and the required thickness.
- b. The required lines and grades of the liner subgrade and the cover layer, if applicable.
- c. Details of panel placement, orientation, and anchorage.
- d. Requirements for subgrade compaction.
- e. Requirements of any cushioning material to be used and the material references for the same.
- f. Requirements for a geosynthetic rubber sheet, as mentioned in section 6, Liner Placement
- g. Requirements for under drains and the associated materials.
- h. Details for any loading, unloading, or cleanout ramps; including batten strips or other means of fastening.
- i. Details for pipe outlets and boots or appurtenances to fit the liner to the pipe, concrete, or steel structures, as mentioned in section 11, Appurtenances.
- j. Details of gas vents and their locations, as mentioned in section 12, Gas Vents and Drainage.
- k. Details for fences, ladders, or other safety features.

- l. Requirements for cover soil, as mentioned in section 13, Cover Soil.
- m. Requirements for concrete placement including the slump of the concrete, as mentioned in section 14, Placement of concrete.
- n. Any special instructions related to the materials, installation, and onsite quality control testing.

4. Items of work and construction details

Starting at the top of page 97-6, prepare and outline job specific "Items of Work and Construction Details" (IWCD) in accordance with these instructions.

Construction Specification 97—Flexible Membrane Liner

1. Scope

The work consists of furnishing and installing a flexible membrane liner, including appurtenances, cover soil, and concrete pads.

2. Material

The liner, welding rod, vent covers, pipe boots, gaskets, metal battens, clamps, bolts, embed channel, adhesive, and sealant shall conform to the requirements of Material Specification 594, the applicable provisions in this specification, and details as shown on the drawings.

3. Shipping and storage

Liner material shall be delivered, handled, and stored according to the manufacturer's recommendations. Liner material shall be stored and protected from puncture, dirt, grease, excessive heat, exposure to ultraviolet radiation, or other damage.

Damaged liner material shall be repaired or replaced. Liner material that cannot be satisfactorily repaired to comply with the requirements of Material Specification 594 shall be removed from the job site.

4. Subgrade preparation

Subgrade soils shall be compacted to provide a smooth, firm, and unyielding foundation. All subgrade surfaces shall be free of organic material, rocks larger than 3/8 inch, angular rocks, or other sharp objects. Surface deformations shall not exceed 1 inch. Standing water, mud, and snow shall be removed prior to liner placement.

The liner shall not be placed until the subgrade has been approved by the engineer.

5. Anchor trench

The anchor trench provides permanent anchoring for the liner and shall be constructed in accordance with the drawings. The trench corners shall be slightly rounded to prevent sharp bends in the liner.

If sloughing of the trench occurs, the sloughed soils shall be removed and necessary repairs shall be made to provide a smooth trench wall. Standing water, mud, and snow shall be removed prior to liner placement and trench backfill.

Soil material used for backfilling the trench shall meet the requirements specified in section 4 of this specification. The trench shall be backfilled in two equal lifts and compacted by rolling with rubber-tired equipment or manually directed compaction equipment.

6. Liner placement

The liner shall be installed with a minimum of handling by using a spreader bar assembly attached to a front-end loader, track-hoe bucket, or by other methods recommended by the liner manufacturer. The liner shall be placed parallel to the direction of maximum slope. During installation, the liner shall be secured with sandbags to protect it from wind uplift forces. The liner shall be seamed and secured by the end of each workday.

Construction equipment shall not be allowed to operate directly on the liner except for all terrain vehicles that produce ground pressure less than 5 pounds per square inch.

The liner shall not be placed during foggy conditions, precipitation events, or in the presence of excessive winds. High-Density Polyethylene (HDPE) and Linear Low-Density Polyethylene (LLDPE) liners shall not be placed when the temperature is less than 50 degrees Fahrenheit. Polypropylene (PP) liners shall not be placed when the temperature is less than 40 degrees Fahrenheit. Polyvinyl Chloride (PVC) liners shall not be placed when the temperature is less than 40 degrees Fahrenheit or greater than 105 degrees Fahrenheit. Ethylene Propylene Diene Monomer (EPDM) liners shall not be placed when the temperature is less than zero degrees Fahrenheit or greater than 120 degrees Fahrenheit.

The liner shall be loosely laid over the subgrade with sufficient slack to accommodate thermal expansion and contraction. Each panel shall be laid out and positioned to minimize the number and length of liner seams and in accordance with the manufacturer's recommendations. The methods used to place panels shall minimize wrinkles especially along field seams. Wrinkles shall not exceed 6 inches in height or "fold over" during soil cover placement or other load application. When specified in section 16 of this specification or recommended by the manufacturer, a geosynthetic rub sheet shall be used under the liner when dragging or moving the panels.

Seam overlap—Liner panels shall have a minimum seam overlap of 4 inches for hot wedge welding, hot air welding, chemical fusion welding, adhesive seams, inseam tape, and cover strip seams. A minimum seam overlap of 3 inches shall be used for extrusion-welded seams. Upslope panels shall overlap downslope panels to produce a shingle effect for drainage.

7. Seaming methods

HDPE, LLDPE, PP—The primary method of seaming shall be hot wedge fusion welding. Fillet extrusion welding shall be used for repairs, T-seams, and detail work. Hot air fusion or chemical fusion welding may be used for PP. Seaming shall not be performed when the ambient sheet temperature is below 45 degrees Fahrenheit or above 90 degrees Fahrenheit.

PVC—Seams shall be joined using hot wedge fusion welding, hot air fusion welding, chemical fusion welding, or an adhesive. Special precautions, as recommended by the manufacturer, shall be taken for seam joining if the ambient sheet temperature is above 105 degrees Fahrenheit. Seam joining shall not be performed when the ambient sheet temperature is below 40 degrees Fahrenheit or above 140 degrees Fahrenheit.

EPDM—Seams shall be joined using double-faced inseam tape or a cover strip recommended by the manufacturer. Seaming shall not be performed when the ambient sheet temperature is below zero degrees Fahrenheit or above 120 degrees Fahrenheit.

8. Seaming procedures

Seaming shall extend to the outside edge of the liner to be placed in the anchor trenches. Seaming shall not be conducted in the presence of moisture, dust, dirt, standing water, or soft subgrade. Seaming procedures shall be in accordance with the liner manufacturer's recommendations.

Hot wedge welding—Hot wedge welding shall be accomplished by a double-wedge fusion welder that produces a double track weld. Welding equipment and accessories shall be in accordance with the liner manufacturer's recommendations. The welder shall be calibrated at least once per day at the beginning of each seaming period.

Fillet extrusion welding—Extrusion welding equipment and accessories shall be in accordance with the liner manufacturer's recommendations. The extrusion welder shall be calibrated at least once per day at the beginning of each seaming period. To ensure proper bonding of the extrusion weld, edges of the patch material and the adjacent liner shall be properly abraded by a light grinding. This operation shall be done no more than 15 minutes before the welding operation. The abrasion process shall remove no more than 10 percent of the material thickness.

Hot air welding—Hot air welding shall be accomplished by a single- or double-tracked fusion welder. Welding equipment and accessories shall be in accordance with the liner manufacturer's recommendations. The welder shall be calibrated at least once per day at the beginning of each seaming period.

Chemical fusion welding—The chemical fusion agent shall be applied to both panels by a squeeze bottle or paintbrush. The width of application shall be a minimum of 2 inches. Pressure shall be applied to the seam in accordance with the liner manufacturer's recommendations to provide adequate contact between the panels. Excess agent extruded from the seam shall be immediately removed.

Adhesive—Adhesive shall be approved by the manufacturer and consist of material with a life expectancy similar to that of the liner material. The adhesive shall be applied to both panels by a paintbrush or other approved method. The adhesive shall cover the entire seam overlap. Pressure shall be applied to the seam in accordance with the liner manufacturer's recommendations to provide adequate contact between the panels. Excess adhesive extruded from the seam shall be immediately removed.

Inseam tape—A primer shall be applied to both panels by a scrub pad or other approved method recommended by the manufacturer. The primer shall cover the entire seam overlap. As soon as the primer has flashed, install the tape on the bottom sheet, remove tape backing, lap the top sheet over the tape, and roll with sufficient pressure to provide adequate contact between the panels.

Cover strip—A primer shall be applied to both panels by a scrub pad or other approved method recommended by the manufacturer. The top sheet shall be lapped over the bottom sheet and rolled to provide contact between the panels. Additional primer shall be applied to cover the entire seam overlap. As soon as the primer has flashed, install the cover strip and roll it with sufficient pressure to provide adequate contact between the cover strip and the panels.

9. Seam testing

Field seams shall be nondestructively tested over their full length. Seam testing shall be performed as the work progresses.

Nondestructive seam testing—Air pressure tests shall be performed in accordance with ASTM D 5820 on all double-track fusion seams. The air pressure test equipment and procedures shall conform to this specification and the liner manufacturer's recommendations. Pressurize the air channel to 25 to 30 pounds per square inch for HDPE, LLDPE, and PP liners, 15 to 25 pounds per square inch for 30 mil PVC liners, and 20 to 30 pounds per square inch for 40 mil PVC liners.

Monitor any pressure drops for 5 minutes. A loss of pressure in excess of 4 pounds per square inch for HDPE, LLDPE, and PP liners, 5 pounds per square inch for 30 mil PVC liners, 4 pounds per square inch for 40 mil PVC liners, or a continuous loss of pressure is an indication of a leak. The location of all defective seams shall be marked and repaired.

Vacuum box tests shall be performed in accordance with ASTM D 5641 on all seams and repairs made by extrusion welds and may be used on PP chemical fusion welds. Vacuum box tests shall not be used on PVC liner seams. The location of all defective seams shall be marked and repaired.

Air lance tests shall be performed in accordance with ASTM D 4437 on single-track fusion welds, chemical fusion welds, and on adhesive PVC seams and EPDM seams, and may be used on PP chemical fusion seams. The location of all defective seams shall be marked and repaired.

Destructive seam testing—If specified in section 16 of this specification, seam samples shall be cut at no more than one sample per 500 feet of weld for destructive seam testing. All destructive seam samples shall be tested in shear and peel modes in accordance with ASTM D 6392 to verify seams meet the requirements of Material Specification 594.

10. Repairs

All defective liner areas and failed seams shall be repaired and retested.

Tears, punctures, material defects—All tears, punctures, and material defects in the liner shall be repaired by installing a patch over the defective area. Surfaces of the liner to be patched shall be cleaned before the repair. All patches shall be of the same liner material and extend a minimum of 6 inches beyond the edges of the defect area. All patches shall have rounded corners and shall be seamed to the liner. Holes that are less than 0.25 inch in diameter on HDPE, LLDPE, and PP liners shall be repaired by a bead of extrudent.

Seam repair—Failed seams shall be repaired by installing a cap strip over the entire length of failed seam. The cap strip shall be of the same liner material and shall extend beyond the failed seam a minimum of 6 inches in all directions. Alternatively, the upper flap may be extrusion welded to the liner along the entire length of the failed seam.

11. Appurtenances

The liner shall be mechanically attached to pipe, concrete, or steel structures as shown in the drawings and according to liner the manufacturer's recommendations.

Pipe boots—Factory fabricated pipe boots shall be used as specified in section 16 of this specification. Pipe boots fabricated in the field shall be from the same material as the liner. The boots shall be welded and clamped to pipes of the same material as the liner. They shall be clamped to other types of pipe as shown in the drawings, or as recommended by the manufacturer, to provide a leak-free attachment.

Metal battens—Metal battens shall meet the requirements of Material Specification 594 and shall be installed according to the drawings and the liner manufacturer's recommendations. The battens shall be bolted to concrete by bolts on 6-inch intervals to create a leak-free connection under submerged conditions. Bolt spacing may be increased to 12 inches for connections above the fluid level.

Embed channel—Embed channel shall meet the requirements of Material Specification 594 and be installed according to drawings and the liner manufacturer's recommendations. The embed channel shall be prefabricated to the dimensions shown on the drawings. All sections of the channel shall be continuously welded to subsequent sections before installation in the concrete forms. All corners shall be miter cut and welded on all sides.

12. Gas vents and drainage

Gas vent flaps vent pipes, and drainage systems shall be installed as specified in section 16 of this specification and as shown on the drawings.

13. Cover soil

If specified in section 16 of this specification, cover soil and placement method shall be in accordance to the drawings and shall conform to this specification and the liner manufacturer's recommendations. Cover soils shall meet the same requirements as specified for subgrade soils in section 4 of this specification. Cover soil placement shall be performed by a loader or bulldozer with ground pressure of less than 8 pounds per square inch. Cover soil shall not be dropped onto the liner from a height of more than 3 feet. Following construction of an access ramp, the soil shall be placed from the bottom of the slope upward. Construction equipment or machinery shall not operate directly on the liner. Cover soil shall be placed during the coolest part of the day.

14. Placement of concrete

Concrete placement for ramps and other appurtenances shall be in accordance with the drawings and as specified in section 16 of this specification. All reinforcing steel shall be placed on flat-footed plastic rebar chairs. All rebar splices shall be fully tied. On slopes, concrete shall be placed from the bottom of the slope to the top and have a slump as specified in section 16 of this specification. Internal vibrators shall be used to consolidate concrete. Metal shovels and rodding shall not be used to consolidate or place the concrete. Concrete forms shall be held in place by methods that avoid damaging the liner.

15. Measurement and payment

For work for which specific unit prices are established in this contract, the quantity of liner installed shall be determined to the nearest square foot by measurement of the covered surfaces only, disregarding that for anchorage, seams, and overlaps. Payment for items listed separately in the contract bid schedule shall be made at the contract price for those items. Such payment shall constitute full compensation for furnishing, shipping, and installing the liner including all pipe boots or shirts, mechanical attachments to pipes and structures, and other items necessary and incidental to the completion of the work.

Compensation for any item of work described in the contract, but not listed in the bid schedule, is included in the payment for the item of work to which it is made subsidiary. Such items and the items to which they are made subsidiary are identified in section 16 of this specification.

16. Items of work and construction details

Instructions for use Construction Specification 98—Geosynthetic Clay Liner

1. Applicability

Construction Specification 98 is applicable to the placement of geosynthetic clay liners in liquid containment systems to control seepage.

2. Material specifications

Material Specification 595, Geosynthetic Clay Liner, complements this specification.

Construction Specification 95, Geotextile, also complements this specification.

3. Included items

Items to be included in the contract Drawings and specifications follow:

- a. The maximum index flux of the geosynthetic clay liner. Geosynthetic Clay liners sandwiched between two geotextiles typically have an index flux of 1×10^{-8} m/s while those with a laminate or film have an index flux of 1×10^{-9} m/s.
- b. The required lines and grades of the liner subgrade and the cover layer, if applicable.
- c. Details of panel placement, orientation, and anchorage.
- d. Requirements of any cushioning material to be used and the material references for the same.
- e. Requirements for subgrade compaction.
- f. Requirements for under drains or interceptors and the associated materials.
- g. Details for any loading, unloading, or cleanout ramps.
- h. Details for pipe outlets or appurtenances to fit the liner to the outlet or inlet structures.

- i. Details for fences, ladders, or other safety features.
- j. Any special instructions related to the materials, installation, and onsite quality control testing.

4. Items of work and construction details

Starting at the top of page 98–3, prepare and outline job specific "Items of Work and Construction Details" (IWCD) in accordance with these instructions.

Construction Specification 98—Geosynthetic Clay Liner

1. Scope

The work shall consist of furnishing and installing a geosynthetic clay liner (GCL) with the necessary appurtenances as shown on the drawings or as specified herein.

2. Material

The liner material shall comply with the requirements of Material Specification 595, the applicable provisions in this specification, and those shown on the drawings.

Granular bentonite used at panel joints and around penetrations and structures shall be of the same quality as the bentonite that is encapsulated in the liner.

Cover soil shall conform to this specification and requirements shown on the drawings.

3. Shipping and storage

The liner material shall be transported to the job site and stored onsite in a manner that does not damage the rolls. The rolls shall be handled at the site with equipment capable of safely doing the job with no damage to the material. The rolls shall be stored on a flat, dry surface and shall be kept dry at all times.

4. Subgrade preparation

Irregularities and any abrupt grade changes shall be eliminated from the surface prior to placing the GCL. When the GCL is placed, the subgrade shall be dry, smooth, and free of debris, roots, ruts, and stones or any projection of more than 0.5 inch. All projections of more than 0.5 inches shall be removed, crushed, or pushed into the surface with a smooth-drum roller.

5. GCL installation

The contractor shall confine the work to an area that can be completely installed and covered by the end of the normal working day in a manner that will prevent the occurrence of hydration prior to being covered with the specified cover soils. Daily completion shall be defined as the full installation of the liner, covering around appurtenances, and placement of the specified cover soils.

The rolls shall be carefully rolled down the slope and not allowed to unroll freely and out of control. When it is necessary to drag liner panels, a geosynthetic subgrade covering known as a rub sheet shall be used to reduce friction and protect the GCL during placement.

The rolls shall be placed with the woven geotextile or geomembrane side against the subgrade. The GCL panels shall be placed so that the long axis of the panels is oriented up and down the slope. This panel orientation shall apply to all covered slopes including corner slopes. All seams shall be overlapped a minimum of 6 inches. End-of-roll seams shall be located at least 3 feet from the toe or crest of the slope. Seams at the base of the slope shall be a minimum of 6 feet from the toe.

Seams at the ends of panels should be constructed such that they are shingled in the direction of the grade to prevent flow from entering the overlap zone. The end of roll overlap shall be a minimum of 24 inches. All seam areas or runs shall be augmented with granular bentonite. Granular bentonite shall be dispersed evenly to cover the entire lapped area from the panel edge to the lap line at a minimum rate of 1 pound per 2 square feet of area covered. Seams shall remain closed during the backfill operation in order to prevent contamination of the bond surface and to ensure the panels remain in intimate contact, where jointed, at all times.

For penetrations or structures the liner will contact, a 3-inch by 3-inch notch shall be cut or dug in the subgrade around the penetration or structure.

For penetrations, the liner shall be brought up to the penetration and trimmed to fit into the notch. Granular bentonite or a compact mixture of 1 part bentonite to 4 parts soil (by volume), blended dry, shall be placed into the bottom half of the notch. The liner shall then be inserted into the notch, with the remaining area in the notch filled with the granular bentonite or the 1 to 4 mixture, and compacted. A secondary GCL collar shall be placed around horizontal penetrations. The collar shall overlap the GCL a minimum of 12 inches in each direction.

For liner terminated at a structure, granular bentonite or a compact mixture of one part bentonite to four parts soil (by volume), blended dry, shall be placed in the notch and against the structure. The liner shall extend over the notch and a minimum of 3 inches vertically adjacent to the structure.

The GCL shall be anchored at the top of the slope as shown on the drawings. The GCL shall be placed in the anchor trench so that it covers the entire trench bottom and only one trench wall.

The GCL shall be placed so that seams are parallel to the direction of the slope. End of roll seams shall be a minimum of 3-feet from the toe or crest of the slope.

The GCL shall not be placed in the rain, at times of impending precipitation, or in ponded water.

6. Repairs during installation

GCL that has begun to hydrate before being covered with soil shall be removed and replaced with dry GCL.

All damaged or flawed material shall be repaired as follows:

- Completely expose the affected area.
- Remove all soil or other foreign objects.
- Place a GCL patch over the exposed area with a minimum overlap of 12 inches on all edges.
- Place granulated bentonite between overlap at the rate of 1 pound per 2 square feet of area covered, and spread to a minimum width of 6 inches.
- On a sloping surface, fasten augment the bentonite-enhanced seam with construction adhesive.

7. Protective soil cover

A soil cover shall be placed to the final depths and moisture content as specified in section 9 of this specification or as shown on the plans.

At all times during the soil cover operation, a minimum of 12 inches of soil material shall be kept between the liner and any equipment being used to spread soil cover. In frequently trafficked areas or roadways, a minimum cover thickness of 2 feet is required. The soil cover on slopes shall be pushed up the slopes to prevent downhill stress on the liner material. Avoid sharp turns and quick starts or stops that could pinch or shift the liner.

8. Measurement and payment

For work for which specific unit prices are established in this contract, the quantity of liner installed shall be determined to the nearest square foot by measurement of the covered surfaces only, disregarding that for anchorage, seams, and overlaps. Payment for items listed separately in the contract bid schedule shall be made at the contract price for those items. Such payment shall constitute full compensation for furnishing, shipping, and installing the liner including all pipe boots or shirts, mechanical attachments to pipes and structures, and other items necessary and incidental to the completion of the work.

Compensation for any item of work described in the contract, but not listed in the bid schedule, is included in the payment for the item of work to which it is made subsidiary. Such items and the items to which they are made subsidiary are identified in section 9 of this specification.

9. Items of work and construction details