United States
Department of
Agriculture

**Natural
Resources
Conservation
Service**

Part 631 Geology
National Engineering Handbook

# Chapter 33 Investigations for Ground Water Resources Development

Issued November 1998

The United States Department of Agriculture (USDA) prohibits discrimination in all its programs and activities on the basis of race, color, national origin, gender, religion, age, disability, political beliefs, sexual orientation, and marital or family status. (Not all prohibited bases apply to all programs.) Persons with disabilities who require alternative means for communication of program information (Braille, large print, audiotape, etc.) should contact USDA's TARGET Center at (202) 720-2600 (voice and TDD).

To file a complaint, write USDA, Director, Office of Civil Rights, Room 326W, Whitten Building, 14th and Independence Avenue, SW, Washington, DC 20250-9410 or call (202)720-5964 (voice or TDD). USDA is an equal employment opportunity provider and employer.

# Acknowledgments

Chapter 33 was prepared under the guidance of **John S. Moore,** national hydrogeologist, Natural Resources Conservation Service, Washington, DC.

# Chapter 33 Investigations for Ground Water Resources Development

Contents:


| | | |
|---|---|---|
| 631.3300 | **Introduction** | **33–1** |
| 631.33.01 | **Determining critical collapse pressure in design of water well casing** | **33–1** |
| | (a) Steel well casing | 33–1 |
| | (b) Plastic casing | 33–5 |
| | (c) Safety factors | 33–8 |
| | (d) Design guidance | 33–8 |
| 631.3302 | **References** | **33–9** |

**Tables**

| | | |
|---|---|---|
| **Table 33–1** | Differential head limitations for steel casings | 33–2 |
| **Table 33–2** | Maximum allowable differential head for selected plastic pipe (SDR-PR) | 33–5 |
| **Table 33–3** | Dimension and differential head limitations for selected PVC-12454 plastic pipe, schedules 40 and 80 | 33–6 |
| **Table 33–4** | Dimension and differential head limitations for reinforced plastic (RPMP) well casings | 33–6 |

**Figures**

| | | |
|---|---|---|
| **Figure 33–1** | Maximum allowable differential head for steel pipe | 33–3 |
| **Figure 33–2** | Maximum allowable differential head for SDR-PR plastic pipe | 33–7 |

**Example**

| | | |
|---|---|---|
| **Example 33–1** | Collapse resistance for steel casing | 33–4 |

# Chapter 33 Investigations for Ground Water Resources Development

## 631.3300 Introduction

The purpose of this chapter is to provide guidance in the determination of critical collapse pressure in the design of water well casing. Considered are some of the most commonly used materials for water well casing that meet criteria in Conservation Practice Standard 642, Water Well (No.).

Maximum allowable collapse pressure of water well casing is based on collapse resistance (hydraulic pressure) associated with the maximum anticipated differential head. The term *differential head* applies to the difference in water levels between the inside and outside of the casing. For unconfined aquifers, maximum anticipated differential head is determined by subtracting the depth of maximum anticipated drawdown from the highest anticipated elevation of the water table. For confined aquifers, use the highest potentiometric surface.

## 631.33.01 Determining critical collapse pressure in design of water well casing

### (a) Steel well casing

The main factors affecting collapse resistance of steel casing are the diameter, wall thickness, and eccentricity (out-of-roundness). Eccentricity can originate from rough handling in transport or on the job site. Small eccentricity can result in significant loss of collapse resistance. Consider for example, 6.625-inch (outside diameter) steel casing with a wall thickness of 0.25 inch. The design collapse pressure for a perfect cylinder (no eccentricity) is 3,826 pounds per square inch (8,838 feet). However, by factoring in values for eccentricities of 0.5, 1.0, and 1.5 percent, the design collapse pressures are accordingly reduced to 1,576 pounds per square inch (3,639 feet), 1,231 pounds per square inch (2,844 feet), and 1,024 pounds per square inch (2,365 feet), respectively. For this reason, collapse resistance for steel casing is calculated by the Timoshenko Elastic Formula, which has an adjustment for eccentricity.

Table 33–1 gives differential head limitations calculated by the Timoshenko Elastic Formula using Young's Modulus of Elasticity (E) = $3 \times 10^7$ pounds per square inch; Poisson's ratio ($\mu$) = 0.30; casing eccentricity (e) = 0.01 (1%); yield strength ($Y_p$) = 35,000 pounds per square inch, and ultimate tensile strength = 60,000 minimum pounds per square inch, for selected sizes of ASTM A-139 Grade B carbon steel casing. Values for head in table 33–1 are rounded down to the nearest 5 feet.

**Table 33–1** Differential head limitations for steel casings

| | Nominal casing size (inches) 4 | 5 | 6 | 8 | 10 | 12 | 14 | 16 | 18 | 24 |
|---|---|---|---|---|---|---|---|---|---|---|
| Wall thickness | ---------- Outside diameter (inches) ---------- | | | | | | | | | |
| (uncoated) | 4.50 | 5.563 | 6.625 | 8.625 | 10.75 | 12.75 | 14.00 | 16.00 | 18.00 | 24.00 |
| Gage *(inches)* | ---------- Maximum differential head limitations (feet) ---------- | | | | | | | | | |
| 20 Ga (0.036) | 60 | 35 | 20 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| 18 Ga (0.048) | 140 | 75 | 45 | 20 | 0 | 0 | 0 | 0 | 0 | 0 |
| 16 Ga (0.060) | 250 | 145 | 90 | 40 | 20 | 0 | 0 | 0 | 0 | 0 |
| 14 Ga (0.075) | 460 | 260 | 160 | 80 | 40 | 25 | 20 | 0 | 0 | 0 |
| 12 Ga (0.105) | 1,040 | 630 | 400 | 200 | 110 | 70 | 50 | 35 | 0 | 0 |
| 10 Ga (0.135) | 1,810 | 1,140 | 750 | 390 | 220 | 135 | 105 | 70 | 50 | 0 |
| 8 Ga (0.164) | 2,660 | 1,740 | 1,190 | 640 | 360 | 230 | 180 | 125 | 90 | 0 |
| 7 Ga (0.179) | 3,130 | 2,090 | 1,450 | 790 | 460 | 290 | 230 | 160 | 110 | 0 |
| 3/16 (0.188) | 3,415 | 2,300 | 1,610 | 890 | 520 | 330 | 260 | 180 | 130 | 60 |
| 7/32 (0.219) | 4,430 | 3,070 | 2,200 | 1,260 | 750 | 500 | 390 | 270 | 200 | 90 |
| Sch. 40 (0.237) | 5,035 | --- | --- | --- | --- | --- | --- | --- | --- | --- |
| 1/4 (0.250) | | 3,880 | 2,840 | 1,680 | 1,030 | 690 | 550 | 390 | 290 | 130 |
| Sch. 40 (0.258) | | 4,090 | --- | --- | --- | --- | --- | --- | --- | --- |
| Sch. 40 (0.280) | | | 3,490 | --- | --- | --- | --- | --- | --- | --- |
| 9/32 (0.280) | | | | 2,140 | 1,350 | 910 | 730 | 520 | 390 | 180 |
| 5/16 (0.312) | | | | 2,625 | 1,690 | 1,160 | 930 | 680 | 510 | 240 |
| Sch. 40 (0.322) | | | | 2,785 | --- | --- | --- | --- | --- | --- |
| 11/32 (0.344) | | | | | 2,065 | 1,445 | 1,175 | 860 | 650 | 310 |
| Sch. 40 (0.365) | | | | | 2,325 | --- | --- | --- | --- | --- |
| 3/8 (0.375) | | | | | | 1,970 | 1,420 | 1,055 | 800 | 390 |
| Sch. 40 (0.406) | | | | | | 2,045 | --- | --- | --- | --- |
| Sch. 40 (0.438) | | | | | | | 1,975 | --- | --- | --- |
| 7/16 (0.438) | | | | | | | | 1,490 | 1,145 | 580 |
| Sch. 40 (0.500) | | | | | | | | 1970 | --- | --- |
| Sch. 40 (0.562) | | | | | | | | | 1,965 | --- |
| Sch. 40 (0.688) | | | | | | | | | | 1,645 |

Design collapse pressure ($P_d$) is the solution of the Timoshenko Elastic Formula

[33–1]

$$P_d^2 - P_d\left\{\frac{2Y_p}{(SDR-1)} + P_{cr}\left[1+3e(SDR-1)\right]\right\} + \frac{2Y_pP_{cr}}{SDR-1} = 0$$

where:

$P_d$ = design collapse pressure, lb/in$^2$ [alternatively, $2.31(P_d)$ = head, in ft]
$Y_p$ = yield strength, lb/in$^2$
e = casing eccentricity
$P_{cr}$ = critical collapse pressure of a perfect cylinder, lb/in$^2$, given by

$$P_{cr} = \frac{2E}{(1-\mu^2)\left[SDR(SDR-1)^2\right]}$$

where:

E = Young's modulus of elasticity, lb/in$^2$
$\mu$ = Poisson's ratio
SDR = standard dimension ratio, d/t
where:
d = outside diameter of casing, in
t = wall thickness of casing, in

Figure 33–1 may be used to determine maximum allowable differential head for ASTM A-139 Grade B carbon steel casing. The curve in figure 33–1 is a smooth plot of SDR's for steel casing in table 33–1 versus calculated critical collapse pressures (expressed as head, in feet) using equation 1. The curve simplifies the determination without having to run the Timoshenko calculation. The curve ($P_{cr}$ is in feet of head) may be expressed as:

$$P_{cr} = 1.4897 \times 10^7 (SDR)^{-2.5526} \qquad [33–2]$$

**Figure 33–1** Maximum allowable differential head for steel pipe

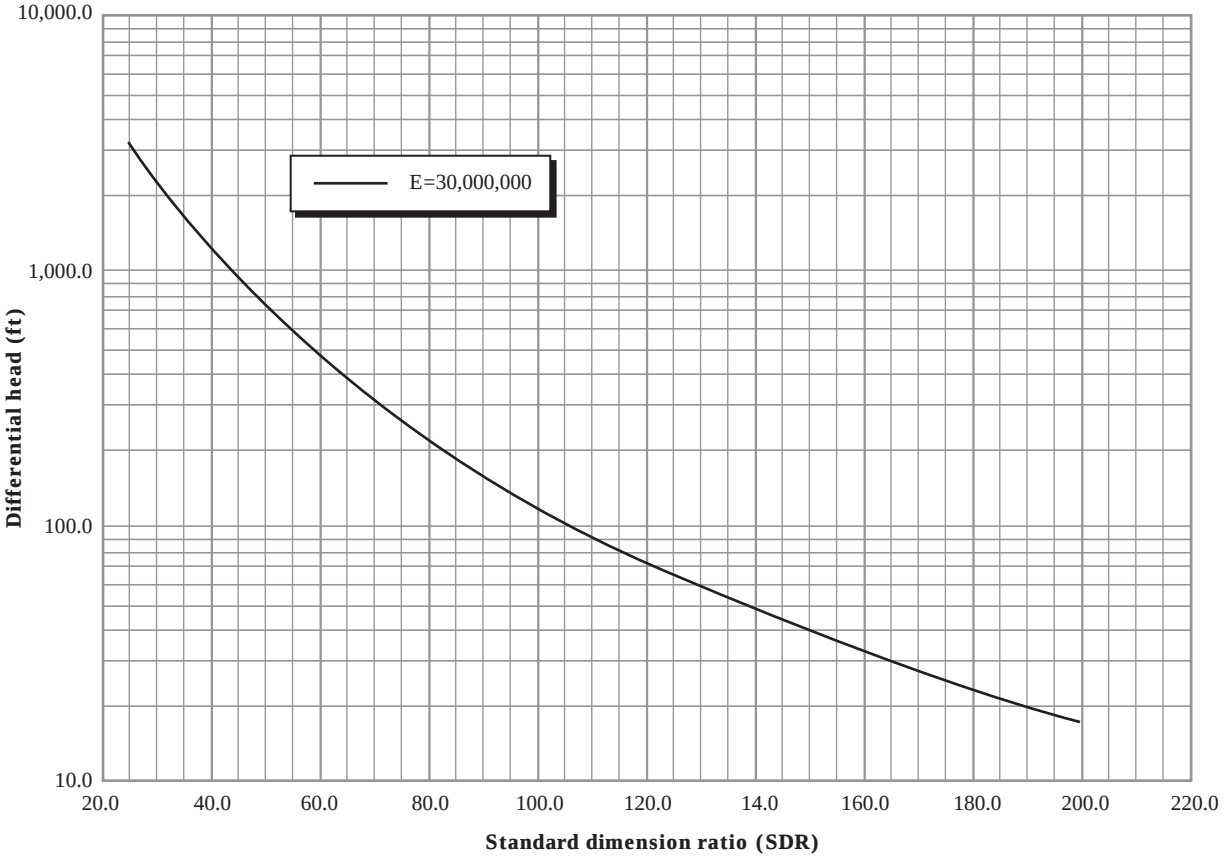

**Example 33–1** Collapse resistance for steel casing

**Problem:** A rancher is drilling a stock water supply well and would like to use some new 6-inch (nominal) Grade B Carbon steel casing on hand. Determine whether it meets criteria for maximum allowable head.

**Given:** The aquifer is unconfined, and the greatest anticipated differential head in the well is determined to be 925 feet. The steel casing has the following characteristics:

outside diameter = 6.625 in
8 gage steel = 0.164 in

**Solution:** Step 1—Calculate the Standard Dimension Ratio:

$$SDR = \frac{6.625}{0.164} = 40.4$$

Step 2—Determine maximum differential head limitation for 8 gage, 6.625 (outside diameter) steel casing, from table 33–1:

Answer = 1.190 ft

Step 3—Alternative. Use equation for curve in figure 33–1 to calculate maximum allowable differential head (result should be close to answer from Step 2):

$$P_{cr} = 1.4897 \times 10^{7} (40.4)^{-2.5526} = 1{,}182 \text{ ft}$$

Step 4—Decision. Because the greatest anticipated differential head, 925 feet, is less than the maximum allowable 1,190 feet, the rancher's casing can be used in this well.

## (b) Plastic casing

Critical collapse resistance for standard dimension ratio pressure-rated plastic pipe, denoted either SDR-PR or SR-PR, including ABS, PVC, and SR, is determined by the Clinedinst Equation (ASTM F-480). The Clinedinst Equation is:

$$P_{cr} = \frac{2E}{\left(1-\mu^2\right)\left[\mathrm{SDR}(\mathrm{SDR}-1)^2\right]} \qquad [33–3]$$

where:

$P_{cr}$ = critical collapse pressure, lb/in$^2$ [alternatively, 2.31($P_{cr}$) = head in ft]
E = Young's modulus of elasticity, lb/in$^2$ =
Poisson's ratio
SDR = standard dimension ratio, d/t, where:
d = outside diameter of casing, in
t = wall thickness of casing, in

Table 33–2 gives the maximum allowable differential head limitations for selected PVC, ABS, and SR plastic pipe (SDR-PR) based on equation 33–3 using $\mu$ = 0.38.

Table 33–3 gives dimension and differential head limitations for PVC-12454 plastic pipe, schedules 40 and 80, constructed of material with E = 400,000 pounds per square inch and $\mu$ = 0.38, based on the Clinedinst equation. Factors given at the bottom of table 33–3 may be used in determining limitations for ABS schedules 40 and 80 plastic pipe.

Table 33–4 provides dimension and differential head limitations for representative sizes of reinforced plastic (RPMP) well casings.

Figure 33–2 may be used to determine maximum allowable differential head for SDR-PR plastic pipe, including PVC (12454 and 14333), SR, and ABS (434 and 533). Four curves are plotted for representative values of E = 500,000, 400,000, 300,000, and 200,000 pounds per square inch and $\mu$ = 0.38, according to the Clinedinst equation. The maximum allowable differential head for different values of E may be determined either by interpolation from the curves in figure 33–2 or by direct calculation from equation 33–3.

**Table 33–2** Maximum allowable differential head for selected plastic pipe (SDR-PR)

| SDR | Material (modulus of elasticity, E, lb/in$^2$) | | | |
|---|---|---|---|---|
| | PVC-12454 | ABS-434 | SR and PVC-14333 | ABS-533 |
| | (400,000) | (360,000) | (320,000) | (260,000) |
| | Maximum allowable differential head | | | |
| | (ft) | (ft) | (ft) | (ft) |
| 13.5 | 1,020 | 920 | 815 | 665 |
| 17.0 | 495 | 445 | 395 | 320 |
| 21.0 | 255 | 230 | 205 | 165 |
| 26.0 | 130 | 120 | 105 | 85 |
| 32.5 | 65 | 60 | 50 | 40 |

**Table 33–3** Dimension and differential head limitations for selected PVC-12454 plastic pipe, schedules 40 and 80

| Nominal diameter (inches) | Outside diameter (inches) | Schedule 40 Minimum wall thickness (inches) | Schedule 40 SDR | Schedule 40 Maximum head (feet) | Schedule 80 Minimum wall thickness (inches) | Schedule 80 SDR | Schedule 80 Maximum head (feet) |
|---|---|---|---|---|---|---|---|
| 2 | 2.375 | 0.154 | 15.4 | 675 | 0.218 | 10.9 | 2,020 |
| 2.5 | 2.875 | 0.203 | 14.2 | 870 | 0.276 | 10.4 | 2,350 |
| 3 | 3.500 | 0.216 | 16.2 | 575 | 0.300 | 11.7 | 1,610 |
| 3.5 | 4.000 | 0.226 | 17.7 | 435 | 0.318 | 12.6 | 1,270 |
| 4 | 4.500 | 0.237 | 19.0 | 350 | 0.337 | 13.4 | 1,045 |
| 5 | 5.563 | 0.258 | 21.6 | 235 | 0.375 | 14.8 | 765 |
| 6 | 6.625 | 0.280 | 23.7 | 175 | 0.432 | 15.3 | 690 |
| 8 | 8.625 | 0.322 | 26.8 | 120 | 0.500 | 17.3 | 470 |
| 10 | 10.750 | 0.365 | 29.5 | 90 | 0.593 | 18.1 | 405 |
| 12 | 12.750 | 0.406 | 31.4 | 70 | 0.687 | 18.6 | 375 |

**Note:** Table 33–3 is for PVC schedule pipe having a modulus of elasticity of 400,000 pounds per square inch. For PVC schedule pipe having a modulus of elasticity of 360,000 pounds per square inch, multiply the maximum head by a factor of 0.9. For PVC schedule pipe having a modulus of elasticity of 320,000 pounds per square inch, use a factor of 0.8. For ABS schedules 40 and 80 pipe having a modulus of elasticity of 250,000 pounds per square inch, use a factor of 0.625. In all cases, $\mu = 0.38$.

**Table 33–4** Dimension and differential head limitations for reinforced plastic (RPMP) well casings

| Casing diameter (inches) | Maximum differential head (feet) 20 | 60 | 100 | 200 | 300 | 400 | 500 | 750 | 1,000 |
|---|---|---|---|---|---|---|---|---|---|
| | Minimum wall thickness (inches) | | | | | | | | |
| 8 | 0.17 | 0.17 | 0.23 | 0.23 | 0.23 | 0.29 | 0.29 | 0.33 | 0.33 |
| 10 | 0.17 | 0.17 | 0.28 | 0.28 | 0.28 | 0.36 | 0.36 | 0.41 | 0.41 |
| 12 | 0.18 | 0.19 | 0.34 | 0.34 | 0.34 | 0.43 | 0.43 | 0.46 | 0.46 |
| 14 | 0.19 | 0.22 | 0.34 | 0.34 | 0.40 | 0.43 | 0.46 | 0.46 | 0.46 |
| 15 | 0.19 | 0.24 | 0.34 | 0.34 | 0.46 | 0.46 | 0.46 | 0.46 | 0.46 |
| 16 | 0.20 | 0.25 | 0.36 | 0.36 | 0.46 | 0.46 | 0.46 | 0.46 | 0.46 |
| 18 | 0.21 | 0.28 | 0.40 | 0.40 | 0.46 | 0.46 | 0.46 | 0.52 | 0.52 |
| 20 | 0.21 | 0.31 | 0.42 | 0.42 | 0.46 | 0.46 | 0.46 | 0.54 | 0.54 |
| 21 | 0.21 | 0.33 | 0.48 | 0.48 | 0.48 | 0.48 | 0.48 | 0.57 | 0.57 |
| 24 | 0.24 | 0.38 | 0.48 | 0.48 | 0.48 | 0.57 | 0.57 | 0.57 | 0.57 |
| 27 | 0.26 | 0.40 | 0.49 | 0.49 | 0.49 | 0.62 | 0.62 | 0.62 | 0.62 |
| 30 | 0.29 | 0.44 | 0.49 | 0.49 | 0.49 | 0.68 | 0.68 | 0.68 | 0.68 |
| 33 | 0.32 | 0.44 | 0.60 | 0.60 | 0.60 | 0.75 | 0.75 | 0.75 | 0.75 |
| 36 | 0.35 | 0.48 | 0.65 | 0.65 | 0.65 | 0.82 | 0.82 | 0.82 | 0.82 |

**Figure 33–2** Maximum allowable differential head for SDR-PR plastic pipe

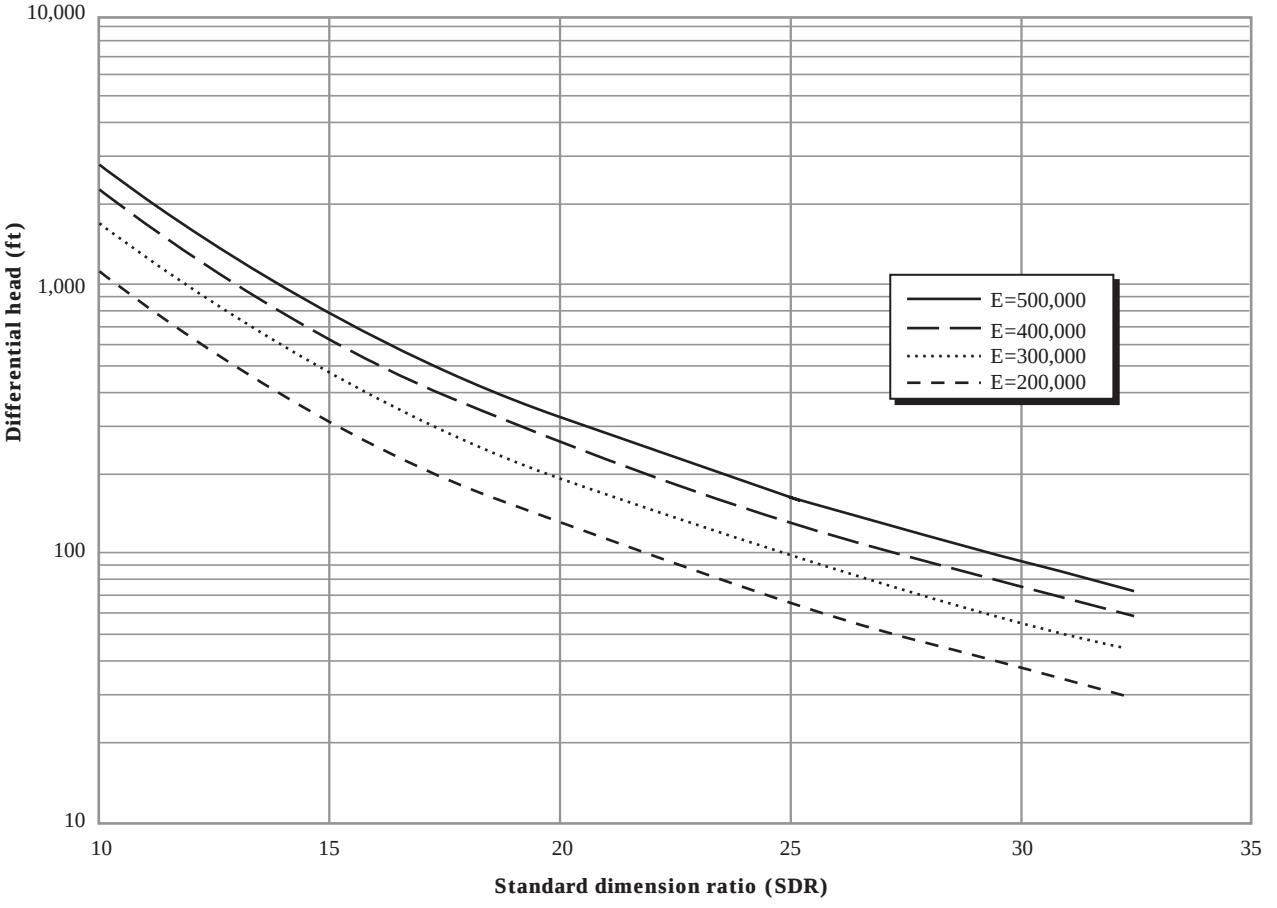

## (c) Safety factors

The data in table 33–1 are plotted in figure 33–1 and are calculated with an assumed eccentricity value of 1.0 percent (0.01) for steel casing. This adjustment is provided to account for out-of-roundness (deviation from rigorous production standards) that may arise in normal shipping and handling. Eccentricity up to 1.5 percent (0.015) can most likely be tolerated. However, collapse pressure needs to be recalculated using equation 33–1, the Timoshenko Elastic Formula with eccentricity adjustment. Used casing and casing with obvious eccentricity or other defects should be rejected.

Data for allowable differential head (collapse resistance) in tables 33–1 to 33–4 take into account only unbalanced hydrostatic pressure. Overburden pressure at depth in a vertical well is the sum of the weight of the overburden material and the contained ground water. Ordinarily, the weight of the formation is borne by the formation itself. Under some circumstances, part or all of the overburden pressure can be transmitted to the interstitial ground water and may result in casing collapse. Design must also take into consideration conditions that can result in collapse forces (static or dynamic) that exceed hydrostatic pressure.

Example of static conditions:

- Deep confined aquifers can generate significant artesian head on the outside of the casing.

Examples of dynamic conditions:

- Heavily pumped, deep, unconsolidated aquifers are subject to compaction and consolidation processes that can result in formation settlement, movement, and subsidence.
- An improperly installed filter pack (with bridged particles or pockets) can suddenly collapse, resulting in rupture of the casing or screen.
- In a fine sand aquifer, quick conditions can arise from an upward movement of ground water. The sand goes into suspension and is then unable to support the weight of the formation. Effective pressure is reduced to zero, and under-designed casing and screen could collapse.
- Earthquakes and blasting can generate temporary forces that result in rearrangement, consolidation, and settlement of aquifer materials that could cause otherwise satisfactory casing and screen to collapse. Sudden ground motions also can induce liquefaction of saturated fine sands and silts with similar deleterious effects on casing or screens.

## (d) Design guidance

If the well may be bailed or pumped dry, such as during development or when pumping a low yield well, the elevation of the bottom of the well should be substituted for the maximum drawdown elevation. Also, if maximum drawdown cannot be determined with confidence, it is a prudent practice to use the elevation of the bottom of the well.

If, in addition to unbalanced hydrostatic pressure, conditions at the well site are anticipated to result only in static pressure increases on the casing and screen, use 40 percent of the maximum allowable differential head values provided in the tables and figures. If dynamic increases in pressure are anticipated, the values should be even less. See example conditions in (c) Safety factors.

## 631.3302 References

American Society for Testing and Materials. 1998. ASTM A-139, Standard specification for electric-fusion (Arc)-welded steel pipe (NPS 4 and over).

American Society for Testing and Materials. 1995. ASTM F-480, Standard specification for thermo-plastic well casing pipe and couplings made in standard dimension ratios (SDR), SCH 40 and SCH 80.

American Water Works Association. 1998. AWWA standard for water wells. Denver, CO, 73 pp.

Driscoll, F.G. 1986. Ground water and wells. Johnson Division, St. Paul, MN, 1089 pp.

Roscoe Moss Company. 1993. Guide to water well casing and screen selection. Los Angeles, CA, 76 pp.

Roscoe Moss Company. 1990. Handbook of ground water development. Los Angeles, CA, John Wiley and Sons, NY, 493 pp.

National Ground Water Association and Plastic Pipe Institute. 1990. Manual on the selection and installation of thermoplastic water well casing. National Ground Water Association, Westerville, OH, and Plastic Pipe Institute, New York, NY, 64 pp.